


2998-G-089
SH 18

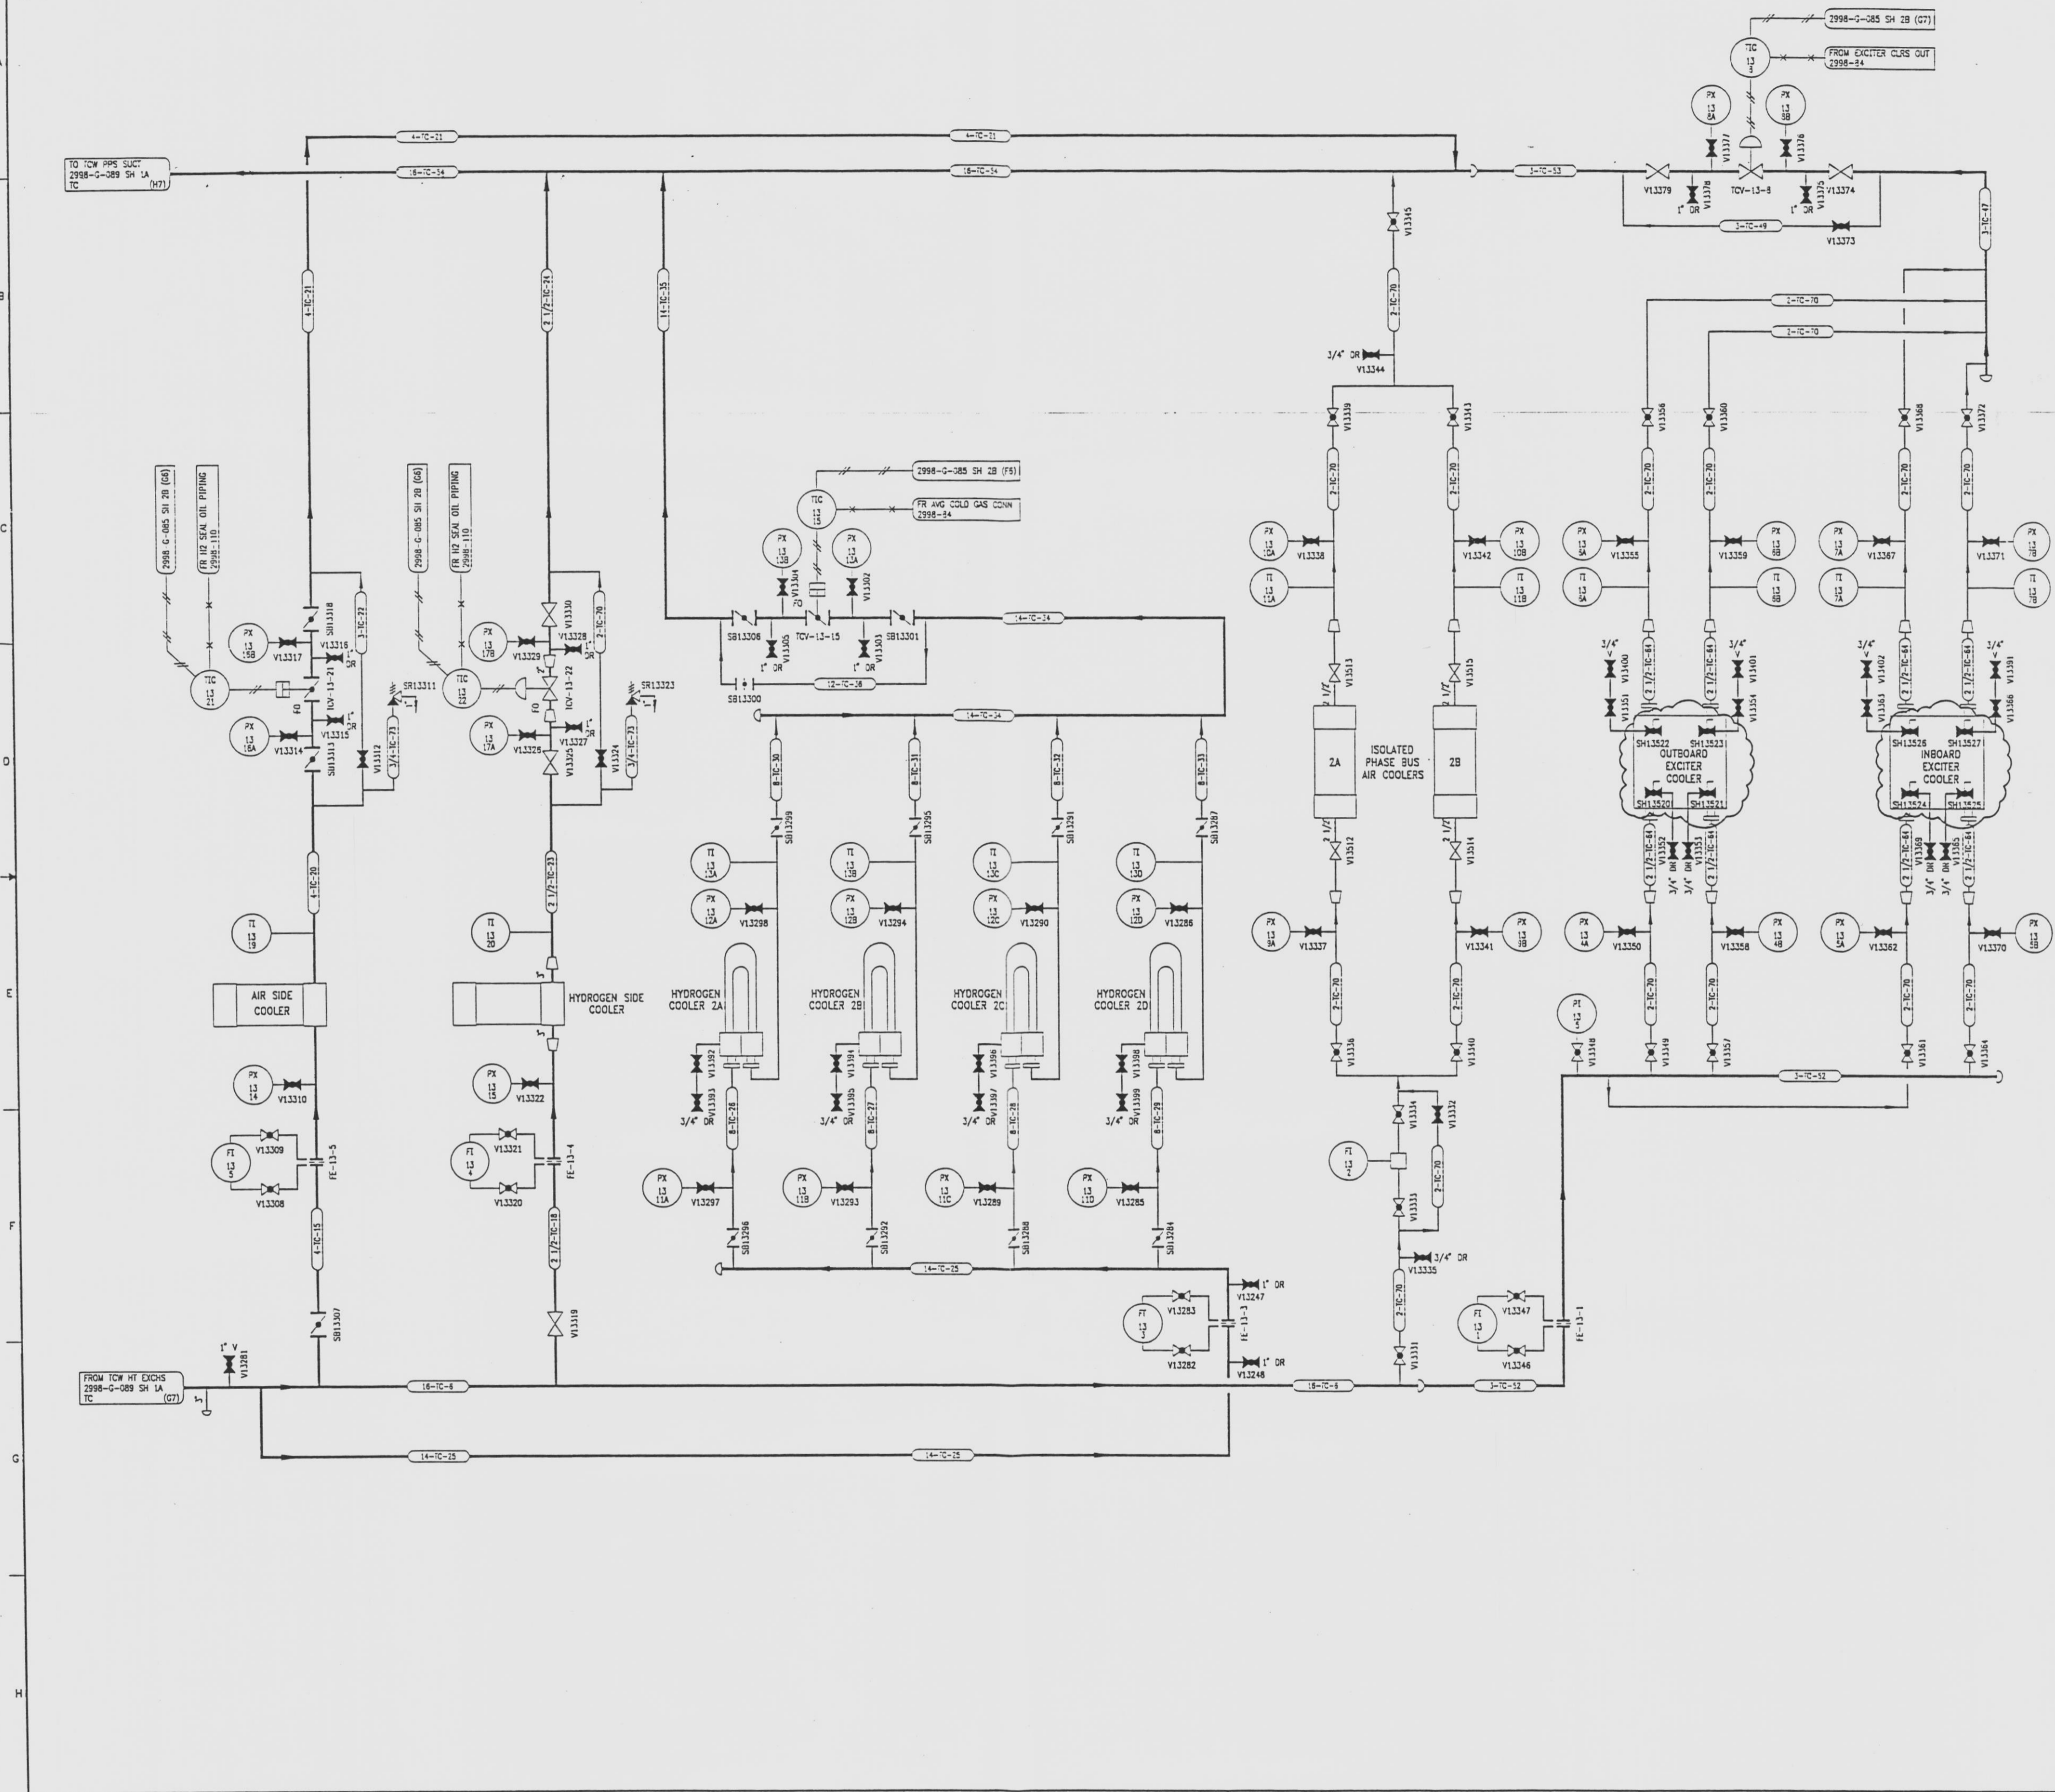

REVISIONS				
NO	DATE	DESCRIPTION	BY	APPROVED
19	7/24/93		CC	JLT
20	8-1-93		JCW	JLT
21	8-1-93		JCW	JLT

DFV
DRAWING NUMBER

2998-G-089
SH 18
DRAWING NUMBER

2998-G-089
SH 18
DRAWING NUMBER

DRAWING NUMBER

REFERENCE DRAWINGS
 PIPING, VALVES & INSTRUMENT SYMBOLS 2998-G-078 SH 100
 VALVE LIST 2998-A-051
 LINE LIST 2998-B-052
 VALVE OPERATIONAL NUMBER INDEX 2998-B-053A
 INSTRUMENT INSTALLATION DETAILS 2998-B-111
 INSTRUMENT LIST 2998-B-270C

INFORMATION ONLY
 VERIFY WITH A CONTROLLED COPY BEFORE USE

RECORDED
 MAY 1 1998
 DOCUMENT CONTROL CENTER

NOTE:
 THIS DRAWING IS MADE FROM REV. 18
 OF DRAWING 2998-G-089 SH 1

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 9.2-9
 FLORIDA POWER & LIGHT COMPANY
 ST. LUCIE PLANT
 1983 - 890 MW EXTENSION - UNIT 2
 FLOW DIAGRAM
 TURBINE COOLING WATER SYSTEM

RAYTHEON ENGINEERS & CONSTRUCTORS, INC.
 SCALE: NONE
 APPROVAL: [Signature]
 DATE: 2998-G-089
 SHEET 18 OF 20

2998-G-089 SH 18

9712040015-01 E

9712040015-01 E