

2998-G-085
SH. 2C


REVISIONS					
NO	DATE	DESCRIPTION	BY	CH	APPROVED
30	7/24/95	DCR-SLM-94-02: REDRAWN	DAK	WJP	JJZ
31	6/12/96	PC/M 86051: REV. (E&F-7) BRANCH LOCATIONS. DEL: (D-7) VALVE V18255. PC/M 86151: REV. (G-4,H-5) CAP LINES, (H-5) VALVE V18618 CLOSED. DEL: (G-4, H-5) PIPING AND VALVES	GM	GW	BJP
32	10/4/96	DCR 86037-6036: ADD: (G5) VALVE MODE LO	GM	HS	JRH
33	11/9/96	DCR 86037-5976: REV. (E5) VALVE POSITION	GM	HS	DG
34	3/17/97	DCR 860208: REV. (D5,E5,F5) VALVE POSITIONS	GM	GM	SHM
35	4/21/97	DCR 860229: REV. (D5,C5) CONTINUATIONS	GM	GM	JPL

DRAWING NUMBER
2998-G-085
SH. 2C

DRAWING NUMBER
2998-G-085
SH. 2C

DRAWING NUMBER
2998-G-085
SH. 2C

NUMBER

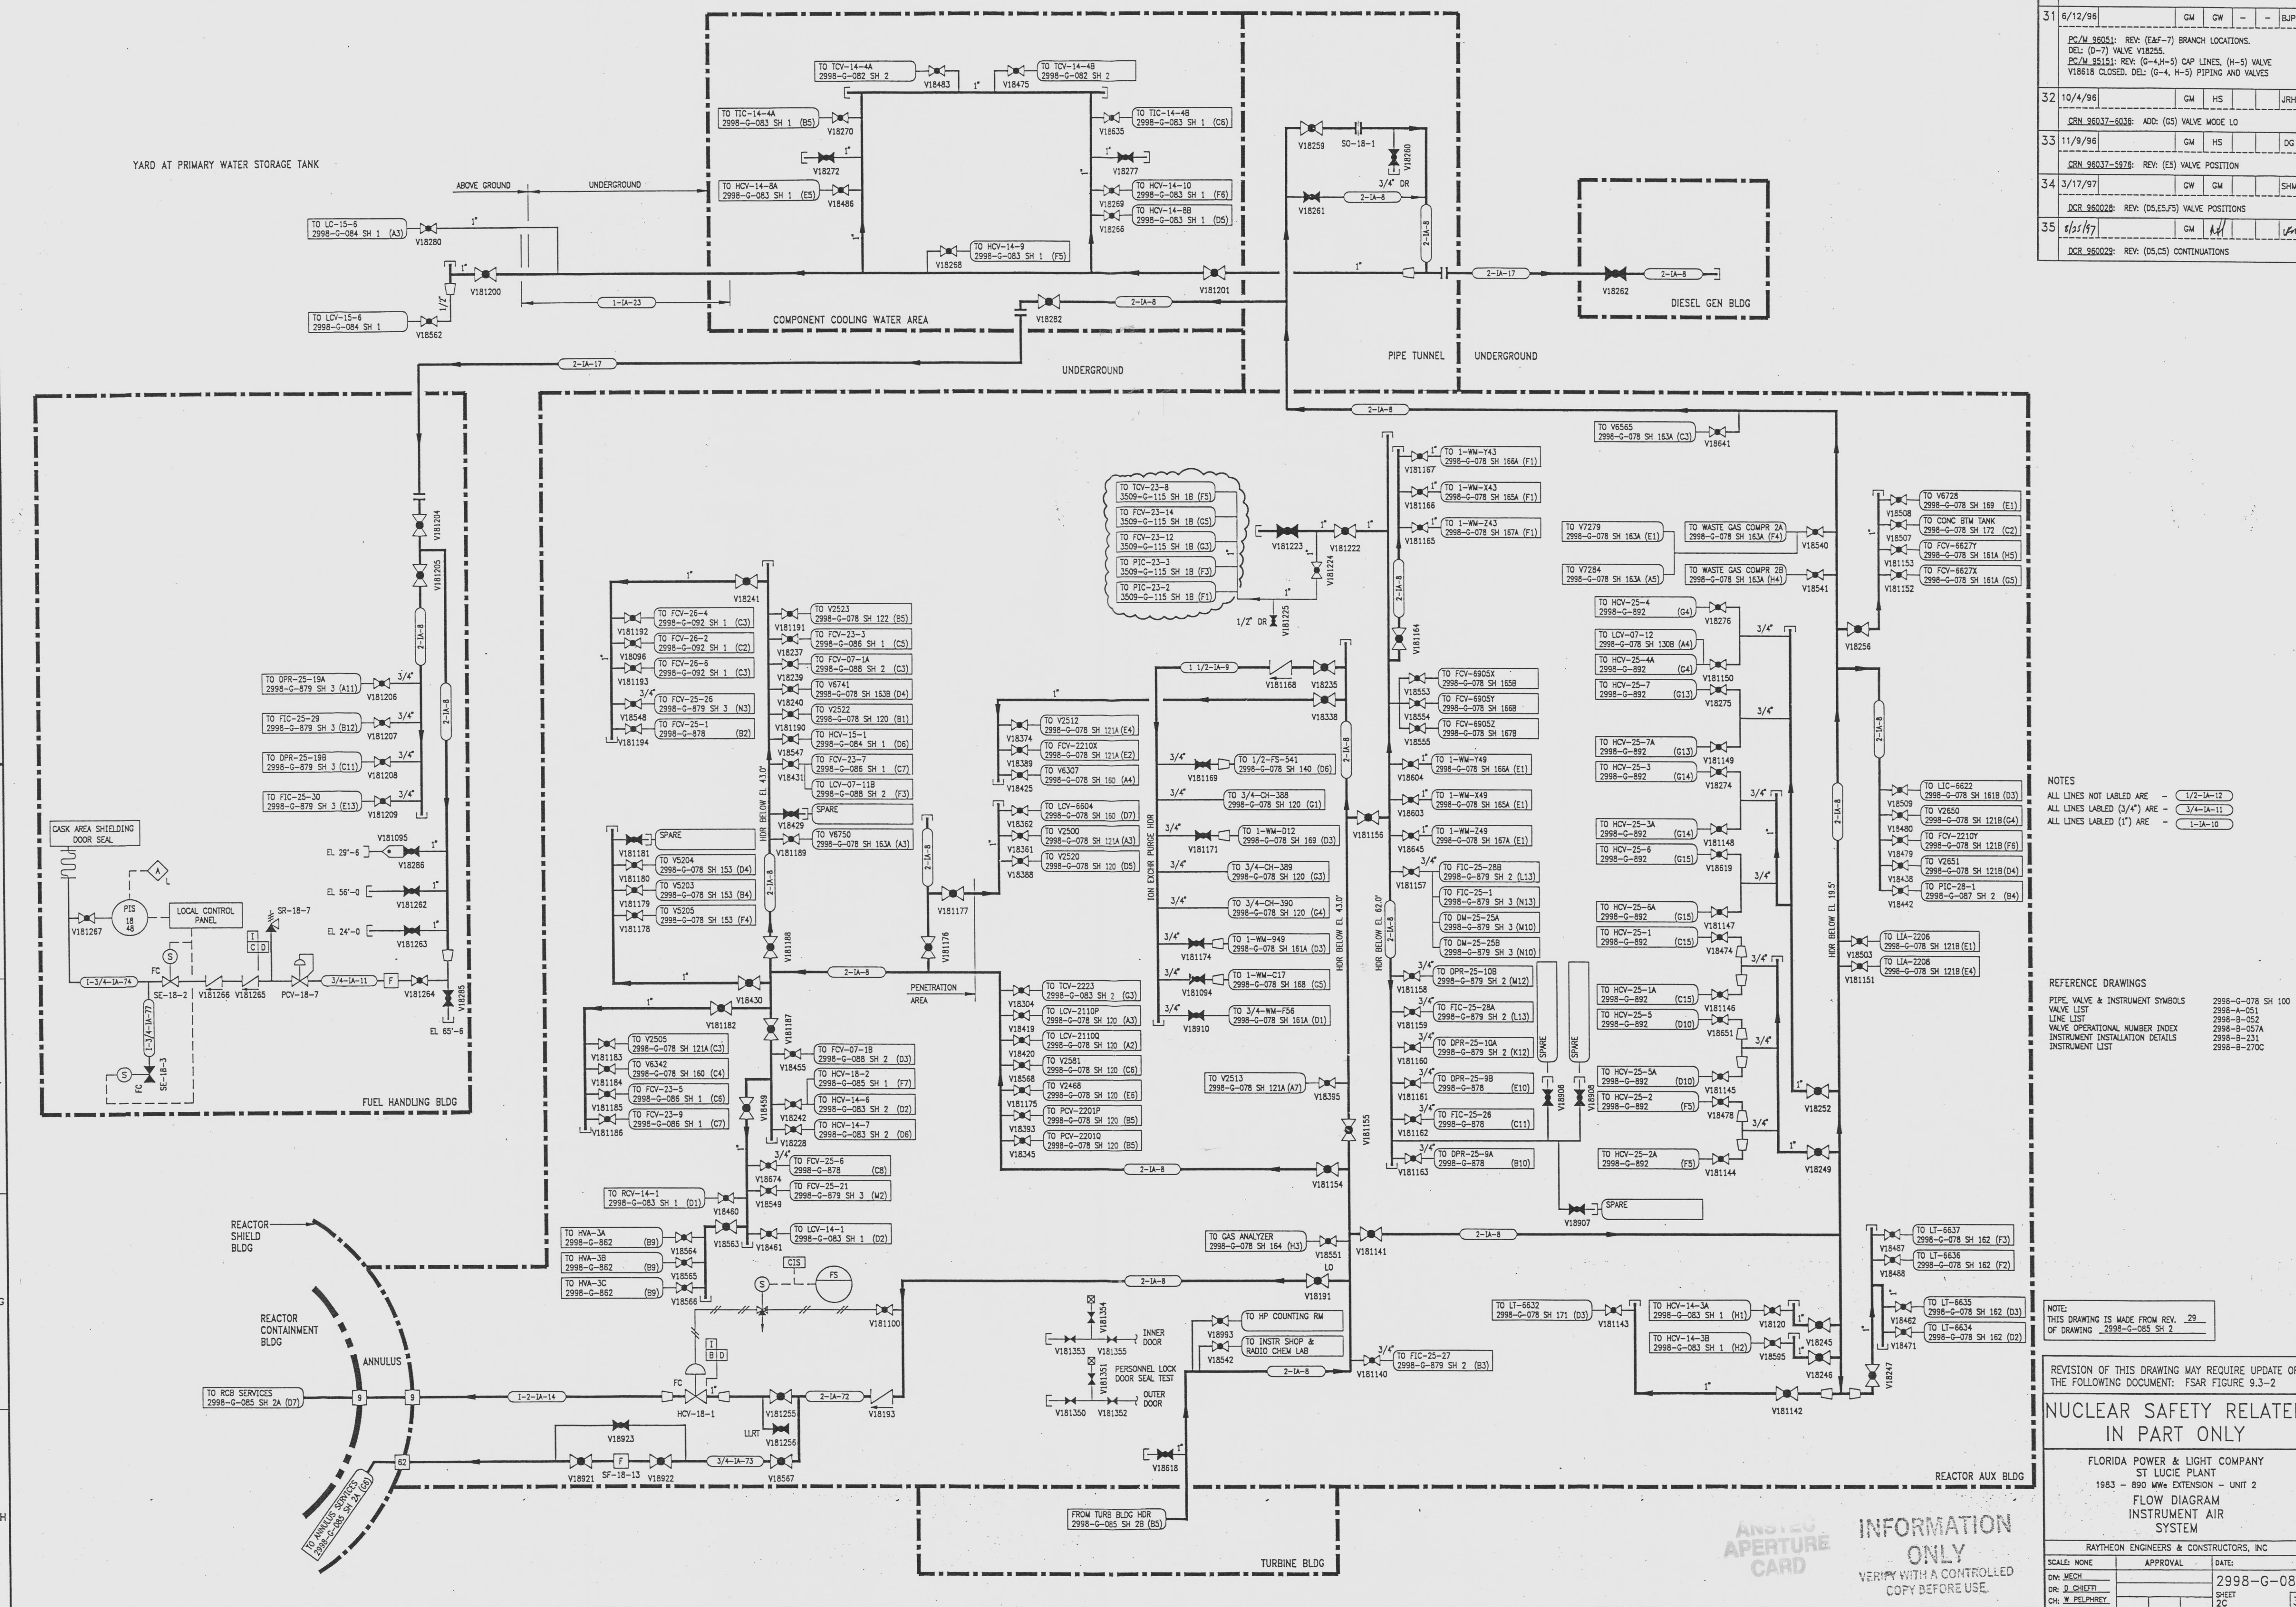

NOTES

ALL LINES NOT LABELED ARE - 1/2-IA-12
 ALL LINES LABELED (3/4") ARE - 3/4-IA-11
 ALL LINES LABELED (1") ARE - 1-IA-10

REFERENCE DRAWINGS

PIPE VALVE & INSTRUMENT SYMBOLS 2998-G-078 SH 100
 VALVE LIST 2998-A-051
 LINE LIST 2998-B-052
 VALVE OPERATIONAL NUMBER INDEX 2998-B-074
 INSTRUMENT INSTALLATION DETAILS 2998-B-231
 INSTRUMENT LIST 2998-B-270C

NOTE: THIS DRAWING IS MADE FROM REV. 29 OF DRAWING 2998-G-085 SH 2

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 9.3-2

NUCLEAR SAFETY RELATED IN PART ONLY

FLORIDA POWER & LIGHT COMPANY
 ST LUCIE PLANT
 1983 - 890 MW EXTENSION - UNIT 2
 FLOW DIAGRAM
 INSTRUMENT AIR SYSTEM

RAYTHEON ENGINEERS & CONSTRUCTORS, INC

SCALE: NONE APPROVAL DATE: 2998-G-085
 DW: MECH DR: D. CHEFFI CH: M. PELPHREY SHEET 2C

INFORMATION ONLY
 VERIFY WITH A CONTROLLED COPY BEFORE USE.

ANSI APTURE CARD

USM00088.DWG

E 9712040015-01