2998-G-394 SH. 3

N

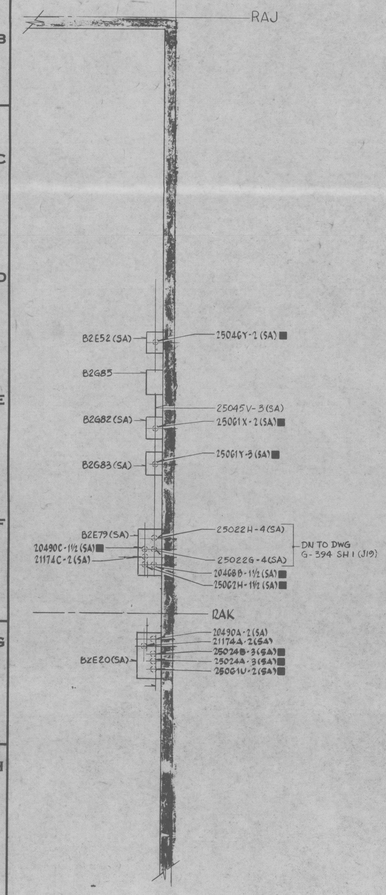

DETAIL E (F-10)
NTS

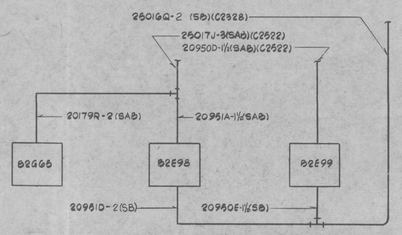

DETAIL - F
(DWG 2998-G-394 SH.1 (J5)

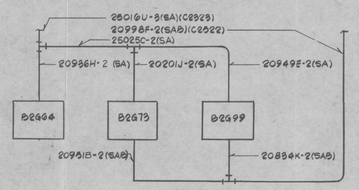

DETAIL - G
(DWG 2998-G-394 SH.1 (L5)

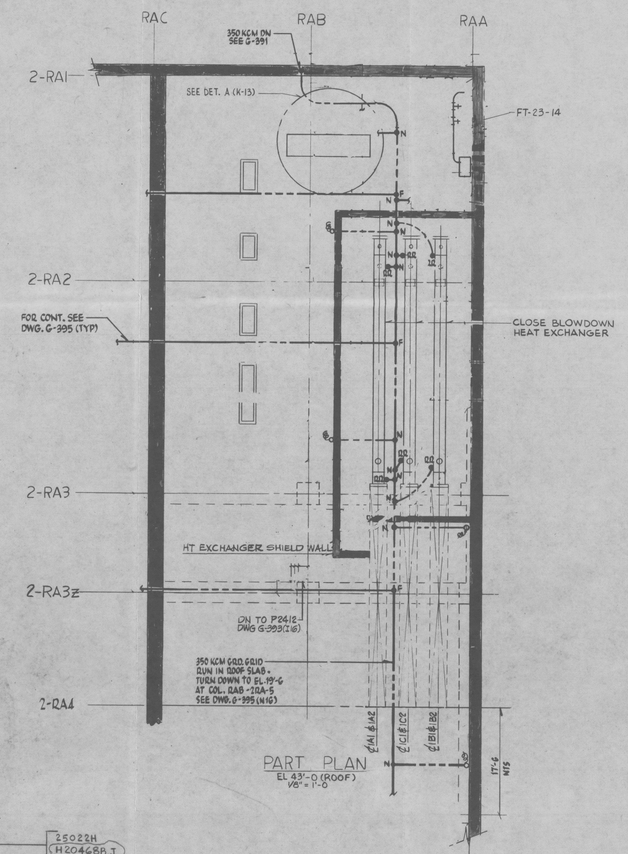

PART PLAN
EL 43'-0 (ROOF)
3/8" = 1'-0

NOTES:
1- FOR ALL NOTES SEE DWG
2- FOR SYMBOLS & REFERENCE DWGS SEE DWG 2998-G-392
3- ■ EXPOSED CONDUIT RUN BELOW SLAB (FLOOR) EL.G1'-0.
4. ● SEE DWG 3509-B-827 FOR CONTROL WIRING DIAGRAMS

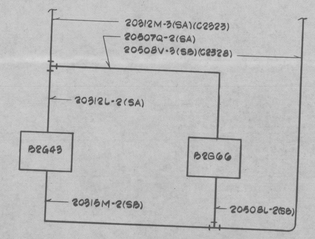

DETAIL - H
(DWG 2998-G-394 SH.1 (E5)

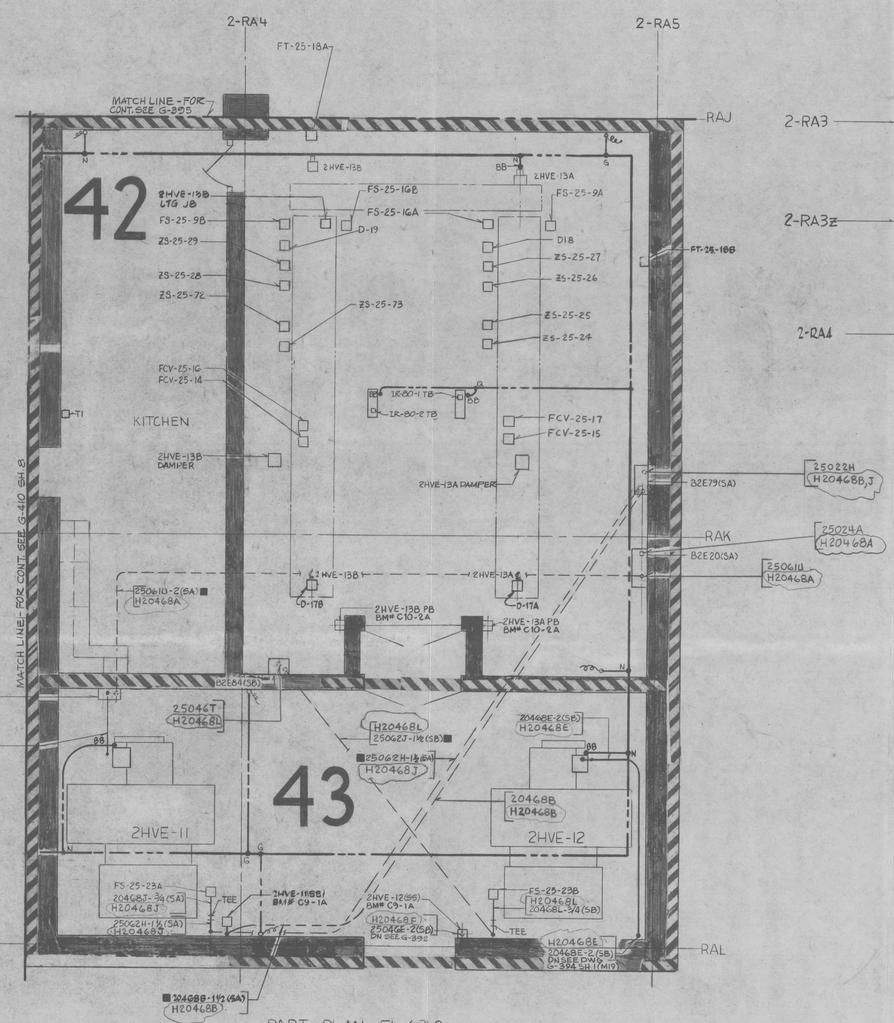

PART PLAN - EL 62'-0

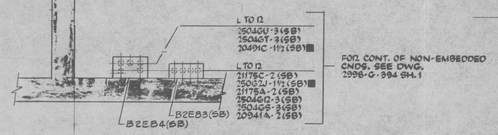

DETAIL B (J-7)
NTS

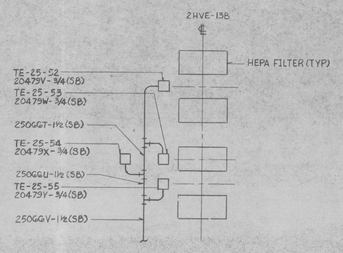

DETAIL C (H-7)
(NOT TO SCALE)

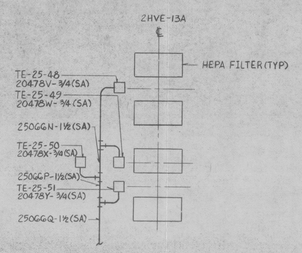

DETAIL D (G-8)
(NOT TO SCALE)

PRC APERTURE CARD

Docket # 50-389
Control # 8206230313
DOC 1/14/82 of Documents
REGULATORY DOCKET FILE

-29 E

ATTACHMENT 6 REV. 1

NUCLEAR SAFETY RELATED

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF SEP 1, 1975 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983-890 MW(e) EXTENSION-UNIT NO.2
REACTOR AUXILIARY BUILDING EL. 62'-0
CONDUIT & GROUNDING SH. 3

EBASCO SERVICES INCORPORATED

SCALE 3/8"=1'-0 UNLESS NOTED	APPROVED	DATE
DIV. ELEC.		2998-G-394 SH. 3
DR. SURENA		
CH. R.DESOUZA		

NO.	DATE	REVISION	BY	CH.	APPROVED