

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8102230391 DOC. DATE: 81/02/05 NOTARIZED: NO DOCKET #
 FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe 05000397
 AUTH. NAME: MATLOCK, R.G. AUTHOR AFFILIATION: Washington Public Power Supply System
 RECIP. NAME: ENGELKEN, R.H. RECIPIENT AFFILIATION: Region 5, San Francisco, Office of the Director

SUBJECT: Final deficiency rept re apparent lack of environ (radiation stress) qualification for Rosemount Pressure Transmitters 1151 D&G, initially reported 801215. Transmitters found properly qualified. Potential deficiency not reportable.

DISTRIBUTION CODE: B019S COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2
 TITLE: Construction Deficiency Report (10CFR50.55E)

NOTES: PM: 2 copies of all material. 05000397


ACTION:	RECIPIENT		COPIES		RECIPIENT	COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME	LTTR
ACTION:	A/D LICENSNG	04	1		YOUNGBLOOD, B	05	1
	RUSHBROOK, M.	06	1		LYNCH, D.	07	1
INTERNAL:	AD/RCI/IE	17	1		ASLBP/J.HARD		1
	D/DIR HUM FAC	15	1		DIR, DIV OF LIC		1
	EDU & STAFF	19	1		EQUIP QUAL BR11		1
	HYD/GEO BR	22	1		I&E	09	1
	LIC QUAL BR	12	1		MPA	20	1
	NRC PDR	02	1		OELD	21	1
	PROC/TST REV	13	1		QA BR	14	1
	<u>REG FILE</u>	01	1		RUTHERFORD, W.	IE	1
STANDRDS DEV	21	1					
EXTERNAL:	ACRS	16	16	1	LPDR	03	1
	NSIC	08	1				


FEB 24 1981

6

MAX

TOTAL NUMBER OF COPIES REQUIRED: LTTR 41 ENCL 0

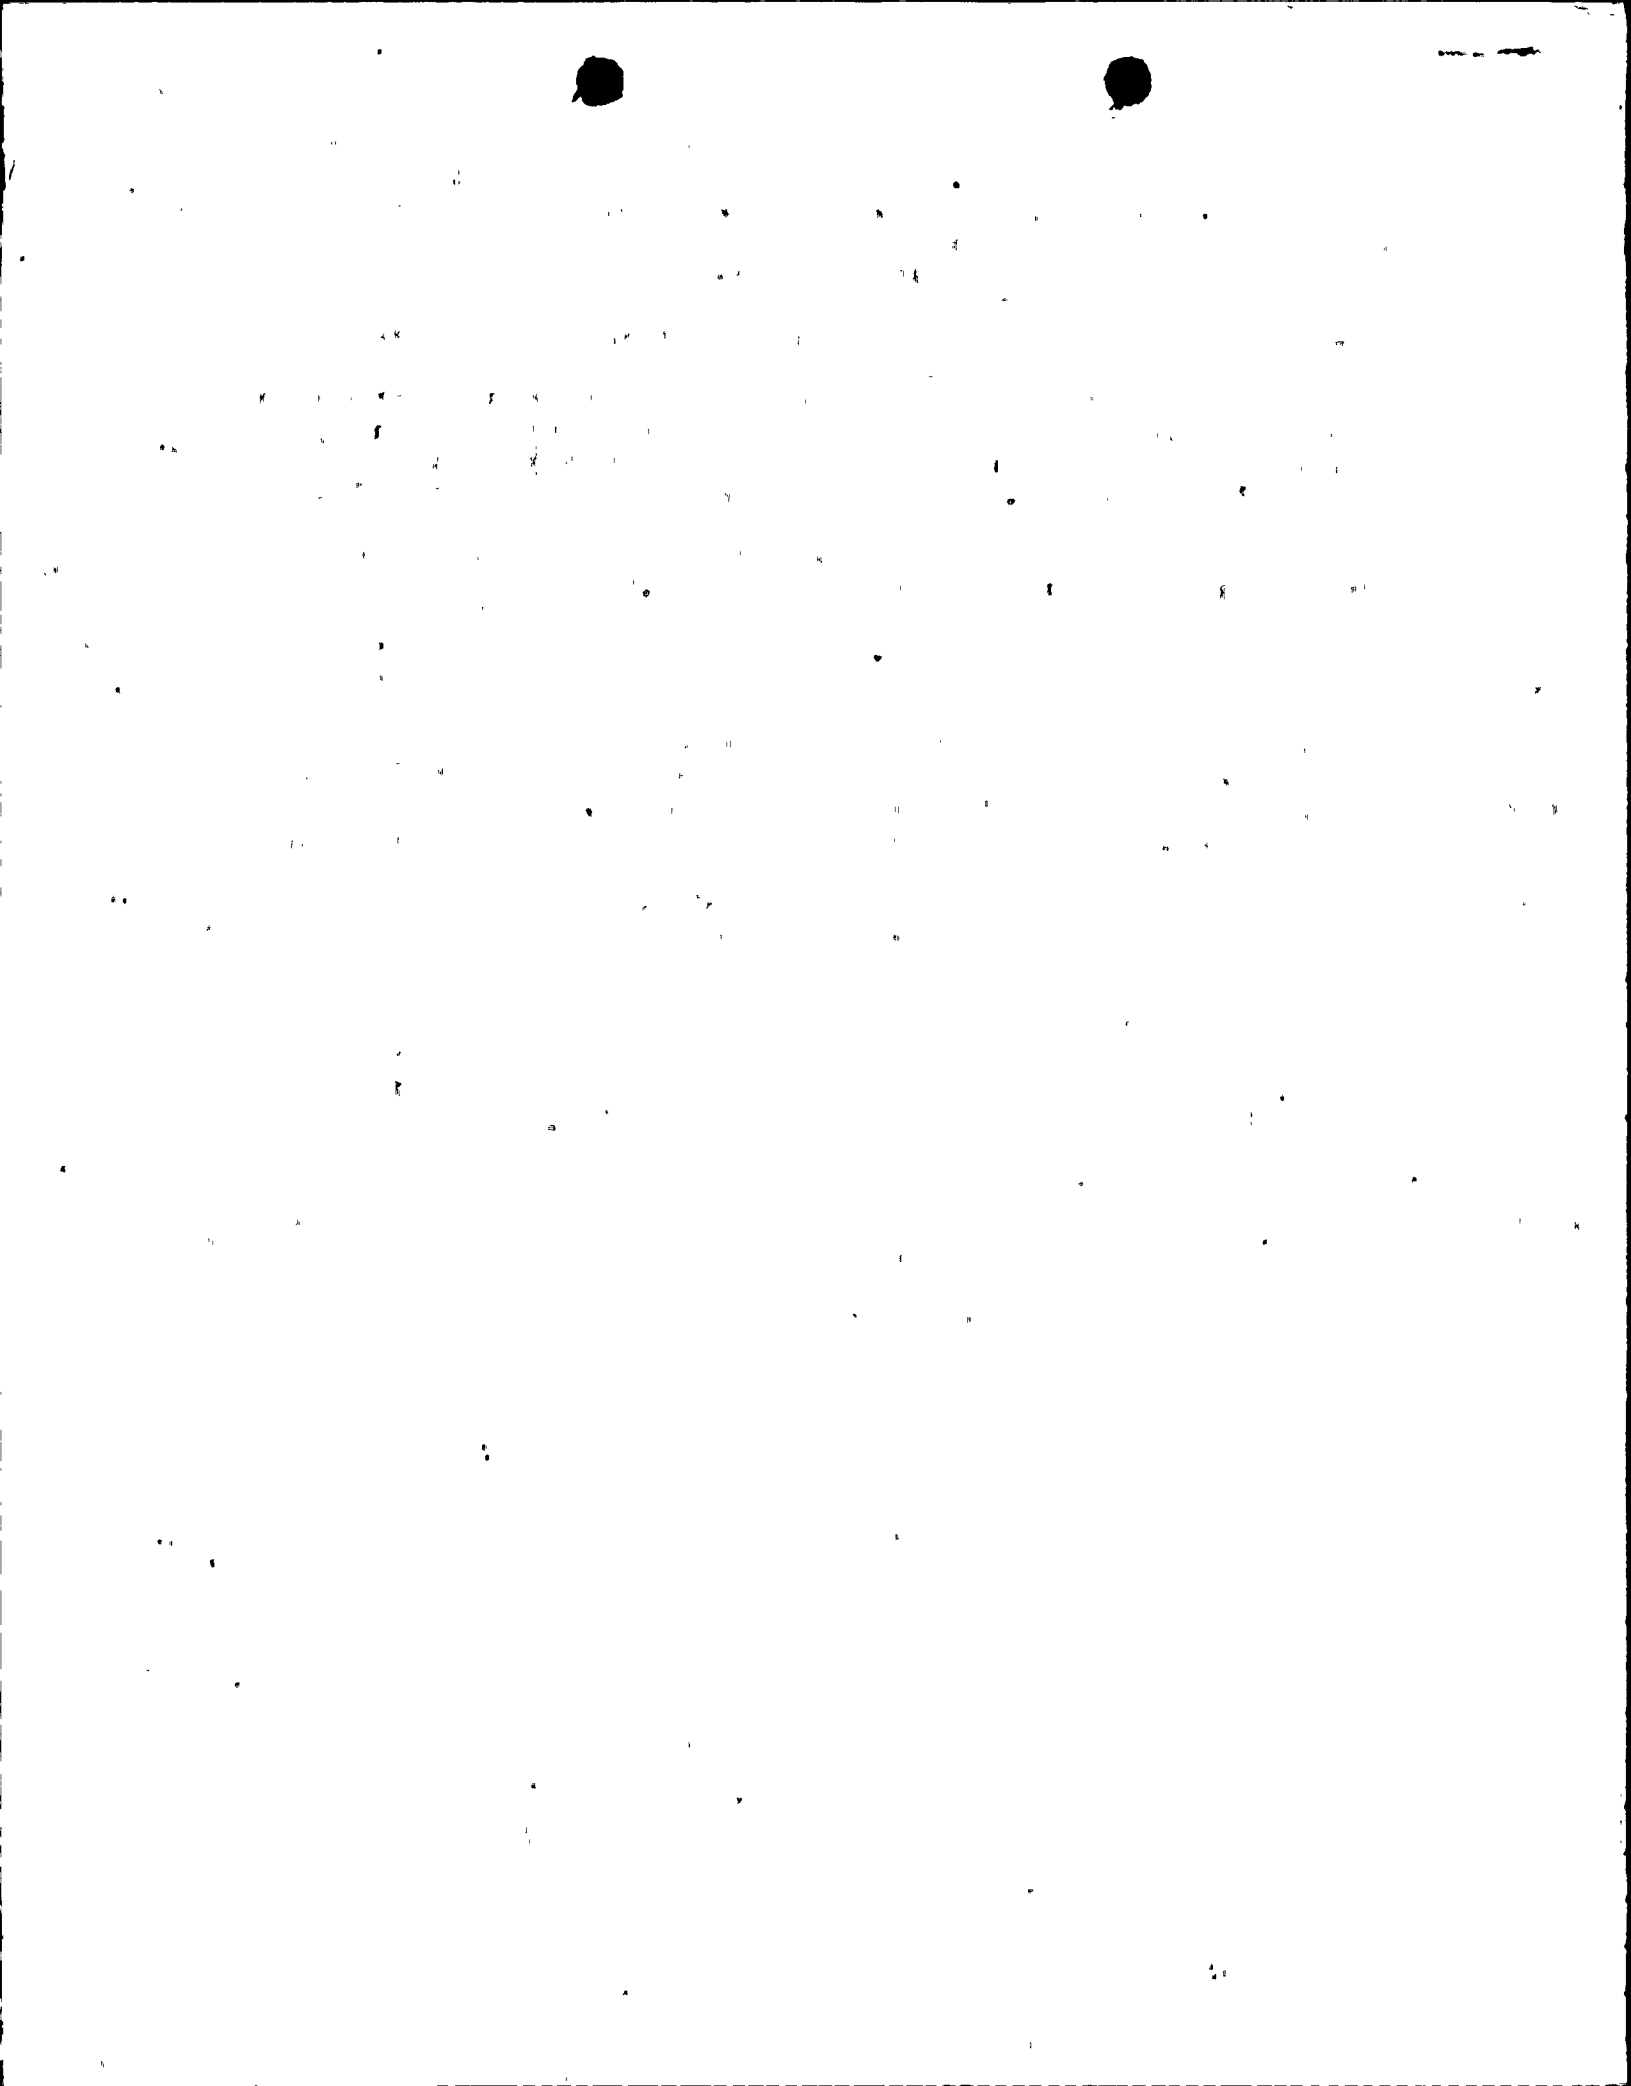

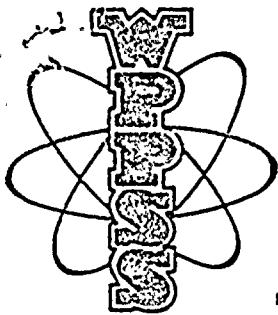

Washington Public Power Supply System
A JOINT OPERATING AGENCY

P.O. BOX 968 3000 GEO. WASHINGTON WAY RICHLAND, WASHINGTON 99352 PHONE (509) 372-5000

February 5, 1981
G02-81-22

Docket No. 50-397
CPPR-93

Nuclear Regulatory Commission
Region V
Suite 202, Walnut Creek Plaza
1990 North California Blvd.
Walnut Creek, California 94596

Attention: Mr. R. H. Engelken, Director
Office of Inspection and Enforcement


Gentlemen:

Subject: WPPSS Nuclear Project No. 2
Potentially Reportable Deficiency-10CFR50.55(e)
Environmental Qualification of Rosemount
Pressure Transmitters, Models 1151 D&G

Reference: Letter G02-80-298, dated December 15, 1980
RG Matlock to RH Engelken, same subject

In accordance with the guidelines established for the reporting of 10CFR50.55(e) conditions, an interim report was transmitted to you by WNP-2 Docket Letter, G02-80-298, dated December 15, 1980, describing a potentially reportable deficiency. The deficiency involved the apparent lack of environmental (radiation stress) qualification for Rosemount Pressure Transmitters, Models 1151 D&G, used in safety-related system designs.


After a thorough investigation involving the equipment manufacturer (Rosemount Engineering) and the equipment supplier (General Electric), it has been determined that the Rosemount Pressure Transmitters, Models 1151 D&G, supplied to WNP-2 are properly qualified for use in the

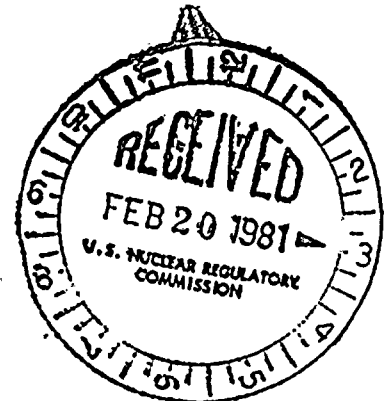

8102230391

5

B019
S/10



Washington Public Power Supply System

radiation environment expected at WNP-2. Therefore, the potentially reportable deficiency has been concluded to be not reportable.

Very truly yours,

R.G. Matlock
Program Director, WNP-2

RGM:GWB:cph

cc: JJ Verderber - Burns & Roe
V. Stello - NRC
AD Toth - NRC Resident Inspector
B. Wood - NUS/LIS
WS Chin - Bonneville Power Admin.
WNP-2 Files
RC Root - B&R Site 901A
RE Snaith - B&R NY

