


REVISIONS				
NO	DATE	DESCRIPTION	BY	APPROVED
30	7/24/95	DCR-SLM-94-052: REDRAWN	DWC	JJZ
31	4/2/96	DCR-SLM-96-013: REVISE (F3) CONTINUATION(V181109)	JGW	JJZ
32	10-4-96	CRN 98037-8038: ADD (G3,H3) VALVE MODE L.O. ADD (E6) VALVE MODE L.C.	GM	JJZ

DRAWING NUMBER
2998-G-085
SH 2A

DRAWING NUMBER

NUMBER

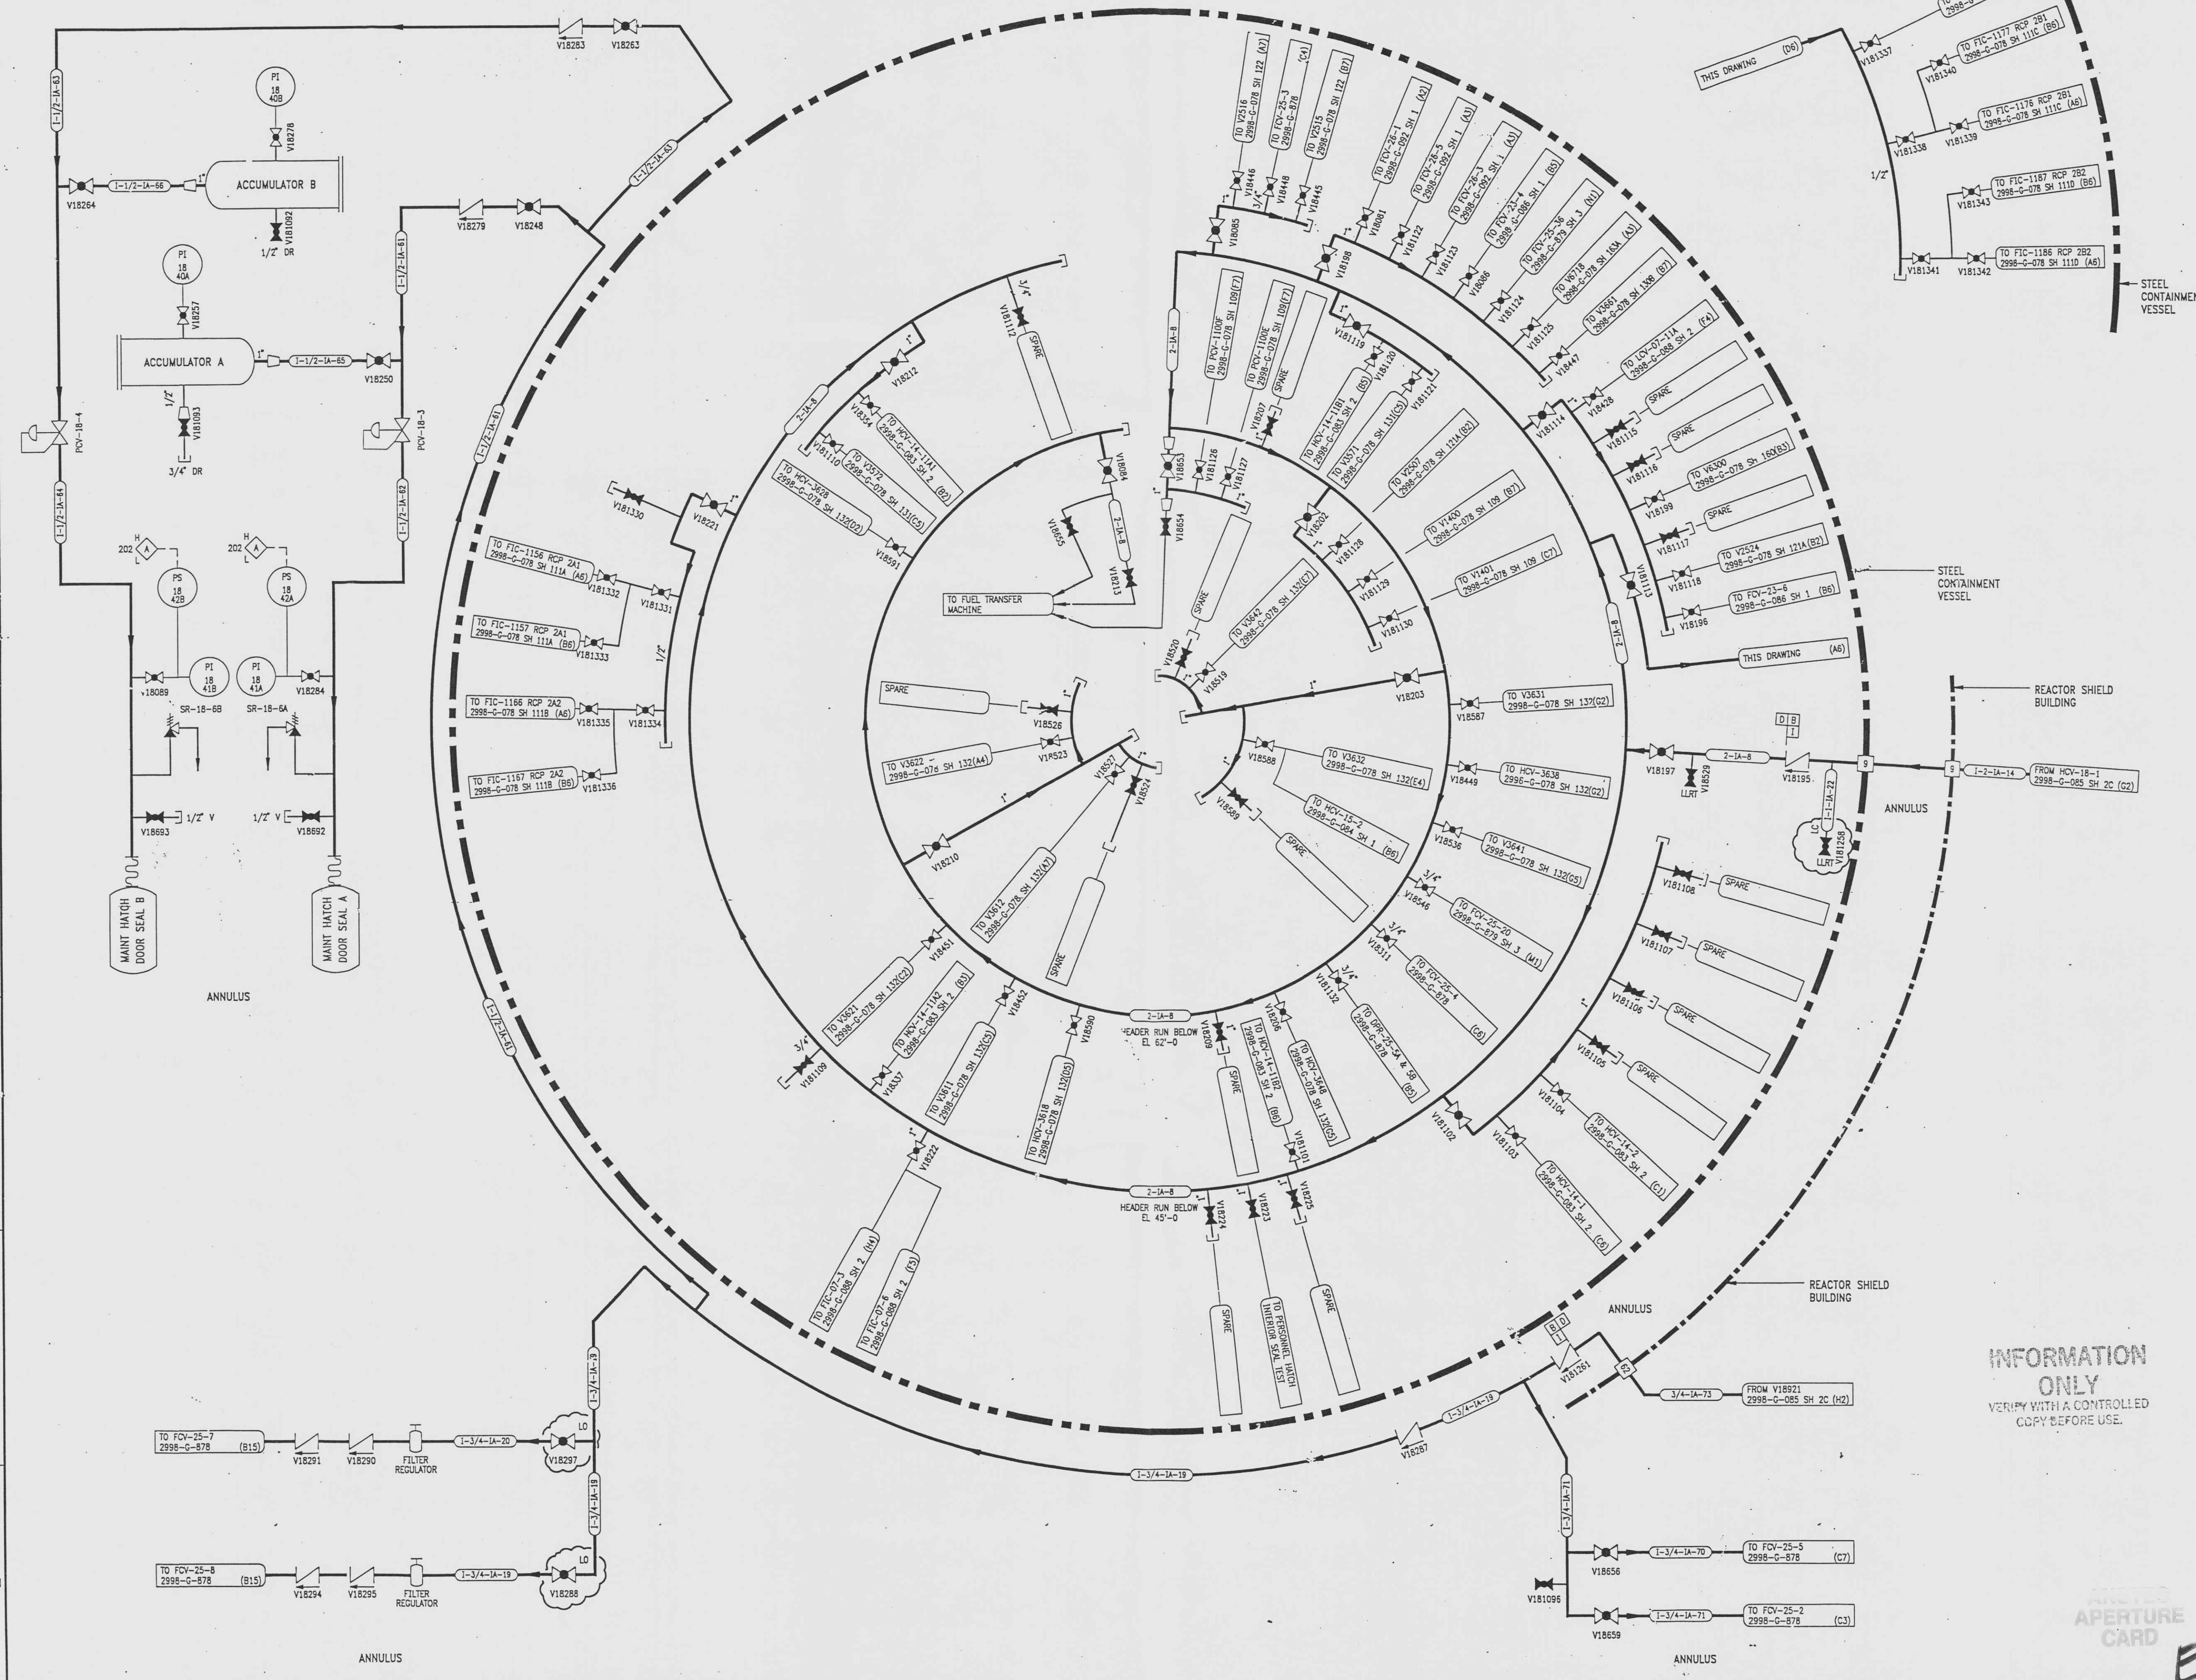

JUN 2 0 1997

- NOTES
- ALL LINES NOT LABELED ARE - 1/2-1A-12
 - ALL LINES LABELED (3/4) ARE - 3/4-1A-11
 - ALL LINES LABELED (1") ARE - 1-1A-10

- REFERENCE DRAWINGS
- PIPE, VALVE & INSTRUMENT SYMBOLS 2998-G-078 SH 100
 - VALVE LIST 2998-A-05
 - LINE LIST 2998-B-052
 - VALVE OPERATIONAL NUMBER INDEX 2998-B-057A
 - INSTRUMENT INSTALLATION DETAILS 2998-B-231
 - INSTRUMENT LIST 2998-B-270C

INFORMATION ONLY
VERIFY WITH A CONTROLLED COPY BEFORE USE.

NOTE:
THIS DRAWING IS MADE FROM REV. 29 OF DRAWING 2998-G-085 SH 2

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 9.3-2

NUCLEAR SAFETY RELATED IN PART ONLY

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983 - 890 MW EXTENSION - UNIT 2
FLOW DIAGRAM
INSTRUMENT AIR SYSTEM

SCALE: NONE		APPROVAL		DATE:	
DR: MECH				2998-G-085	
DR: CLUNTINGHAM				SHEET 2	
CHK: M. PELFREY				32	

