


REVISIONS					
NO	DATE	DESCRIPTION	BY	CH	APPROVED
7	7/24/25				
DCR-SLM-94-052: REDRAWN					
8	4/2/96		JCW	GM	JTZ
DCR-SLM-96-012: REVISE (ES), DELETE "(BOTTOM)"					
9	2/1/97		GM	GM	JTZ
FCM 98132: ADD (BS,CS) VALVES					

DRAWING NUMBER
2998-G-096
541C
PLANTFIELD CORPORATION • IRVINE, CALIFORNIA
NUMBER BY NUMBER/ISSUE

DRAWING NUMBER
2998-G-096
541C
PLANTFIELD CORPORATION • IRVINE, CALIFORNIA
NUMBER BY NUMBER/ISSUE


NUMBER
2998-G-096
541C
PLANTFIELD CORPORATION • IRVINE, CALIFORNIA
NUMBER BY NUMBER/ISSUE

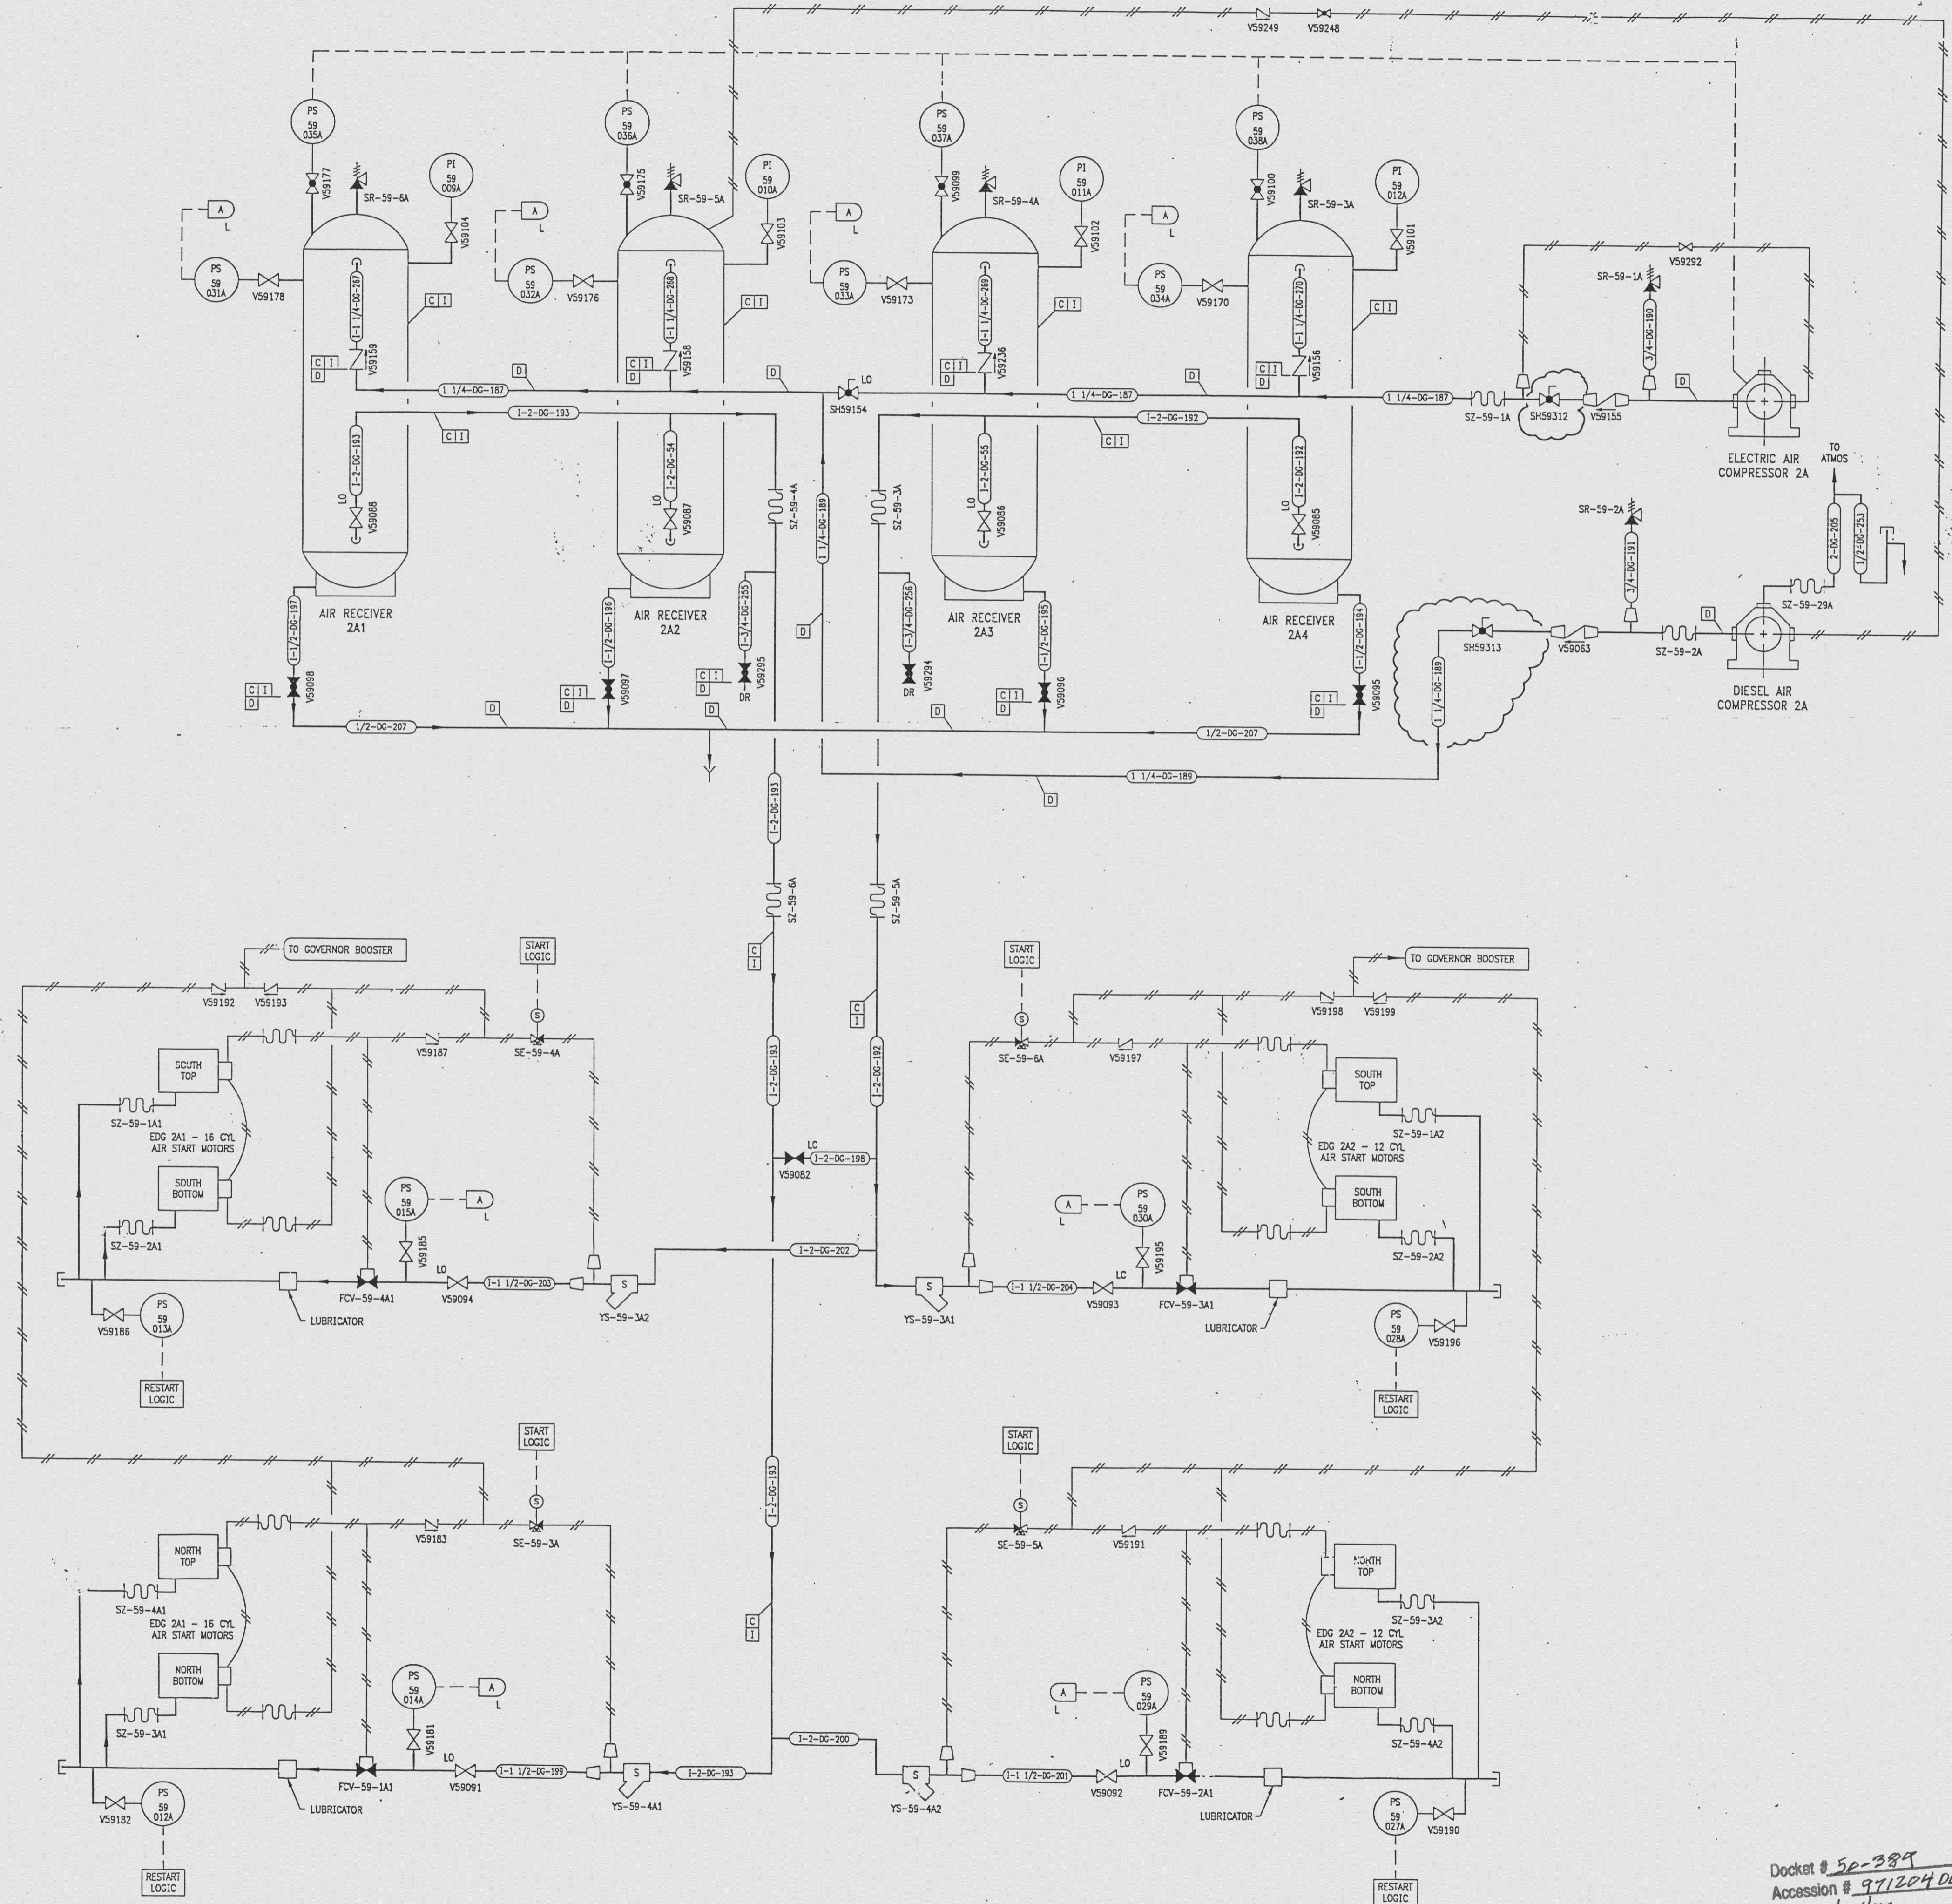

NOTE
LOCAL ALARMS ARE GROUPED ON A LOCAL PANEL. THE LOCAL PANEL HAS AN ANNUNCIATOR IN THE CONTROL ROOM ON RTG8 201.

REFERENCE DRAWINGS

PIPE, VALVE & INSTRUMENT SYMBOLS	2998-G-078 SH 100
VALVE LIST	2998-A-051
LINE LIST	2998-B-052
VALVE OPERATIONAL NUMBER INDEX	2998-B-057A
INSTRUMENT INSTALLATION DETAILS	2998-B-231
INSTRUMENT LIST	2998-B-270C

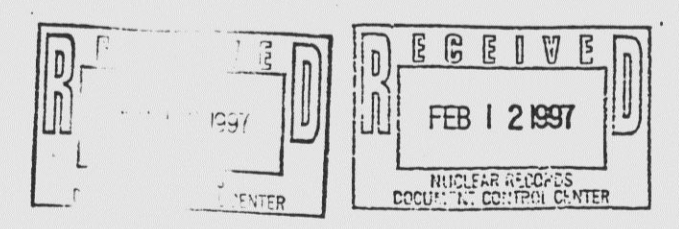

NOTE:
THIS DRAWING IS MADE FROM REV. 6
OF DRAWING 2998-G-096 SH 1

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 9.5-7

NUCLEAR SAFETY RELATED IN PART ONLY

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983 - 890 KW EXTENSION - UNIT 2
FLOW DIAGRAM
EMERGENCY DIESEL GENERATOR SYSTEM
AIR START PACKAGE 2A

RAYTHEON ENGINEERS & CONSTRUCTORS, INC.	
SCALE: NONE	APPROVAL
DATE: 2998-G-096	
DRY: MECH.	SHEET 1C
DR: C. GLATT	
CH: W. FELPHREY	

Docket # 50-389
Accession # 971204 0015-00
Date 11/24/97 of 18
Regulatory Docket File

INFORMATION ONLY
VERIFY WITH A CONTROLLED COPY BEFORE USE.