



NO	DATE	DESCRIPTION	BY	CH	APPROVED
6	7/24/95		GM	RR	JJZ
7	12/8/95	DCR-SLM-94-057: REDRAWN P/M 075-295: REV. Y5-59-1B1 TO SHOW INTERNALS REMOVED (H4)	PAB	HS	TWS
8	8/8/96		HJF	HS	JJZ
9		DCR 96037-6490: DEL: (C4) LO DCR 96037-6490: ADD: (C4) REDUCERS, REV: (B3) DRAIN, (F3) VALVE LOCATION, (E5) LINE BRANCH, (D5) INST. LOCATION, (D4) ORIFICE LOCATION, (E4) BRANCH LINE LOCATION.	GM	ML	JJZ

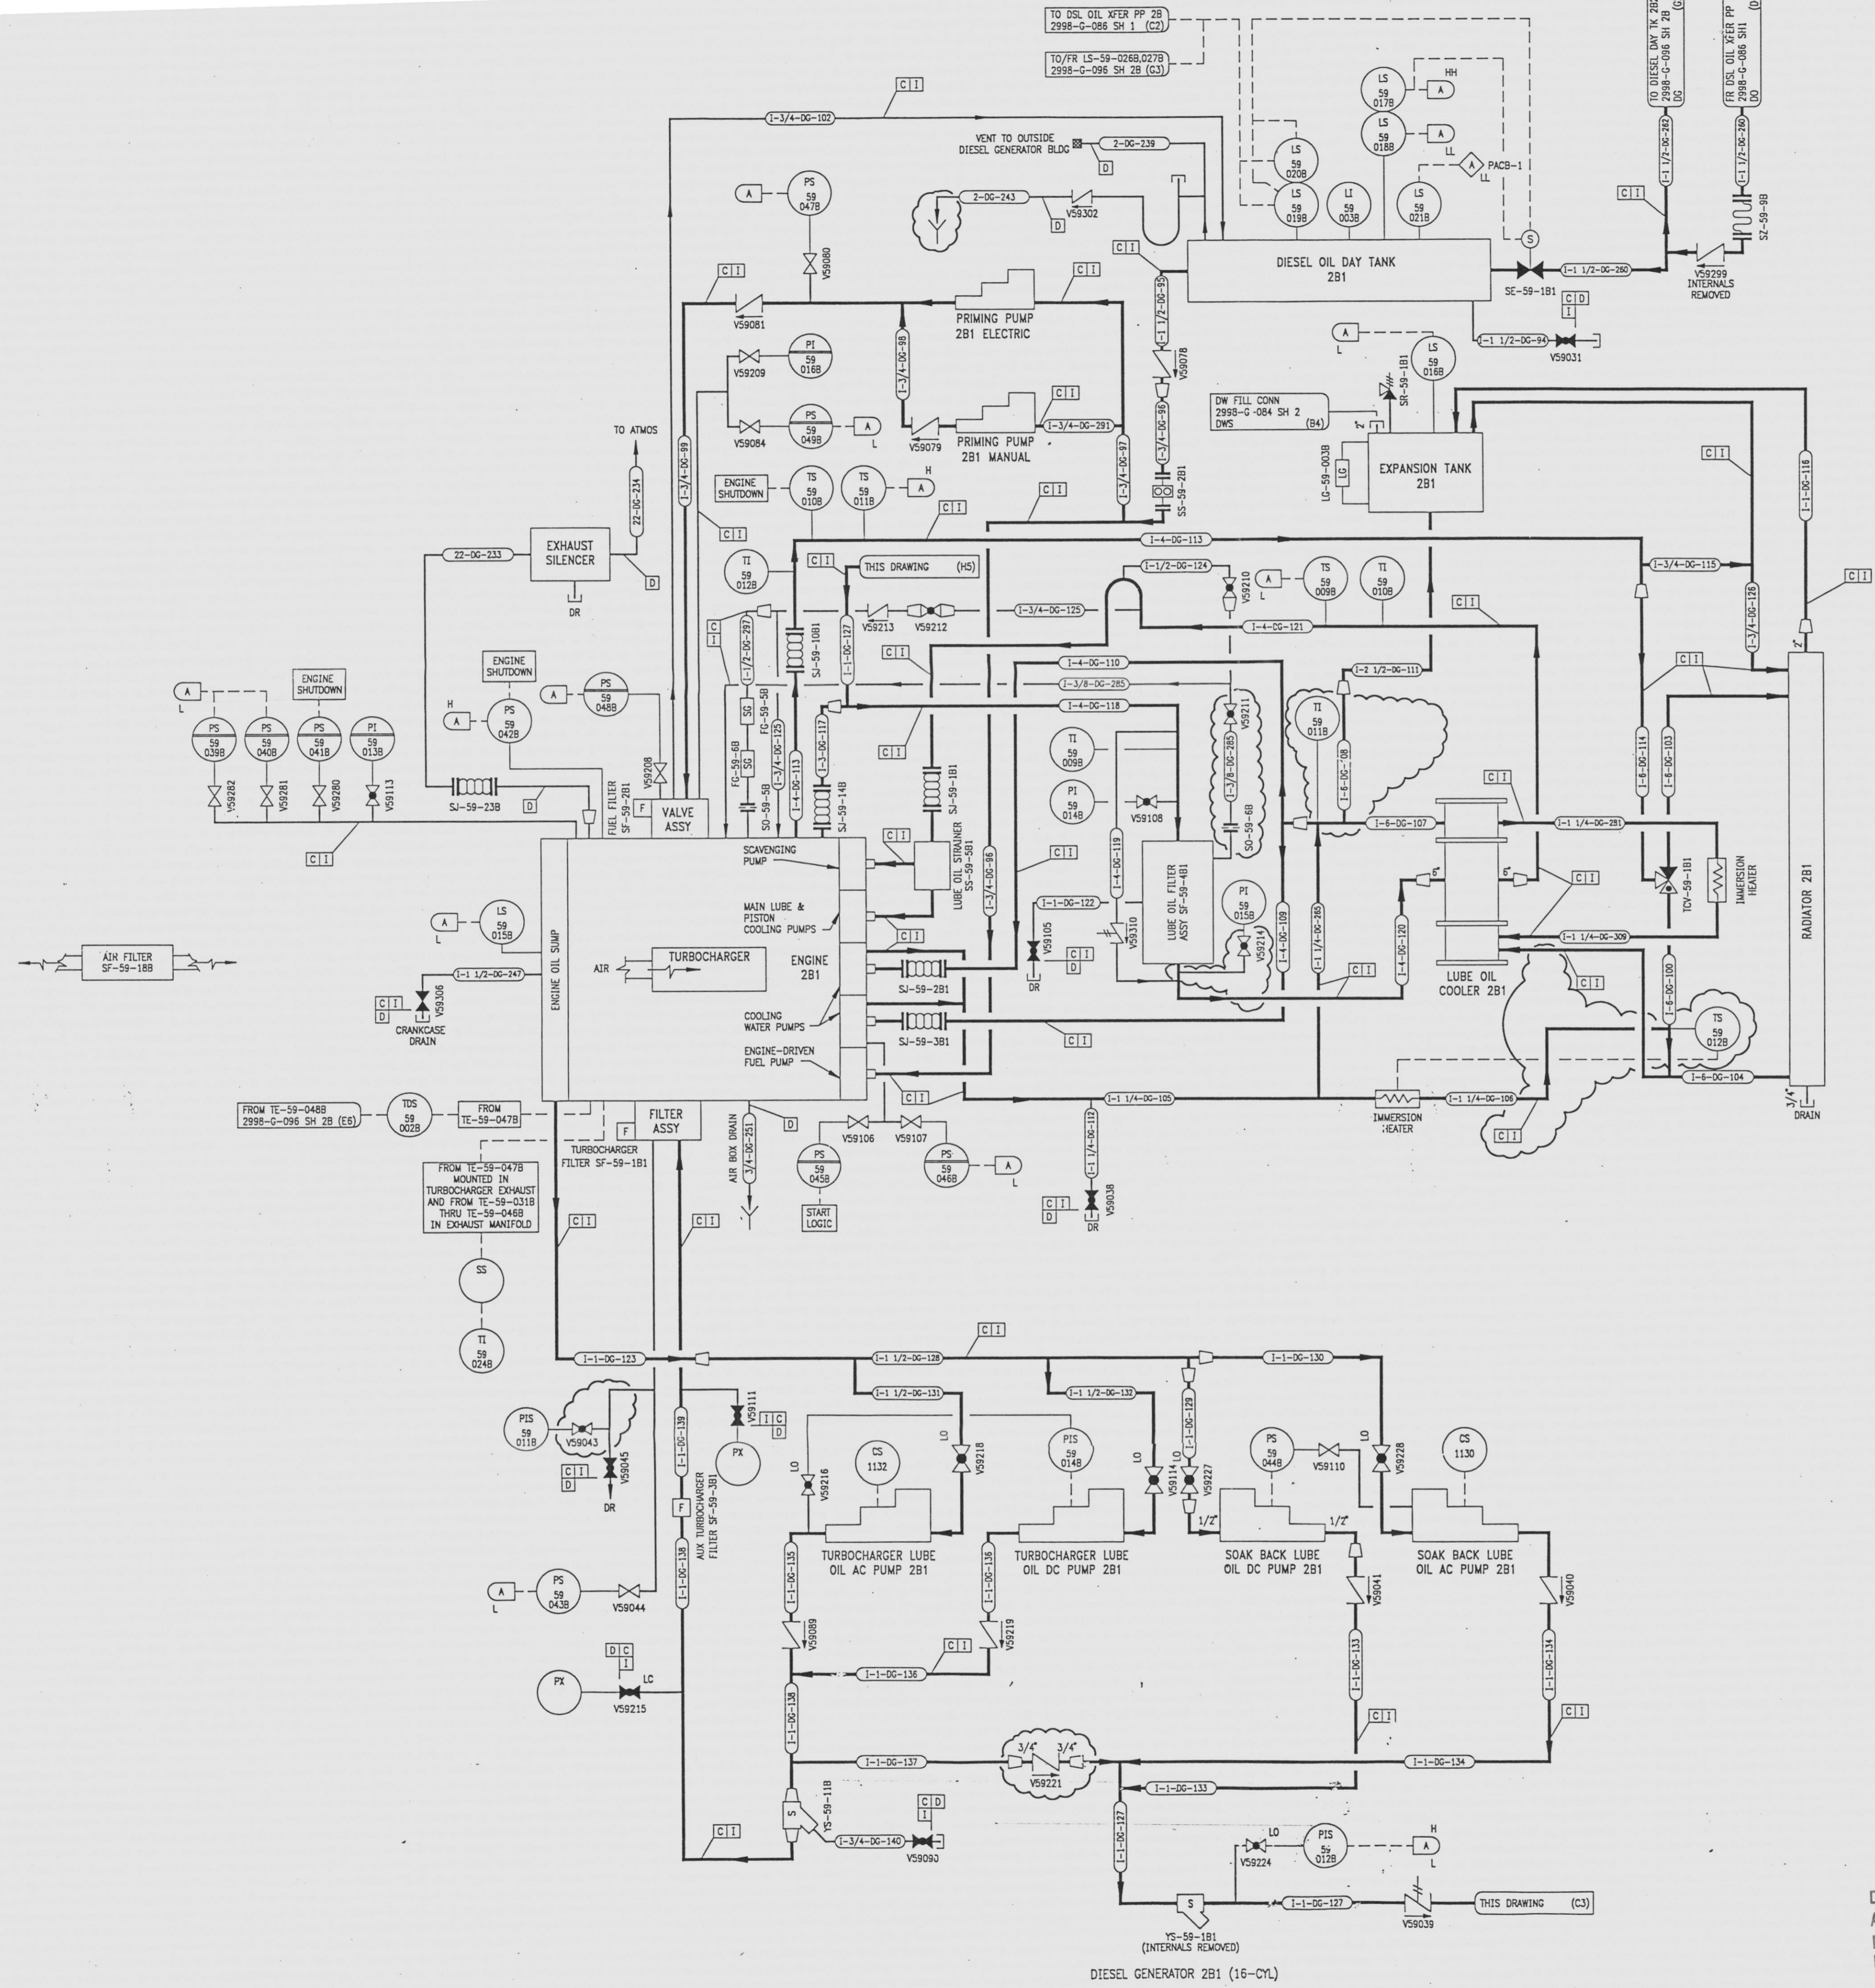

NOTE
LOCAL ALARMS ARE GROUPED ON A LOCAL PANEL.
THE LOCAL PANEL HAS AN ANNUNCIATOR IN THE
CONTROL ROOM ON RTGB 201.

REFERENCE DRAWINGS

PIPE, VALVE & INSTRUMENT SYMBOLS	2998-G-078 SH 100
VALVE LIST	2998-A-051
LINE LIST	2998-B-052
VALVE OPERATIONAL NUMBER INDEX	2998-S-057A
INSTRUMENT INSTALLATION DETAILS	2998-S-211
INSTRUMENT LIST	2998-S-270C

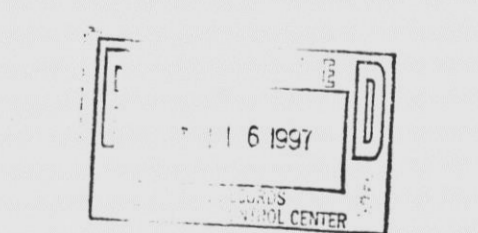

NOTE:
THIS DRAWING IS MADE FROM REV. 5
OF DRAWING 2998-G-096 SH 2

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF
THE FOLLOWING DOCUMENT: FSAR FIGURE 9.5-8

**NUCLEAR SAFETY RELATED
IN PART ONLY**

FLORIDA POWER & LIGHT COMPANY
ST LUCIE PLANT
1983 - 890 MW EXTENSION UNIT 2
FLOW DIAGRAM
EMERGENCY DIESEL GENERATOR SYSTEM
DIESEL ENGINE 2B1

RAYTHEON ENGINEERS & CONSTRUCTORS, INC

SCALE: NONE	APPROVAL	DATE:
DRW: MEDL		2998-G-096
CHK: D. CHEPPE		SHEET
CH: CUNNINGHAM		2A

Docket # 50-389
Accession # 9712040015-03
Date 11/24/97 of 16
Regulatory Docket File

INFORMATION ONLY
VERIFY WITH A CONTROLLED
COPY BEFORE USE.

DRAWING NUMBER
2998-G-096
SH-2A

DRAWING NUMBER
2998-G-096
SH-2A

DRAWING NUMBER
2998-G-096
SH-2A

NUMBER

A
B
C
D
E
F
G
H

1 2 3 4 5 6 7 8

16 1997