


REVISIONS				
NO	DATE	DESCRIPTION	BY	APPROVED
6	7-24-65		CJC	WJP
DCR-SLM-94-052: REDRAWN				
7	5/5/97		CM	GW
PCM 96133: ADD (B5,C5) VALVES				

DRAWING NUMBER
2998-G-096
SH 2C

DRAWING NUMBER
2998-G-096
SH 2C

DRAWING NUMBER
2998-G-096
SH 2C

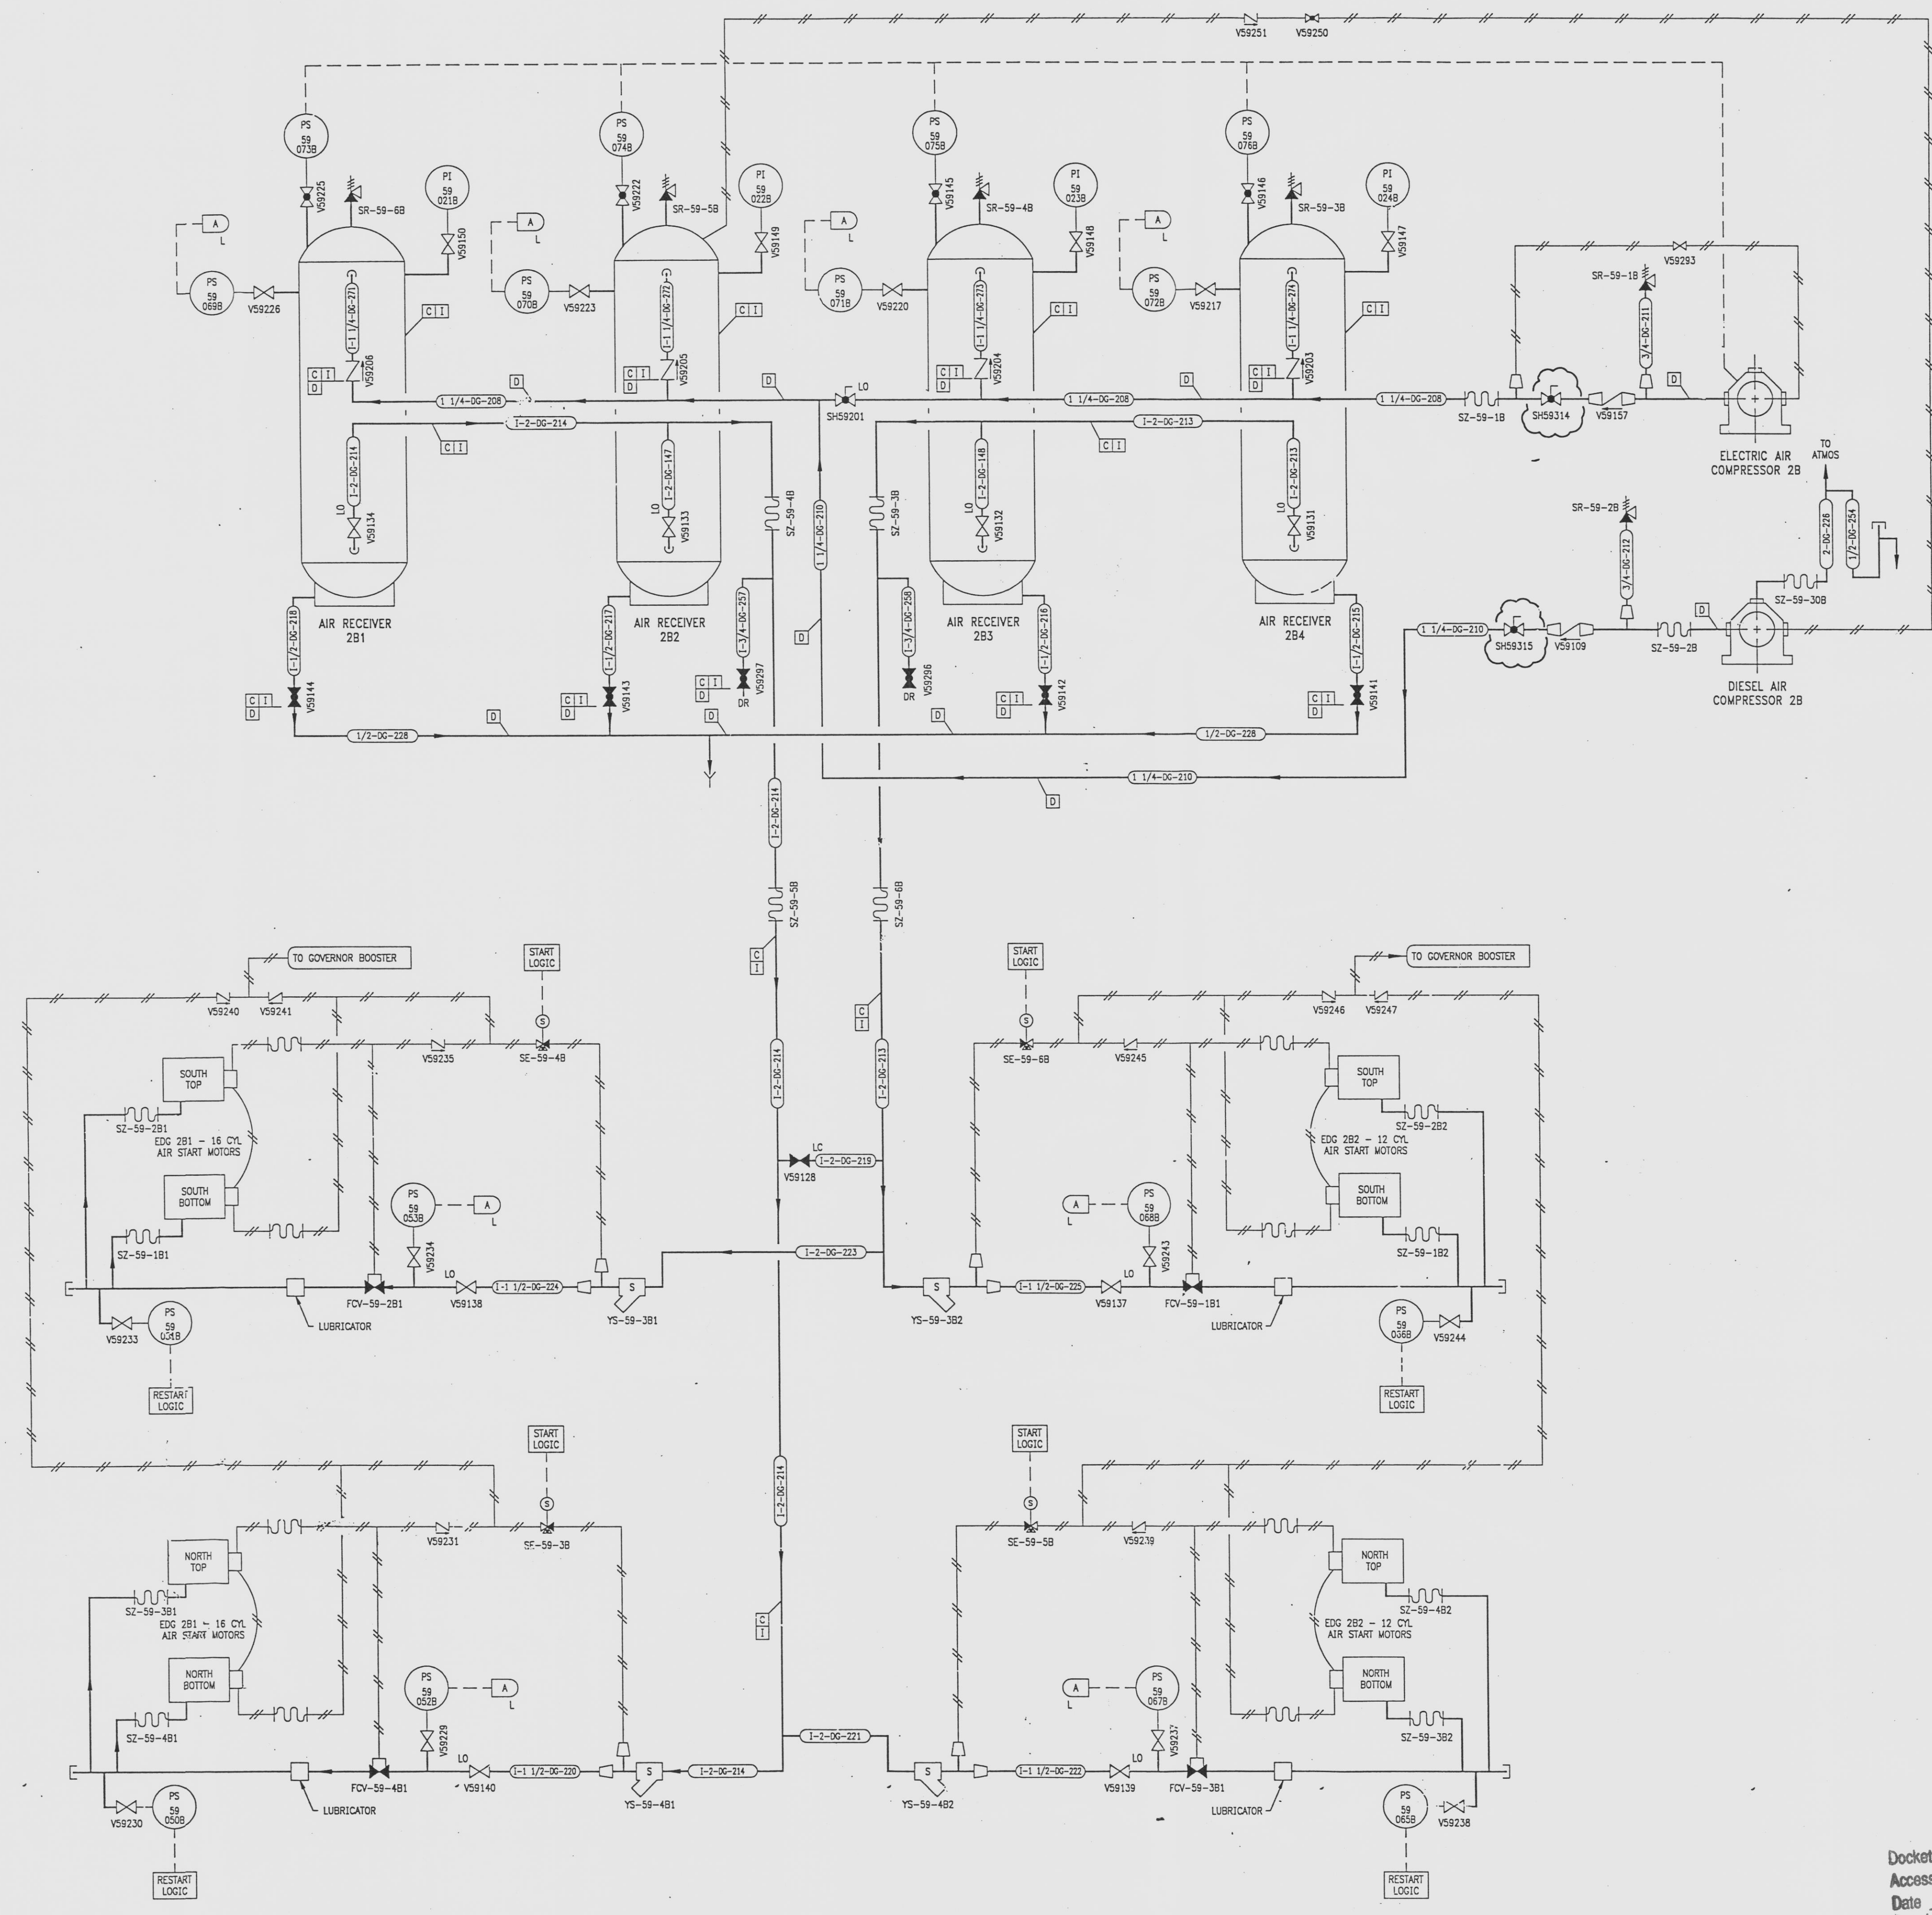


NOTE
LOCAL ALARMS ARE GROUPED ON A LOCAL PANEL THE LOCAL PANEL HAS AN ANNUNCIATOR IN THE CONTROL ROOM ON RTGS 201.

REFERENCE DRAWINGS

PIPE, VALVE & INSTRUMENT SYMBOLS	2998-G-078 SH 100
VALVE LIST	2998-A-051
LINE LIST	2998-B-052
VALVE OPERATIONAL NUMBER INDEX	2998-B-057A
INSTRUMENT INSTALLATION DETAILS	2998-B-231
INSTRUMENT LIST	2998-B-270C

Docket # _____
Accession # _____ of Ltr
Date _____
Regulatory Docket File

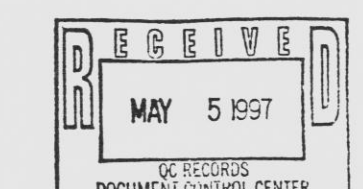

NOTE:
THIS DRAWING IS MADE FROM REV. 5
OF DRAWING 2998-G-096 SH 2

INFORMATION ONLY
VERIFY WITH A CONTROLLED COPY BEFORE USE.

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT: FSAR FIGURE 9.5-8

NUCLEAR SAFETY RELATED IN PART ONLY

FLORIDA POWER & LIGHT COMPANY
ST LUCIE PLANT
1883 - 899 MWe EXTENSION - UNIT 2
FLOW DIAGRAM
EMERGENCY DIESEL GENERATOR SYSTEM
AIR START PACKAGE 2B

RAYTHEON ENGINEERS & CONSTRUCTORS, INC.	
SCALE: NONE	APPROVAL: _____ DATE: _____
DW: MECH	2998-G-096
DR: C. GLATT	SHEET 2C
CH: M. POLYPH...	7

Docket # 50-389
Accession # 97204015-05
Date 11/24/97 of Ltr
Regulatory Docket File

E