

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8206020347 DOC. DATE: 82/05/20 NOTARIZED: NO DOCKET #  
 FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe 05000397  
 AUTH. NAME AUTHOR AFFILIATION  
 BOUCHEY, G.D. Washington Public Power Supply System  
 RECIPIENT NAME RECIPIENT AFFILIATION  
 SCHWENCER, A. Licensing Branch 2


SUBJECT: Confirms 820429 telcon re electrical sys info clarification  
 & forwards proposed change to FSAR Section 8.3.1, 1.3, tests &  
 insps. Proposed change will be issued in forthcoming amend to  
 FSAR, Proposed Figure 8.3-16c encl.

DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 60 SIZE: 3  
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES:

	RECIPIENT ID CODE/NAME	COPIES		RECIPIENT ID CODE/NAME	COPIES	
		LTTR	ENCL		LTTR	ENCL
	A/D LICENSNG	1	0	LIC BR #2 BC	1	0
	LIC BR #2 LA	1	0	AULUCK, R. 01	1	1
INTERNAL:	ELD/HDS2	1	0	IE FILE	1	1
	IE/DEP EPDS 35	1	1	IE/DEP/EPLB 36	3	3
	MPA	1	0	NRR/DE/CEB 11	1	1
	NRR/DE/EQB 13	3	3	NRR/DE/GB 28	2	2
	NRR/DE/HGEB 30	2	2	NRR/DE/MEB 18	1	1
	NRR/DE/MTEB 17	1	1	NRR/DE/QAB 21	1	1
	NRR/DE/SAB 24	1	1	NRR/DE/SEB 25	1	1
	NRR/DHFS/HFEB40	1	1	NRR/DHFS/LGB 32	1	1
	NRR/DHFS/OLB 34	1	1	NRR/DHFS/PTRB20	1	1
	NRR/DSI/AEB 26	1	1	NRR/DSI/ASB 27	1	1
	NRR/DSI/CPB 10	1	1	NRR/DSI/CSB 09	1	1
	NRR/DSI/ETSB 12	1	1	NRR/DSI/ICSB 16	1	1
	NRR/DSI/PSB 19	1	1	NRR/DSI/RAB 22	1	1
	NRR/DSI/RSB 23	1	1	NRR/DST/LGB 33	1	1
	REG FILE 04	1	1	RGNS	2	2
EXTERNAL:	ACRS 41	16	16	BNL (AMDTS ONLY)	1	1
	FEMA-REP DIV 39	1	1	LPDR 03	1	1
	NRC PDR 02	1	1	NSIC 05	1	1
	NTIS	1	1			

TOTAL NUMBER OF COPIES REQUIRED: LTR 63 ENCL 58

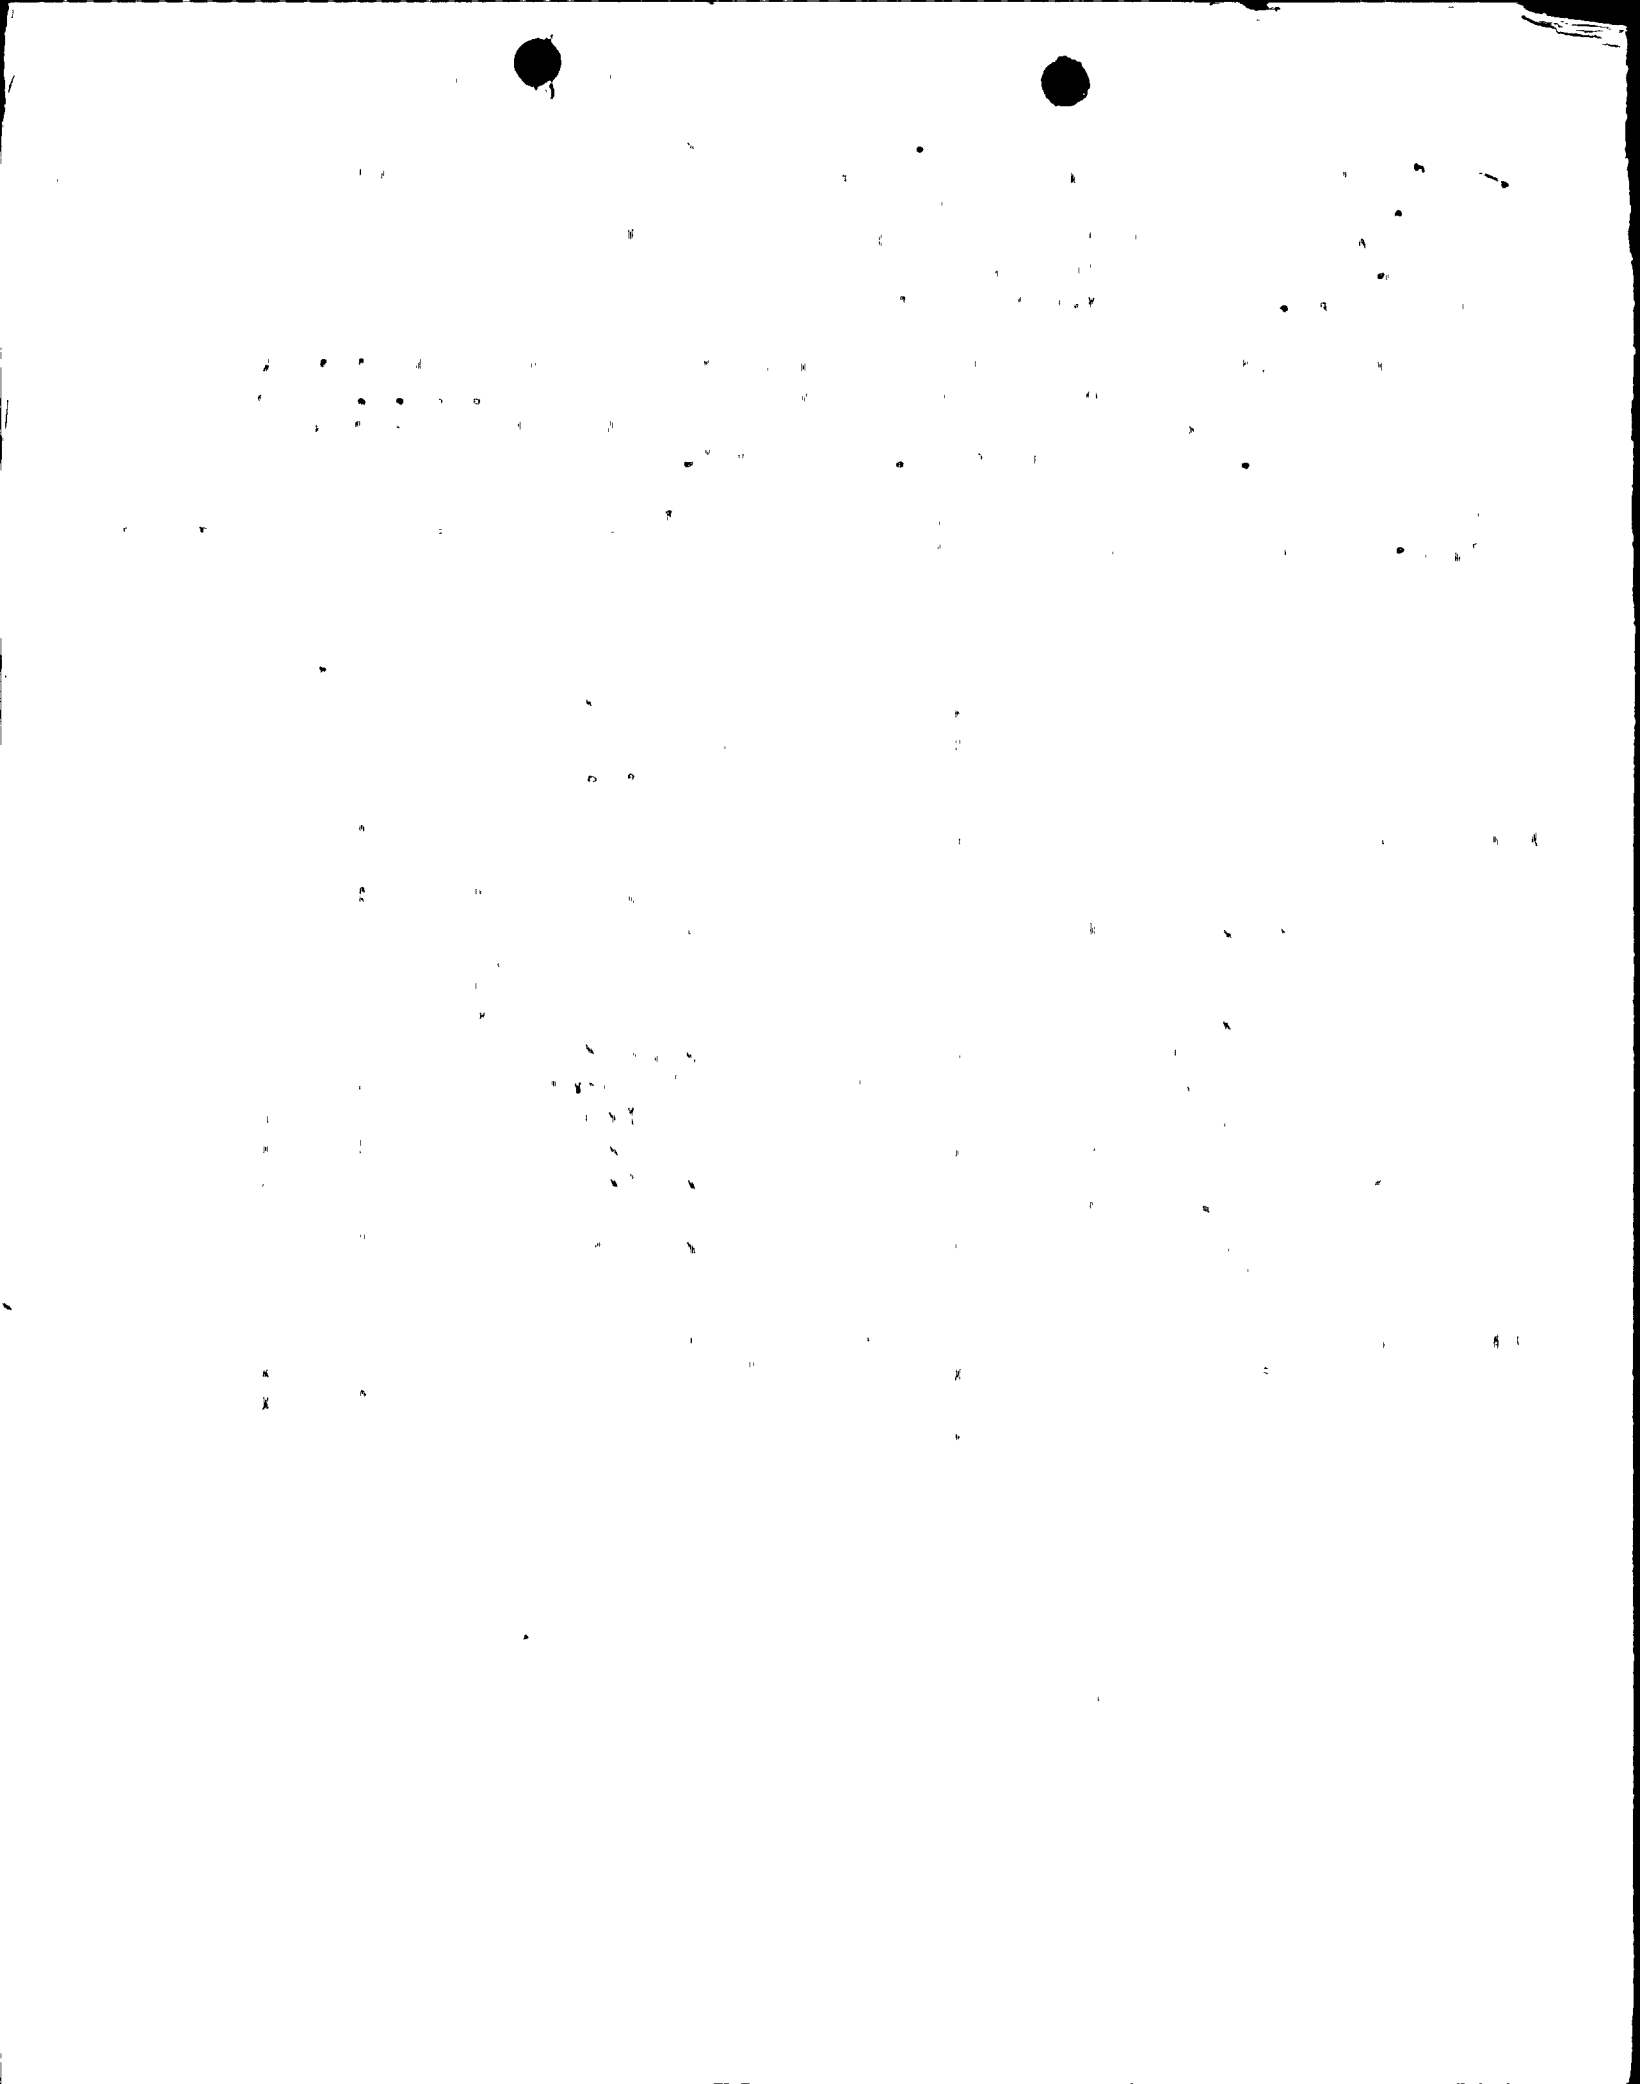

## Washington Public Power Supply System

P.O. Box 968 3000 George Washington Way Richland, Washington 99352 (509)372-5000

May 20, 1982  
G02-82-456  
SS-L-02-PLP-82-034

Docket No. 50-397

Mr. A. Schwencer, Chief  
Licensing Branch No. 2  
Division of Licensing  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555

Dear Mr. Schwencer:

Subject: NUCLEAR PROJECT NO. 2  
ELECTRICAL SYSTEM INFORMATION CLARIFICATION

The attached Final Safety Analysis Report (FSAR) drawing change and the following FSAR amendment change are provided in confirmation of a phone conversation between Mr. S. Rhow of your staff and Messrs. P.L. Powell and T.L. Meade of the Supply System, on April 29, 1982. As agreed, a forthcoming amendment to the FSAR will incorporate the following change immediately after Page 8.3-48, Section 8.3.1.1.3, Tests and Inspections:

- "Voltage values at the Class IE high and low voltage buses will be measured and compared to the design values, to demonstrate correct transformer tap settings, during the preoperational testing phase of the plant."

Additionally, an amendment will be made to change FSAR drawing 8.3-16c to reflect the change indicated in Attachment 1. This is not a design change, only correction of a drawing to conform to a previously reviewed design.

Should you have any further questions, please contact Mr. R.M. Nelson, Project Licensing Manager, WNP-2.

Very truly yours,



G. D. Bouchey  
Deputy Director, Safety and Security

PLP/jca  
Attachment

cc: R Auluck - NRC  
WS Chin - BPA  
R Feil - NRC  
S Rhow - NRC

B001  
S  
1/60

20