



ENLARGED PLAN OF REACTOR BUILDING SHOWING LOCATION OF SAMPLE RACK SR-6 AND FUME HOOD SR-7.

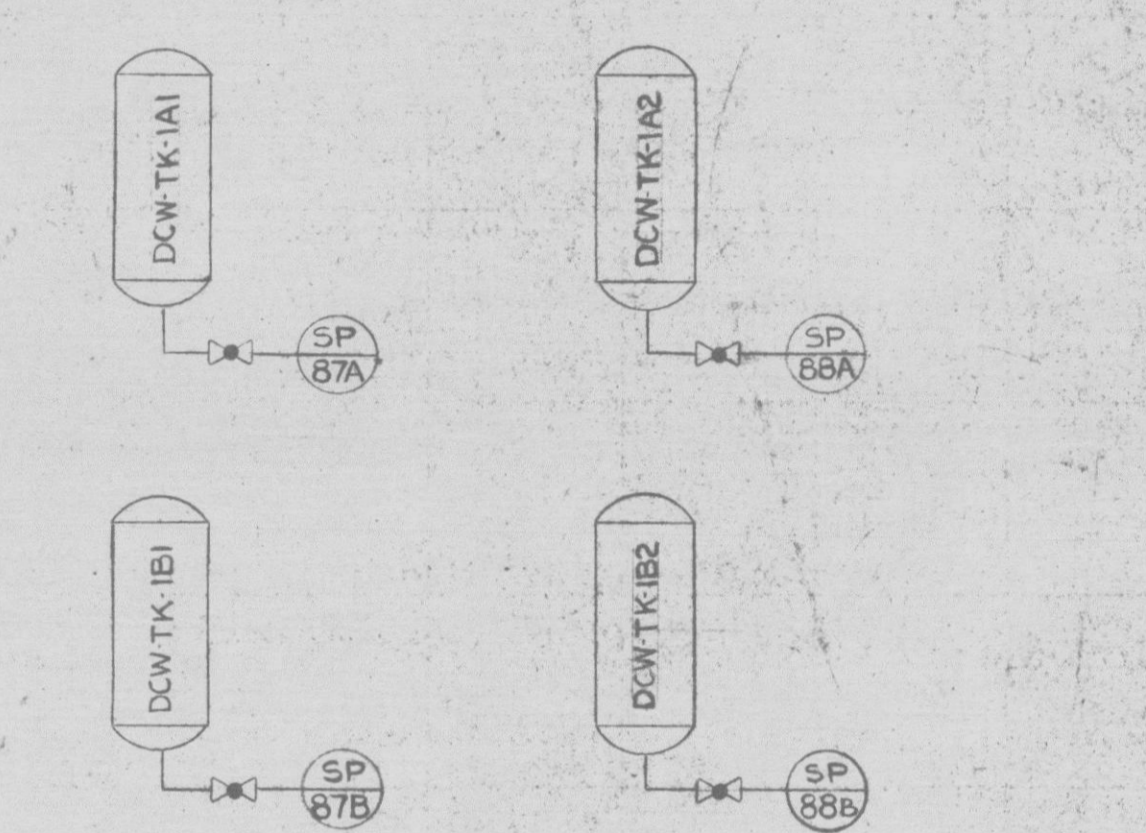

EXPANSION TANKS AT DIESEL ENGINES

**NOTES:**  
 1. FOR GENERAL NOTES & REFERENCE DRAWINGS SEE M-GOT SHEET 1 OF 3.  
 2. PIPING & TUBING WITHIN THE REACTOR BLDG SAMPLE ROOM TO BE QUALITY CLASS II, SEISMIC CATEGORY I FOR SAMPLE RACK SR-6; FUME HOOD WATER (SW) LINES TO BE QUALITY CLASS I, SEISMIC CATEGORY I EXCEPT AS NOTED ON M-619, INSTRUMENT CONNECTION DIAGRAMS.

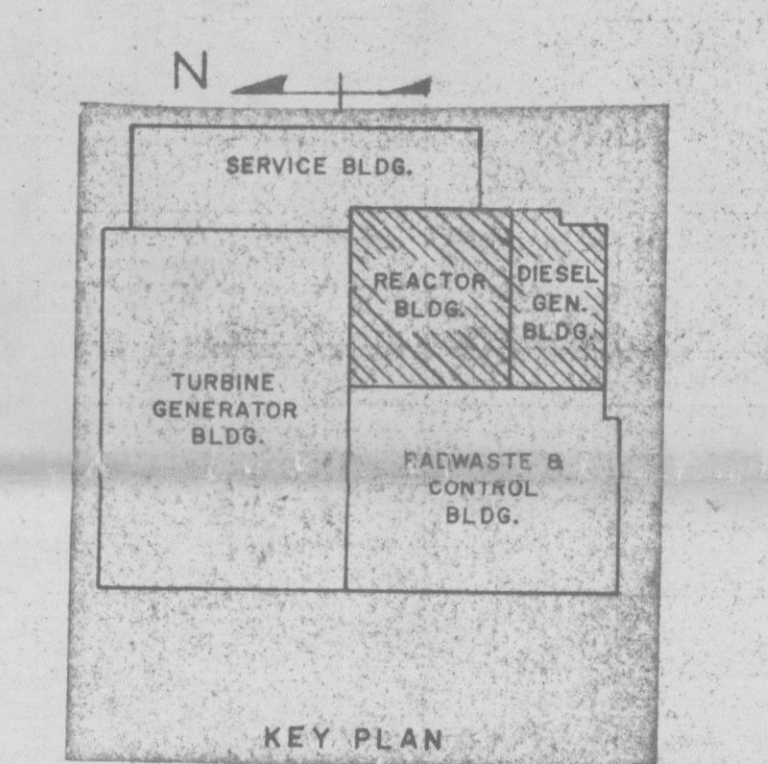

KEY PLAN

**INFORMATION ONLY** **VOID**

PRO APERTURE CARD

BURNS AND ROE, INC.  
 ENGINEERS AND CONSTRUCTORS  
 GRADELL, N.J. HEMPSTEAD, N.Y. LOS ANGELES, CALIF.

FLOW DIAGRAM  
 STEAM AND LIQUID SAMPLING  
 REACTOR BUILDING

WASHINGTON PUBLIC POWER SUPPLY SYSTEM  
 HANFORD No. 2

REV	REVISION	DATE	BY	CHKD	APPROVED	REV NO	REVISION	DATE	BY	CHKD	APPROVED	REV NO	REVISION	DATE	BY	CHKD	APPROVED
5	PER TASK 8300: ADDED PED-220-I-0007	8/1/79	WJW	WJW	[Signature]	1	DRAWING APPROVED FOR CONSTRUCTION	7/30/79	REC	PWL	[Signature]	1	CONTRACT 220: ADDED EXPANSION TANKS (ZONE G-2). REVISED VALVES & ADDED VALVE NOS. PSR-V-19A, 19B & 20 (ZONES E-14, J-10 & D-4) PER FCN 3559	7/30/79	N.D.	JRL	[Signature]
6	PER TASK 8300: ADDED PED-220-I-0390 (J-10)	1/16/80	KAD	[Signature]	[Signature]	2	CONTRACT 220: DELETED COOLING WATER SUPPLY & RETURN FROM RAD MONITOR SR-20 E-21 (G-1, B-10) PER FCN 4410	1/16/80				2	CONTRACT 220: ADDED SPEC BREAKS AND DWG CONTINUATION NOTIFICATION ZONES A & A-9 PER FCN 4278	1/16/80			
7	PER TASK 3040: PED-220-I-084 (H-1-2) 215-M-A36+(F-14-15; H-10)	11-4-80	B.E.	[Signature]	[Signature]	3	CONTRACT 220: ADDED COOLING WATER FOR ANALYSES & MONITORS (ZONES B-C) (TURB) ADDITION TO WATER 2 PER FCN 3426	11-4-80				3	CONTRACT 220: ADDED COOLING WATER FOR ANALYSES & MONITORS (ZONES B-C) (TURB) ADDITION TO WATER 2 PER FCN 3426	11-4-80			
8	PCN 6006 PED-220-I-9007 (B-10) (G-1) (J-10) (H-1)	11-4-80	WJW	[Signature]	[Signature]	4	CONTRACT 220: ADDED COOLING WATER FOR ANALYSES & MONITORS (ZONES B-C) (TURB) ADDITION TO WATER 2 PER FCN 3426	11-4-80				4	CONTRACT 220: ADDED COOLING WATER FOR ANALYSES & MONITORS (ZONES B-C) (TURB) ADDITION TO WATER 2 PER FCN 3426	11-4-80			
9	PCN 6006 PED-220-I-9007 (B-10) (G-1) (J-10) (H-1)	11-4-80	WJW	[Signature]	[Signature]	5	CONTRACT 220: ADDED COOLING WATER FOR ANALYSES & MONITORS (ZONES B-C) (TURB) ADDITION TO WATER 2 PER FCN 3426	11-4-80				5	CONTRACT 220: ADDED COOLING WATER FOR ANALYSES & MONITORS (ZONES B-C) (TURB) ADDITION TO WATER 2 PER FCN 3426	11-4-80			

ENGINEERING REVIEW: NONE  
 SCALE: NONE  
 DATE: 7/30/79  
 W. O. 2808  
 DWG. M607 SH.2 F