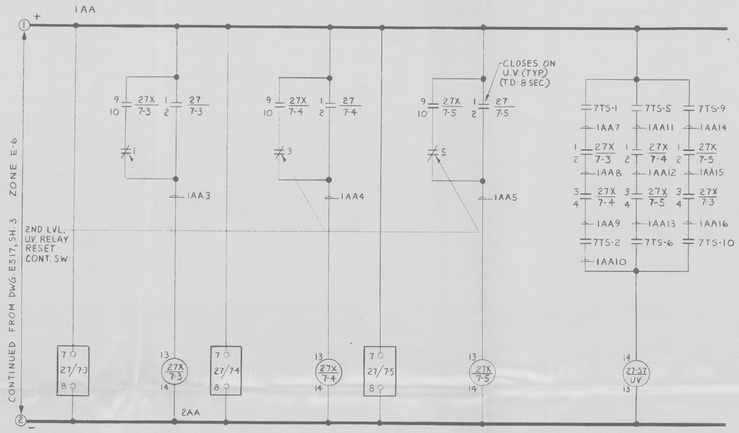

ALL EQUIPMENT IS LOCATED AT SM-7 EXCEPT AS NOTED

7TS13
2UV7T-1
2UV7T-2
2ND LVL UV TEST ON

HOLD E-101

27-57/UV
1AA2 (11)
1AA1 (12)
SM-7 BUS UV CONTROL E517, SH. 3
7-1T8 (1)
7-1T2 (2)
52/7-1 TRIP CKT. E517, SH. 9
87-24 (3)
87-25 (4)
BKR. B-7 CONTROL E517, SH. 10
2UV7A-1 (9)
2UV7A-2 (10)
2ND LVL UV ALERT

HOLD E-101

4160V. SWGR SM-7 CRITICAL BUS 7 UNDERVOLTAGE

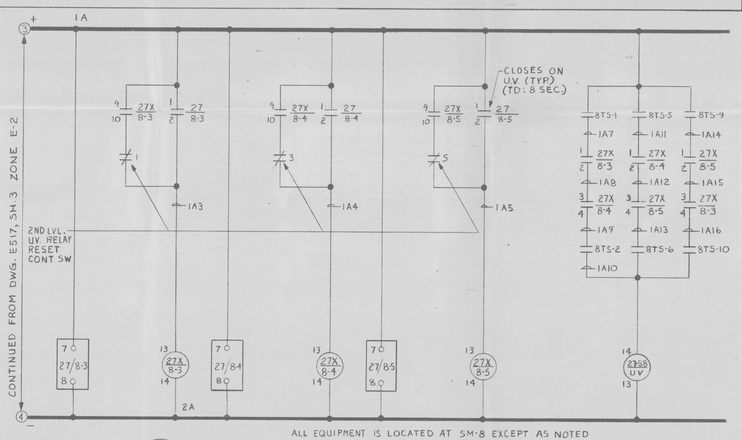

ALL EQUIPMENT IS LOCATED AT SM-8 EXCEPT AS NOTED

8TS13
2UV8T-1
2UV8T-2
2ND LVL UV TEST ON

HOLD E-101

27-58/UV
1A2 (11)
1A (12)
SM-7 BUS UV CONTROL E517, SH. 3
8-3T8 (1)
8-3T2 (2)
52/8-3 TRIP CKT. E517, SH. 9
88-24 (3)
88-25 (4)
BKR. B-8 CONTROL E517, SH. 10
2UV8A-1 (9)
2UV8A-2 (10)
2ND LVL UV ALERT

HOLD E-101

4160V. SWGR SM-8 CRITICAL BUS 8 UNDERVOLTAGE

INFORMATION ONLY

REGULATORY DOCKET FILE COPY

PRC APERTURE CARD

REV. NO.	REVISION	DATE	DRWN.	CHKD.	APPROVED ENG'R	APPROVED PROJ'T
0	APPROVED FOR CONSTRUCTION, PER TASK 3040: PED W218-E-5180. (ADDED HOLD E-101).	12-4-81	MS	CDW		
1	PER TASK 3040: PED-W218-E-4477 (G-14, G-11)	4-8-82	B.E	CDW		

RELEASED FOR	BY	DATE
STATUS		
PRELIMINARY INFO.		
BIDDING ONLY		
ADDENDUM NO.		
AMENDMENT NO.		
CONSTRUCTION		
APPLY TO SPEC. NO.		

BURNS AND ROE, INC.
ENGINEERS AND CONSTRUCTORS
ORADELL, N. J. HEMPSTEAD, N. Y. LOS ANGELES, CALIF.

4160 V SWITCHGEAR
ELEMENTARY DIAGRAMS
SH. 18

WASHINGTON PUBLIC POWER SUPPLY SYSTEM
HANFORD No. 2

ENGINEERING REVIEW				
DIVISION	MECH	ELECT	STRUCT	—
ENG'R	—	—	—	—
DATE	—	—	—	—

APPROVED FOR CONSTRUCTION
FOR CHIEF ELECT. ENGINEER

CLIENT APPROVAL

SCALE: ~

DRWN. MS	CHKD. CDW
DES'D GMM	DATE 12-4-81

ART League CAB 1/6/82
REVIEWED BY DRAFTSMAN

W. O. 2808

DWG. E517 REV. 1

8202.0055 E