



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

DOCKET NO. 50-397

WPPSS NUCLEAR PROJECT NO.2

AMENDMENT TO FACILITY OPERATING LICENSE


License No. NPF-21  
Amendment No. 2

1. The Nuclear Regulatory Commission (the Commission or the NRC) has found that:
  - A. The application for amendment filed by the Washington Public Power Supply System (WPPSS, also the licensee), dated January 20, February 8, and April 10, 1984, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application as amended, the provisions of the Act, and the regulations of the Commission;
  - C. There is reasonable assurance: (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulation set forth in 10 CFR Chapter I;
  - D. The issuance of this amendment will not be inimical to the common defense and security or the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. The license is amended by changes to the Technical Specifications as indicated in the attachment to this amendment and paragraph 2.C.(2) of Facility Operating License No. NPF-21 is hereby amended to read as follows:

(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 2, and the Environmental Protection Plan contained in Appendix B, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

8407230292 840713  
PDR ADDCK 05000397  
P PDR

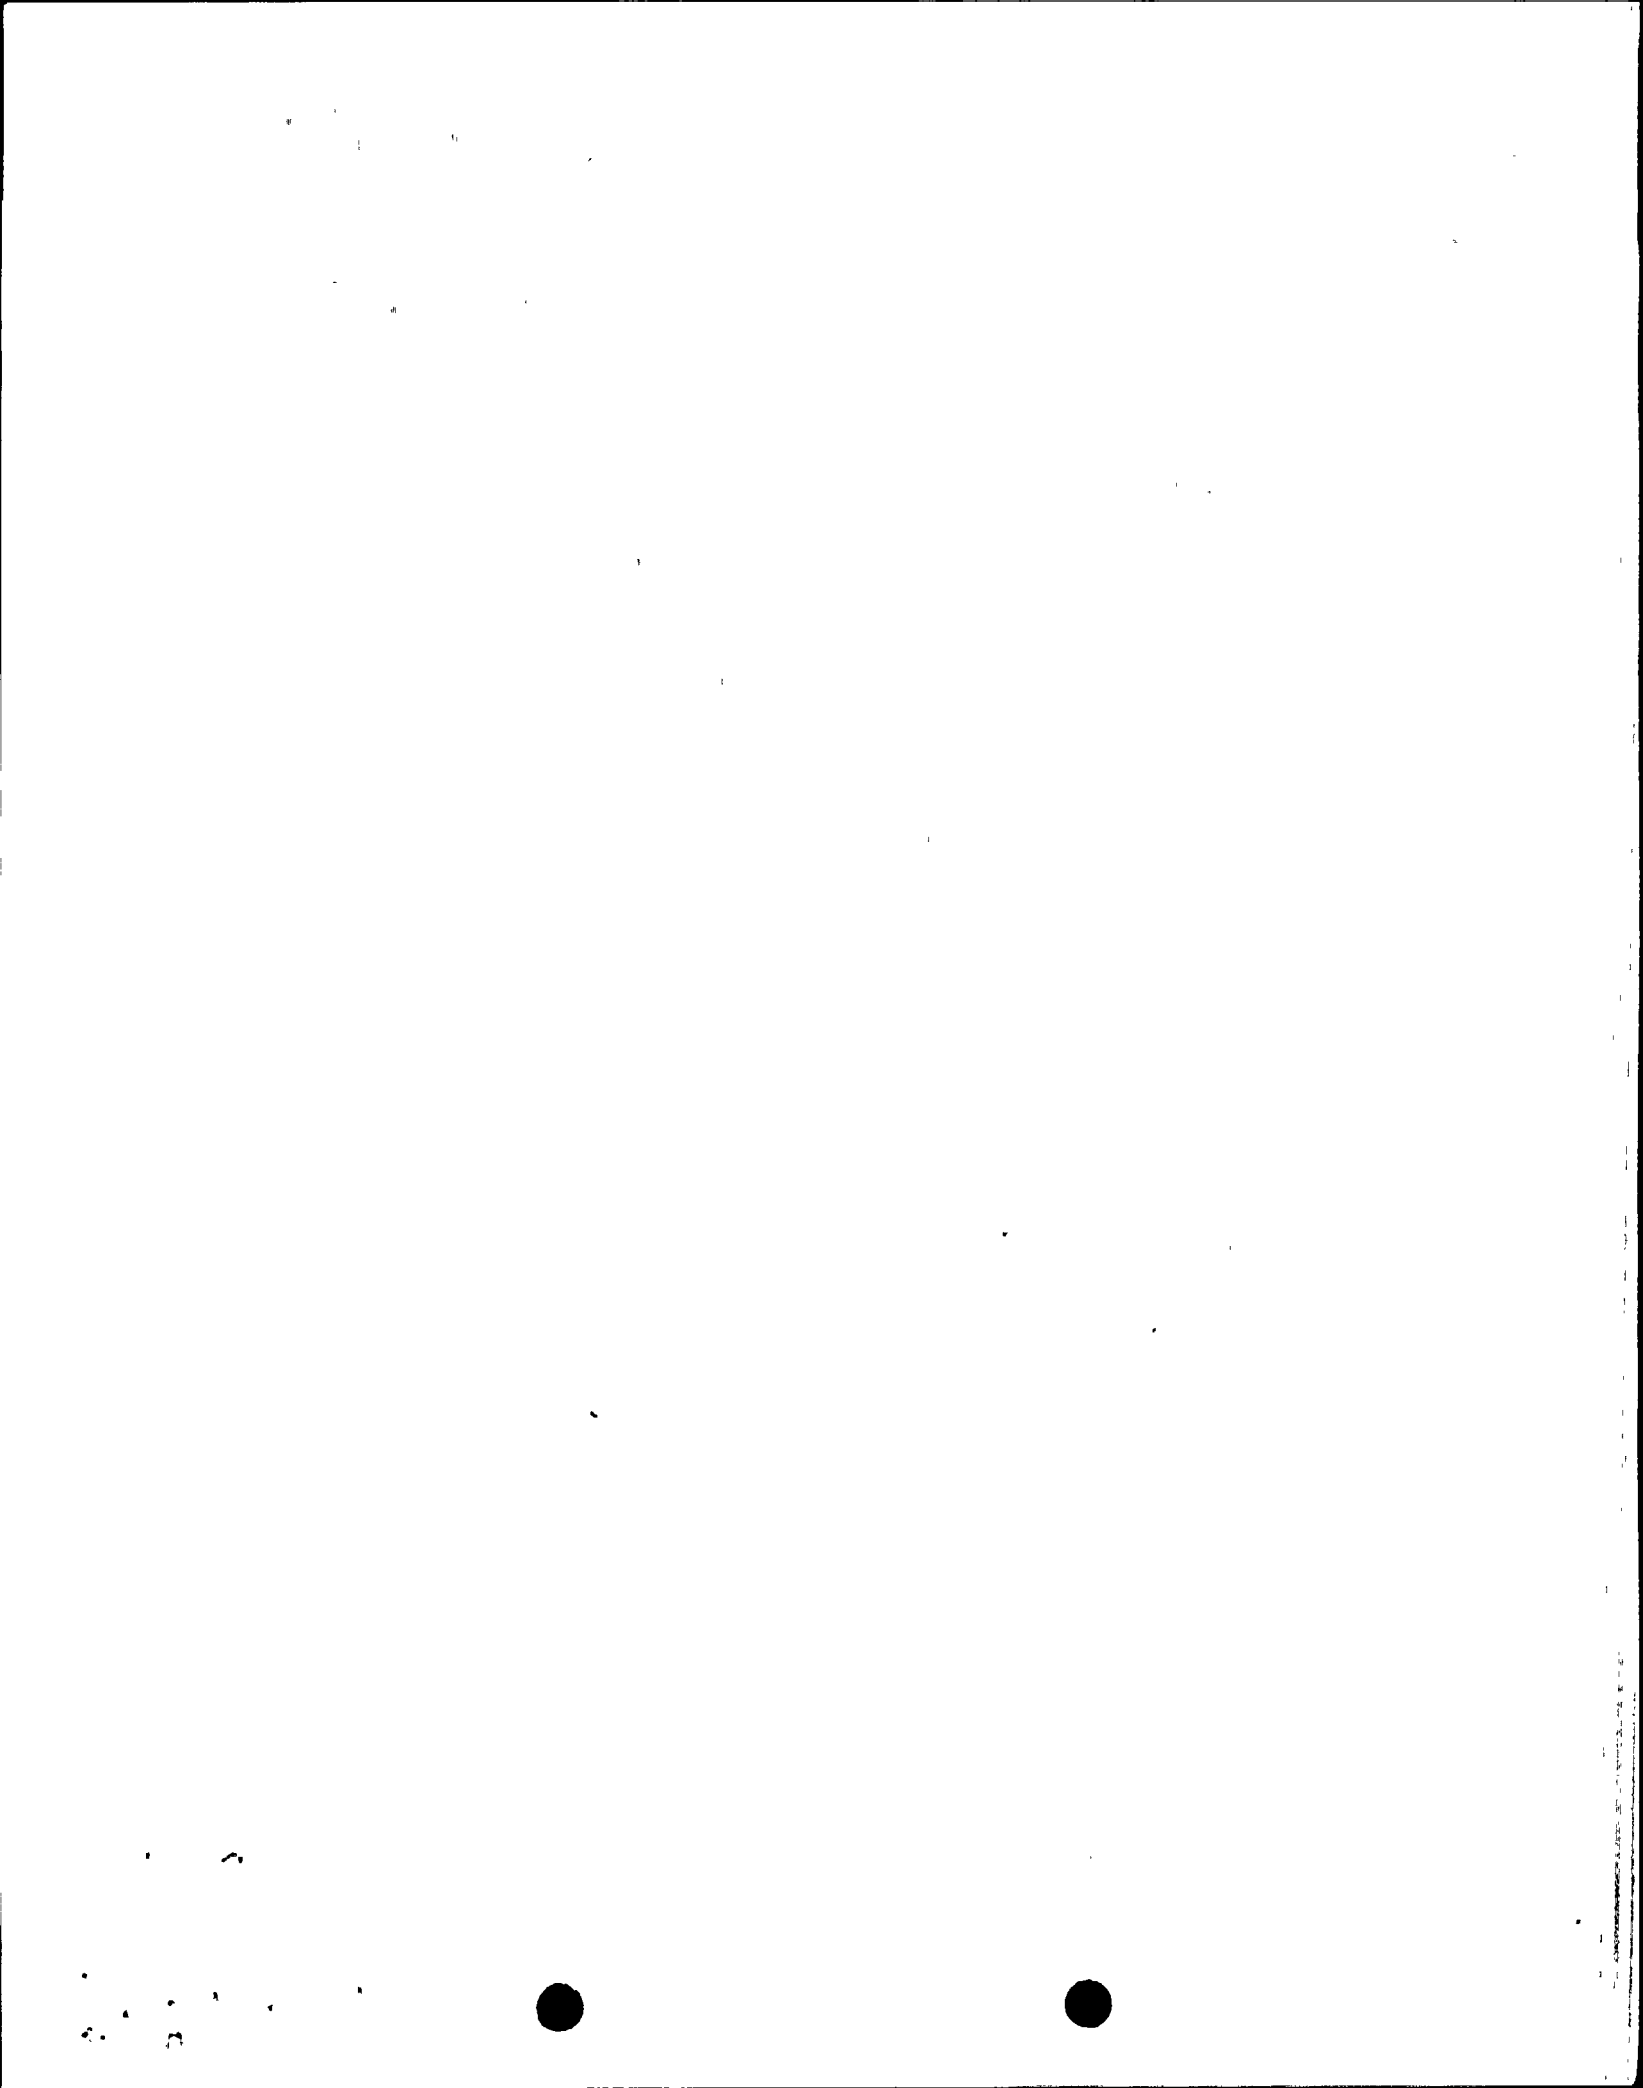

3. This amendment was effective as of April 10, 1984.

FOR THE NUCLEAR REGULATORY COMMISSION

Original signed by

A. Schwencer, Chief  
Licensing Branch No. 2  
Division of Licensing

Attachment:  
Changes to the Technical Specifications

Date of Issuance: JUL 13 1984

DL:LB#2/PM  
Wick:bdm  
5/2/84

DL:LB#2/LA  
EH:son  
5/2/84

~~DL:LB#2/BC~~  
OELD:ATTY  
WPaton  
5/2/84

AS  
DL:LB#2/BC  
ASchwencer  
~~5/2/84~~

7/13/84



1911

1912

ATTACHMENT TO LICENSE AMENDMENT NO. 2  
FACILITY OPERATING LICENSE NO. NPF-21  
DOCKET NO. 50-397


Replace the following page of the Appendix "A" Technical Specifications with enclosed page. The revised pages are identified by Amendment number and contain vertical lines indicating the area of change.

REMOVE

3/4.4-10

INSERT

3/4.4-10

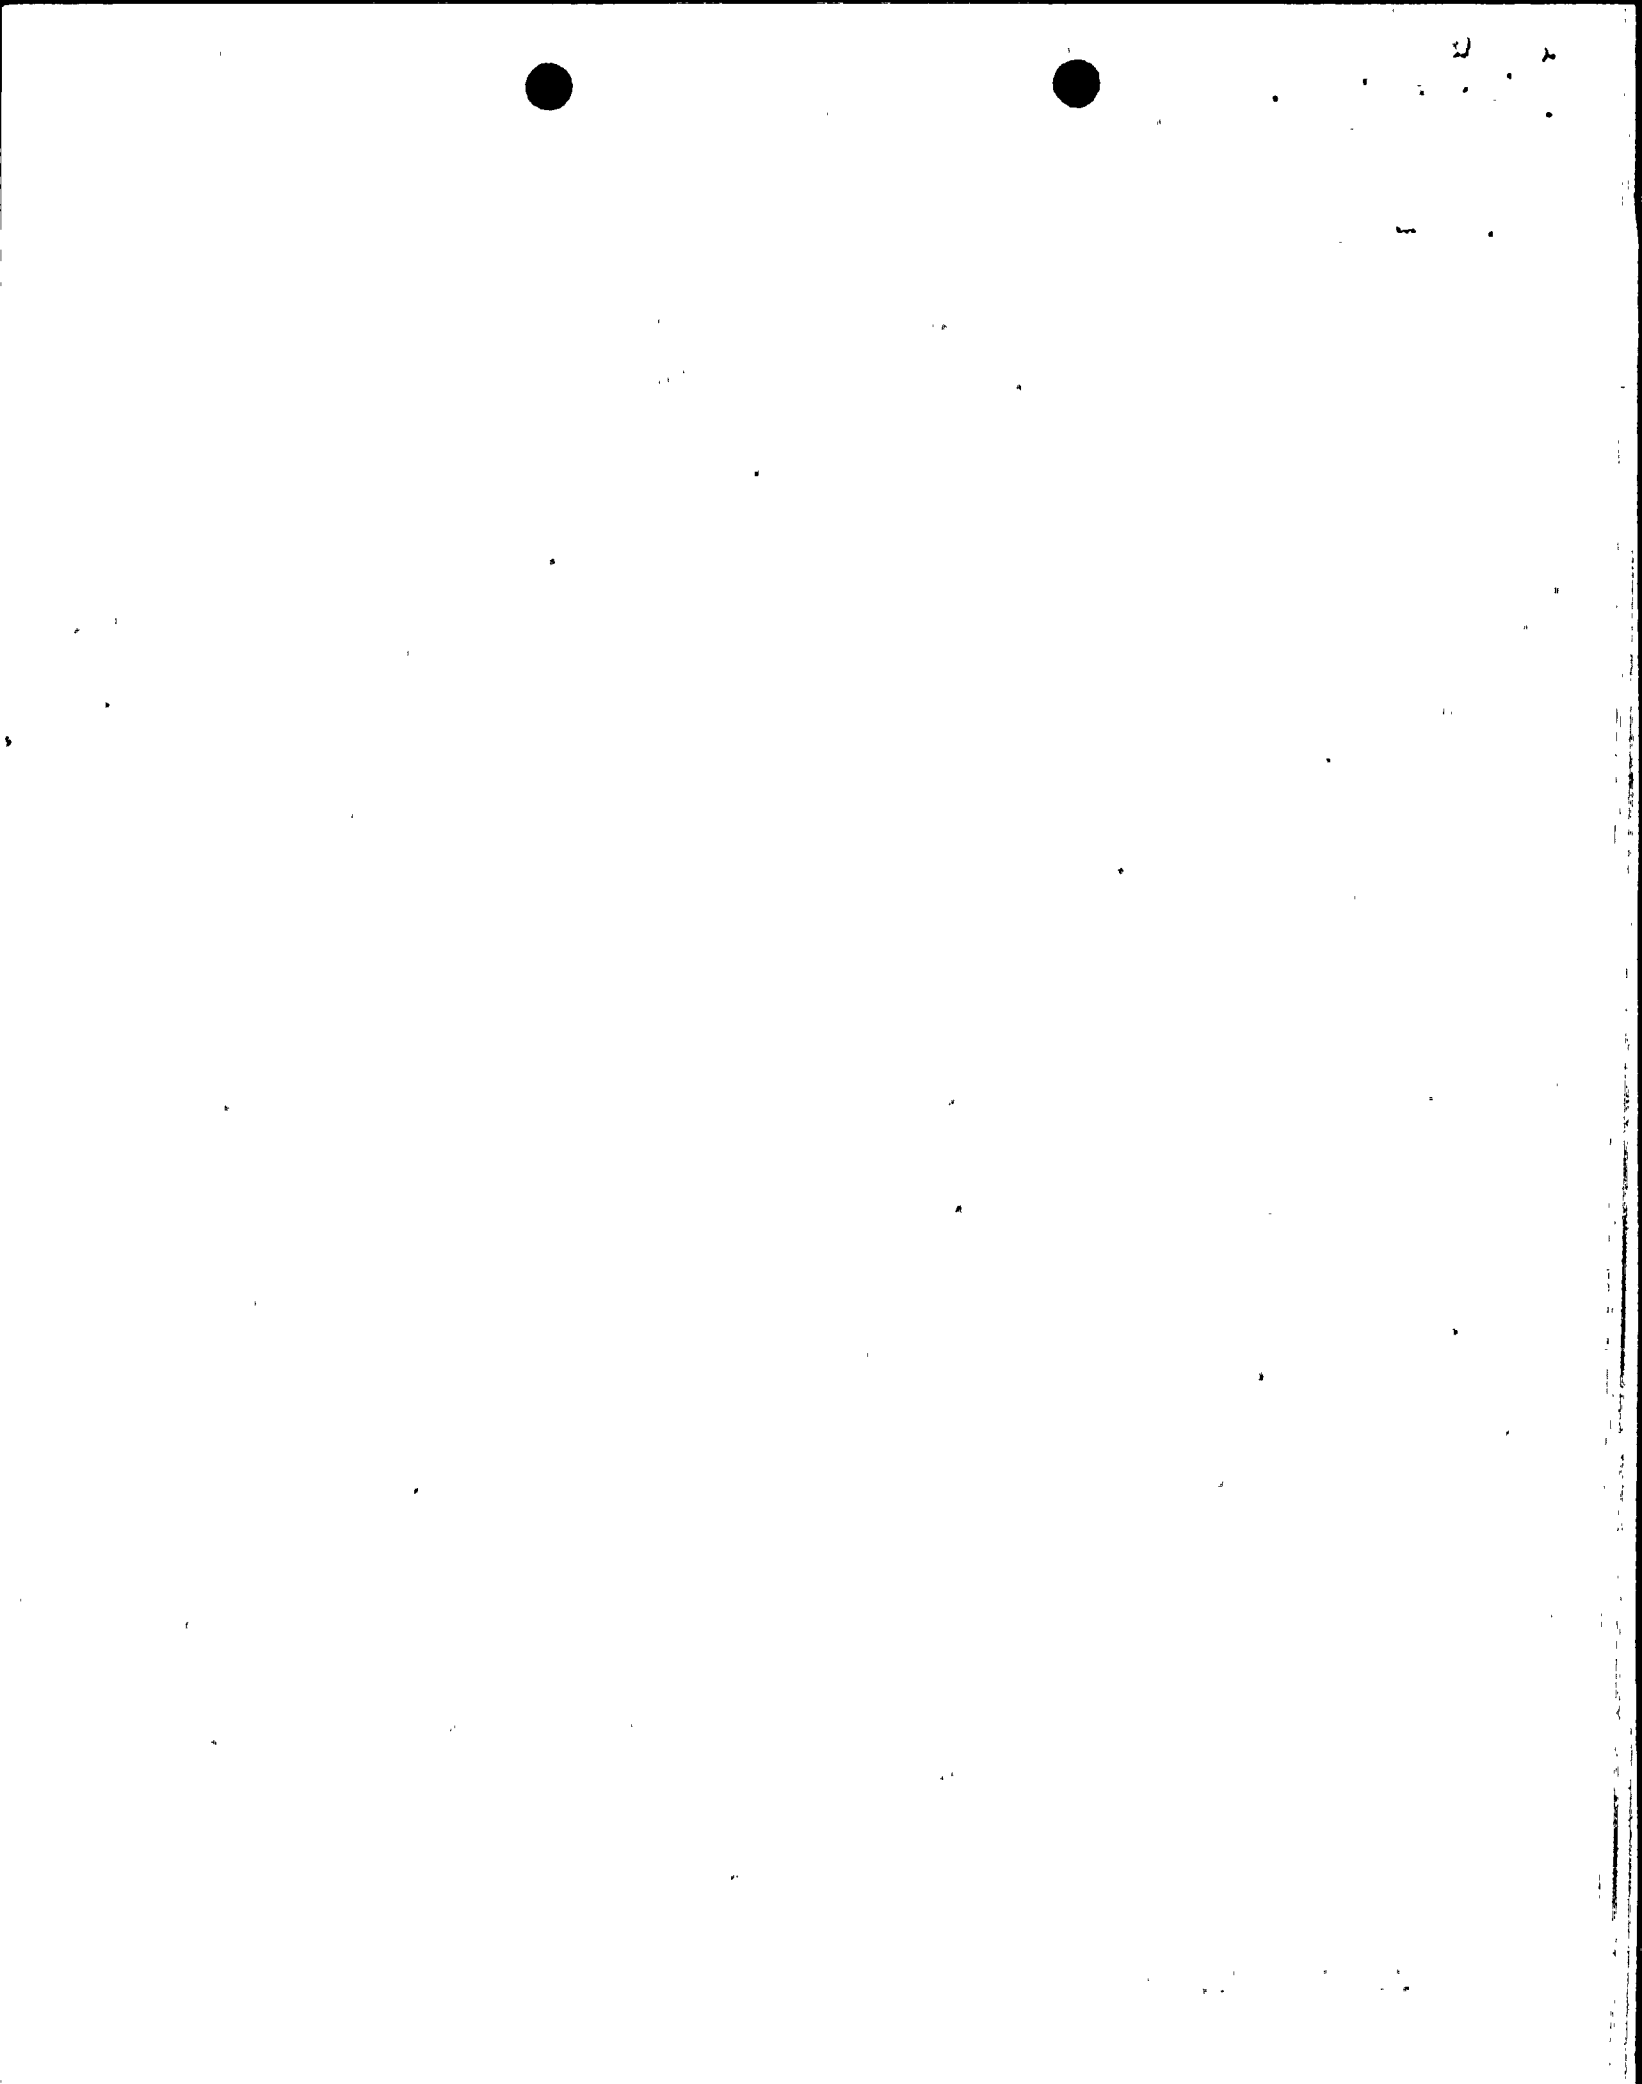

## REACTOR COOLANT SYSTEM

### SURVEILLANCE REQUIREMENTS

---

4.4.3.2.1 The reactor coolant system leakage shall be demonstrated to be within each of the above limits by:

- a. Monitoring the primary containment atmospheric particulate and gaseous radioactivity at least once per 12 hours,
- b. Monitoring the primary containment sump flow rate at least once per 12 hours,
- c. Monitoring the reactor vessel head flange leak detection system at least once per 24 hours.

4.4.3.2.2 Each reactor coolant system pressure isolation valve specified in Table 3.4.3.2-1 shall be demonstrated OPERABLE by leak testing pursuant to Specification 4.0.5 and verifying the leakage of each valve to be within the specified limit:

- a. At least once per 18 months.
- b. Prior to returning the valve to service following maintenance, repair or replacement work on the valve which could affect its leakage rate.

The provisions of Specification 4.0.4 are not applicable for entry into OPERATIONAL CONDITION 3.

4.4.3.2.3 The high/low pressure interface valve leakage pressure monitors shall be demonstrated OPERABLE with alarm setpoints per Table 3.4.3.2-2 by performance of a:

- a. CHANNEL FUNCTIONAL TEST at least once per 31 days, and
- b. CHANNEL CALIBRATION at least once per 18 months.