




REVISIONS				
NO	DATE	DESCRIPTION	BY	APPROVED
11	1-24-82	009-21M-94-007: REDRAWN	BB	DWC

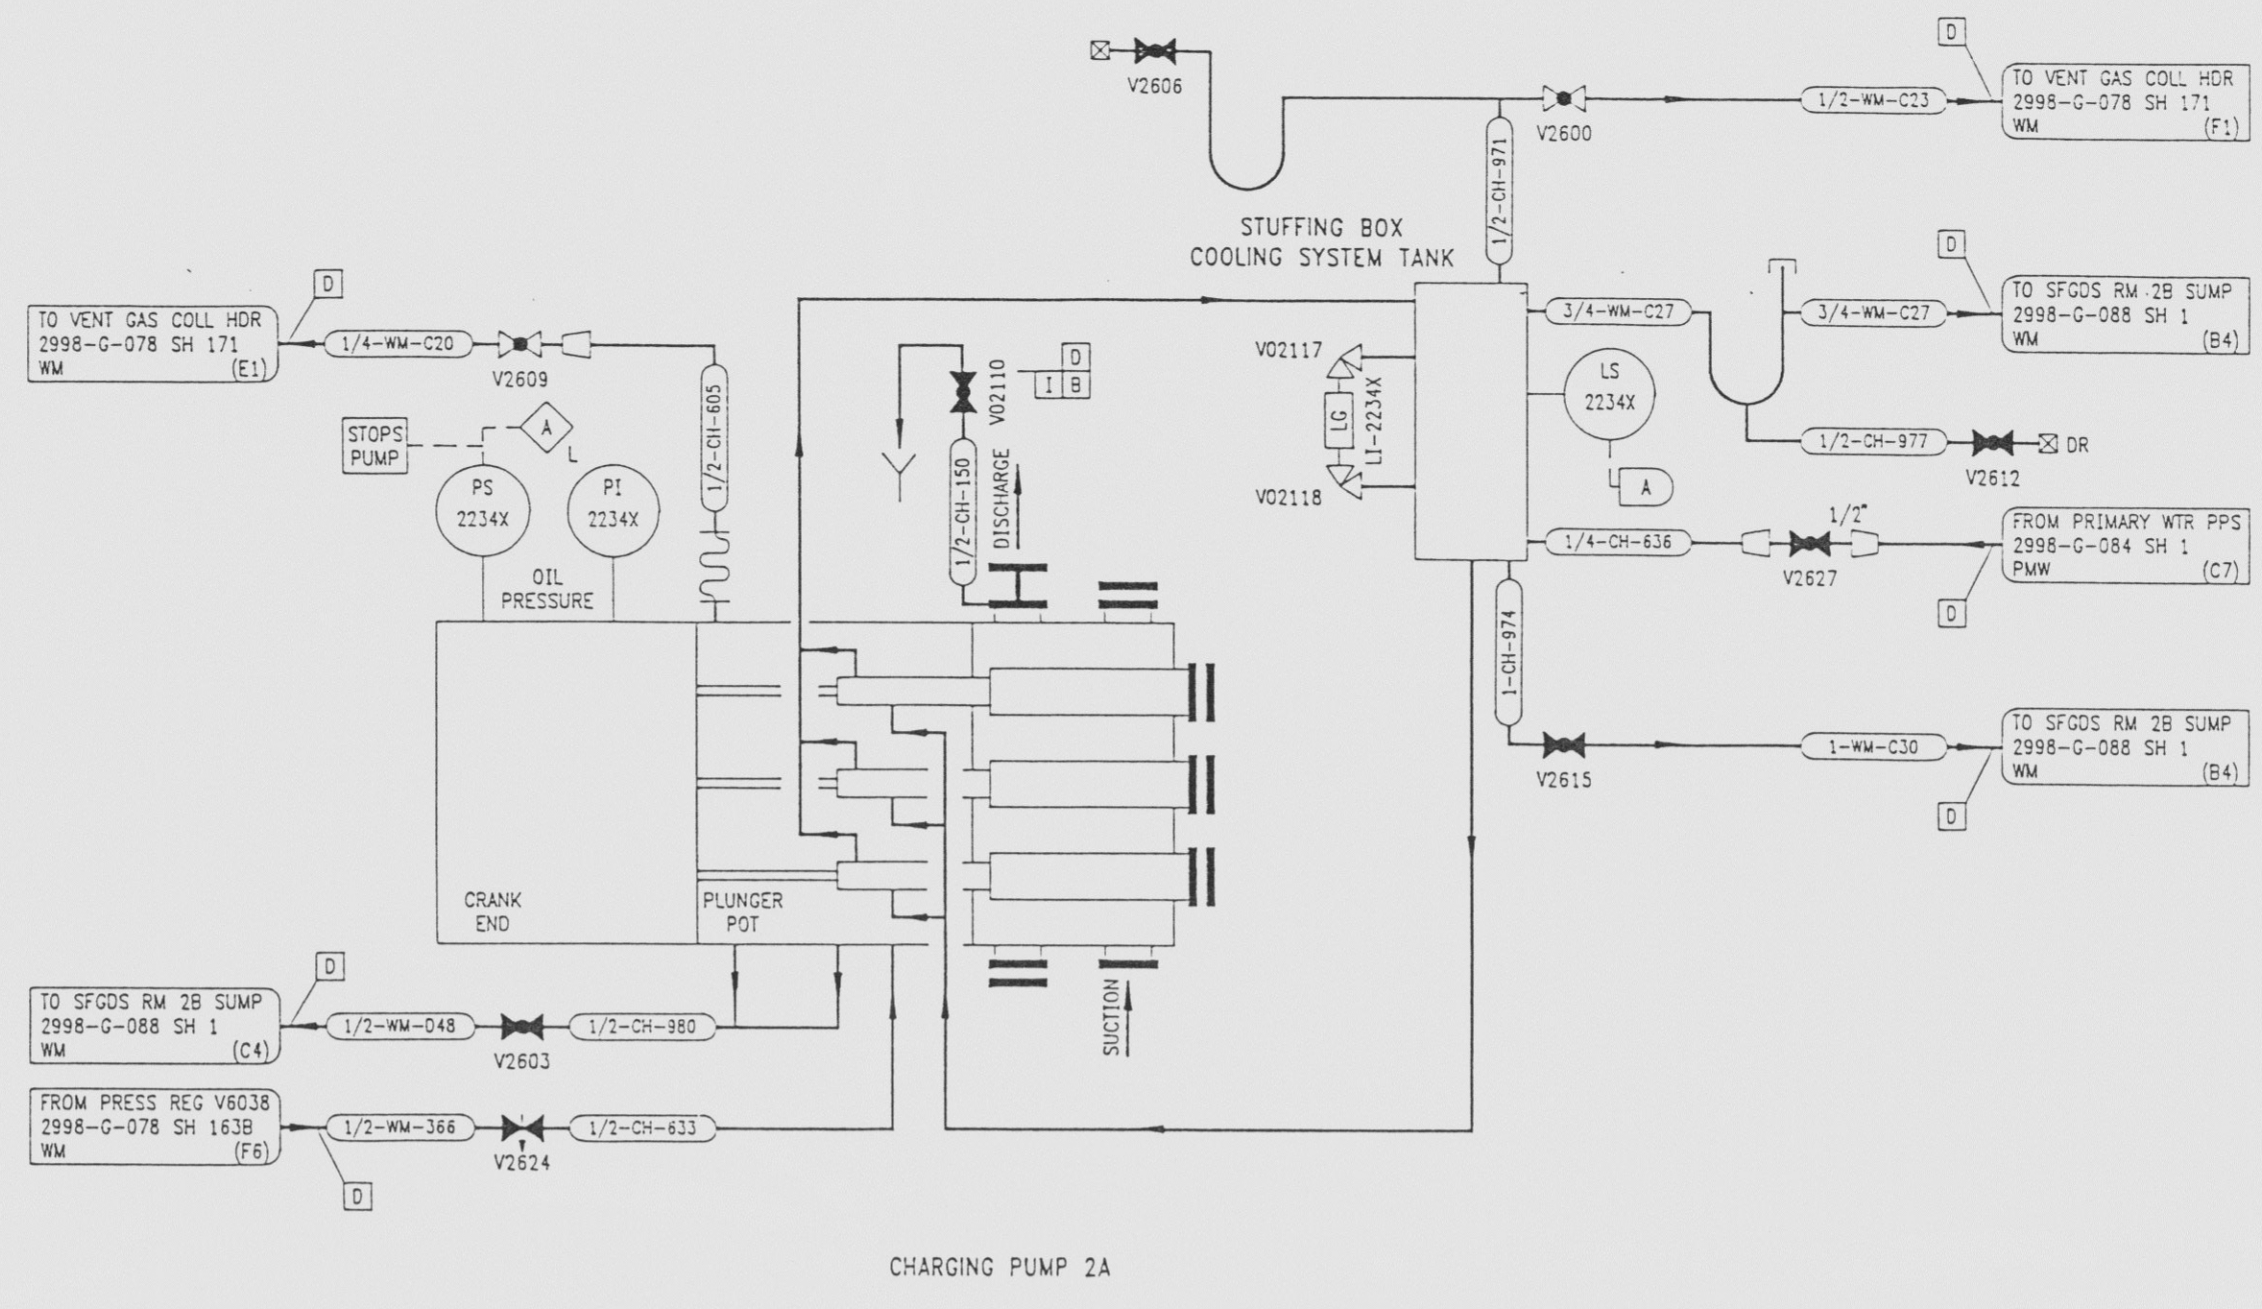

CHARGING PUMP 2A

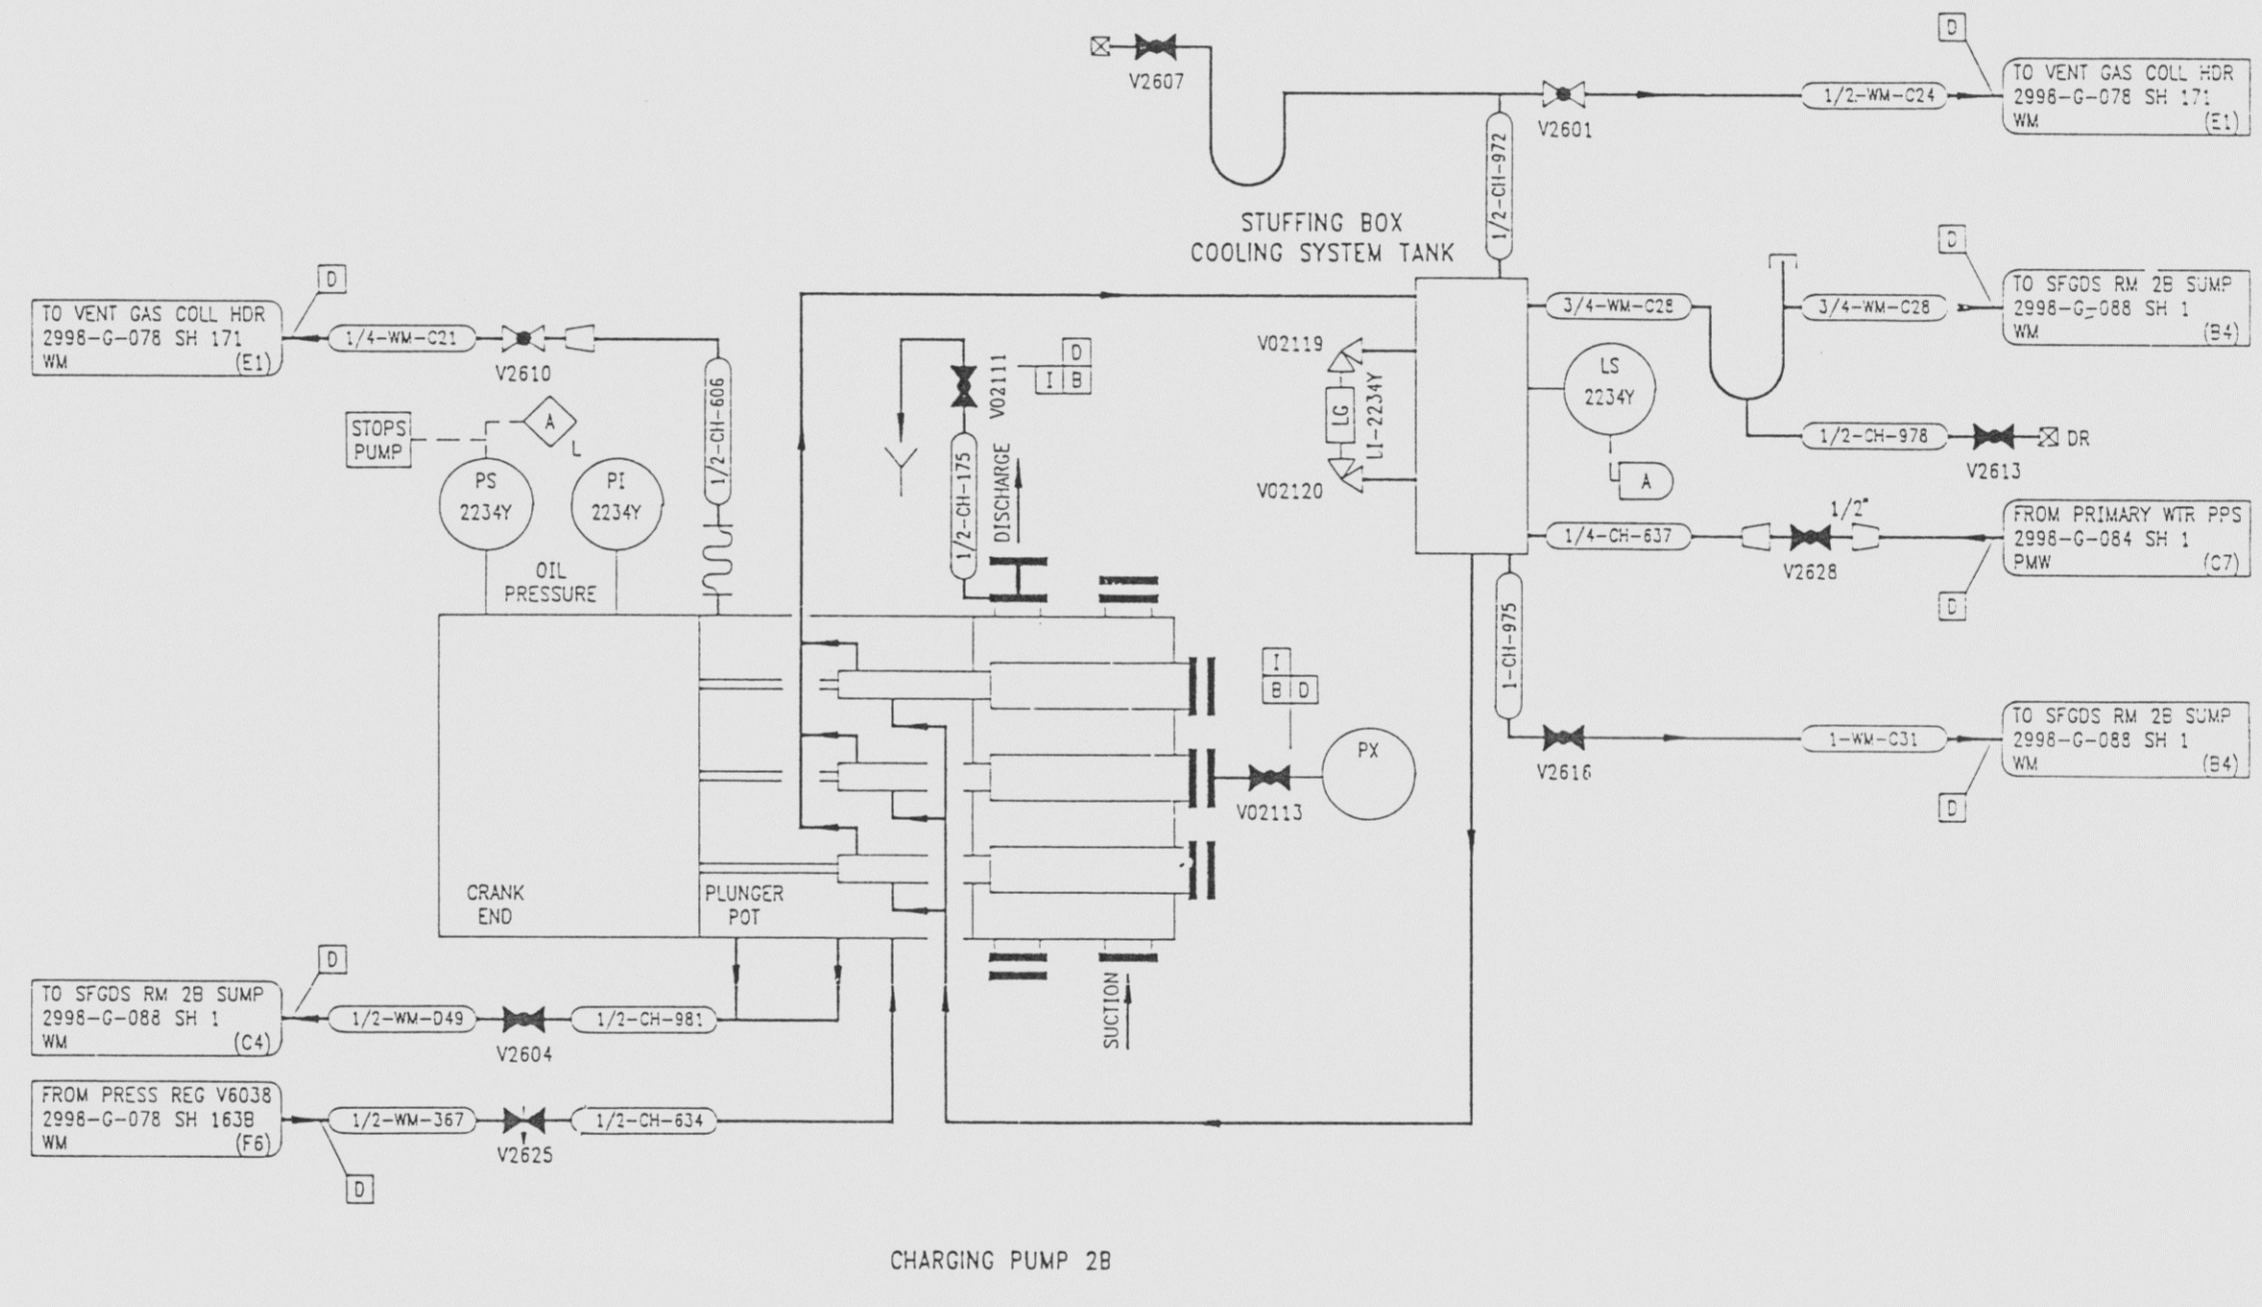

CHARGING PUMP 2B

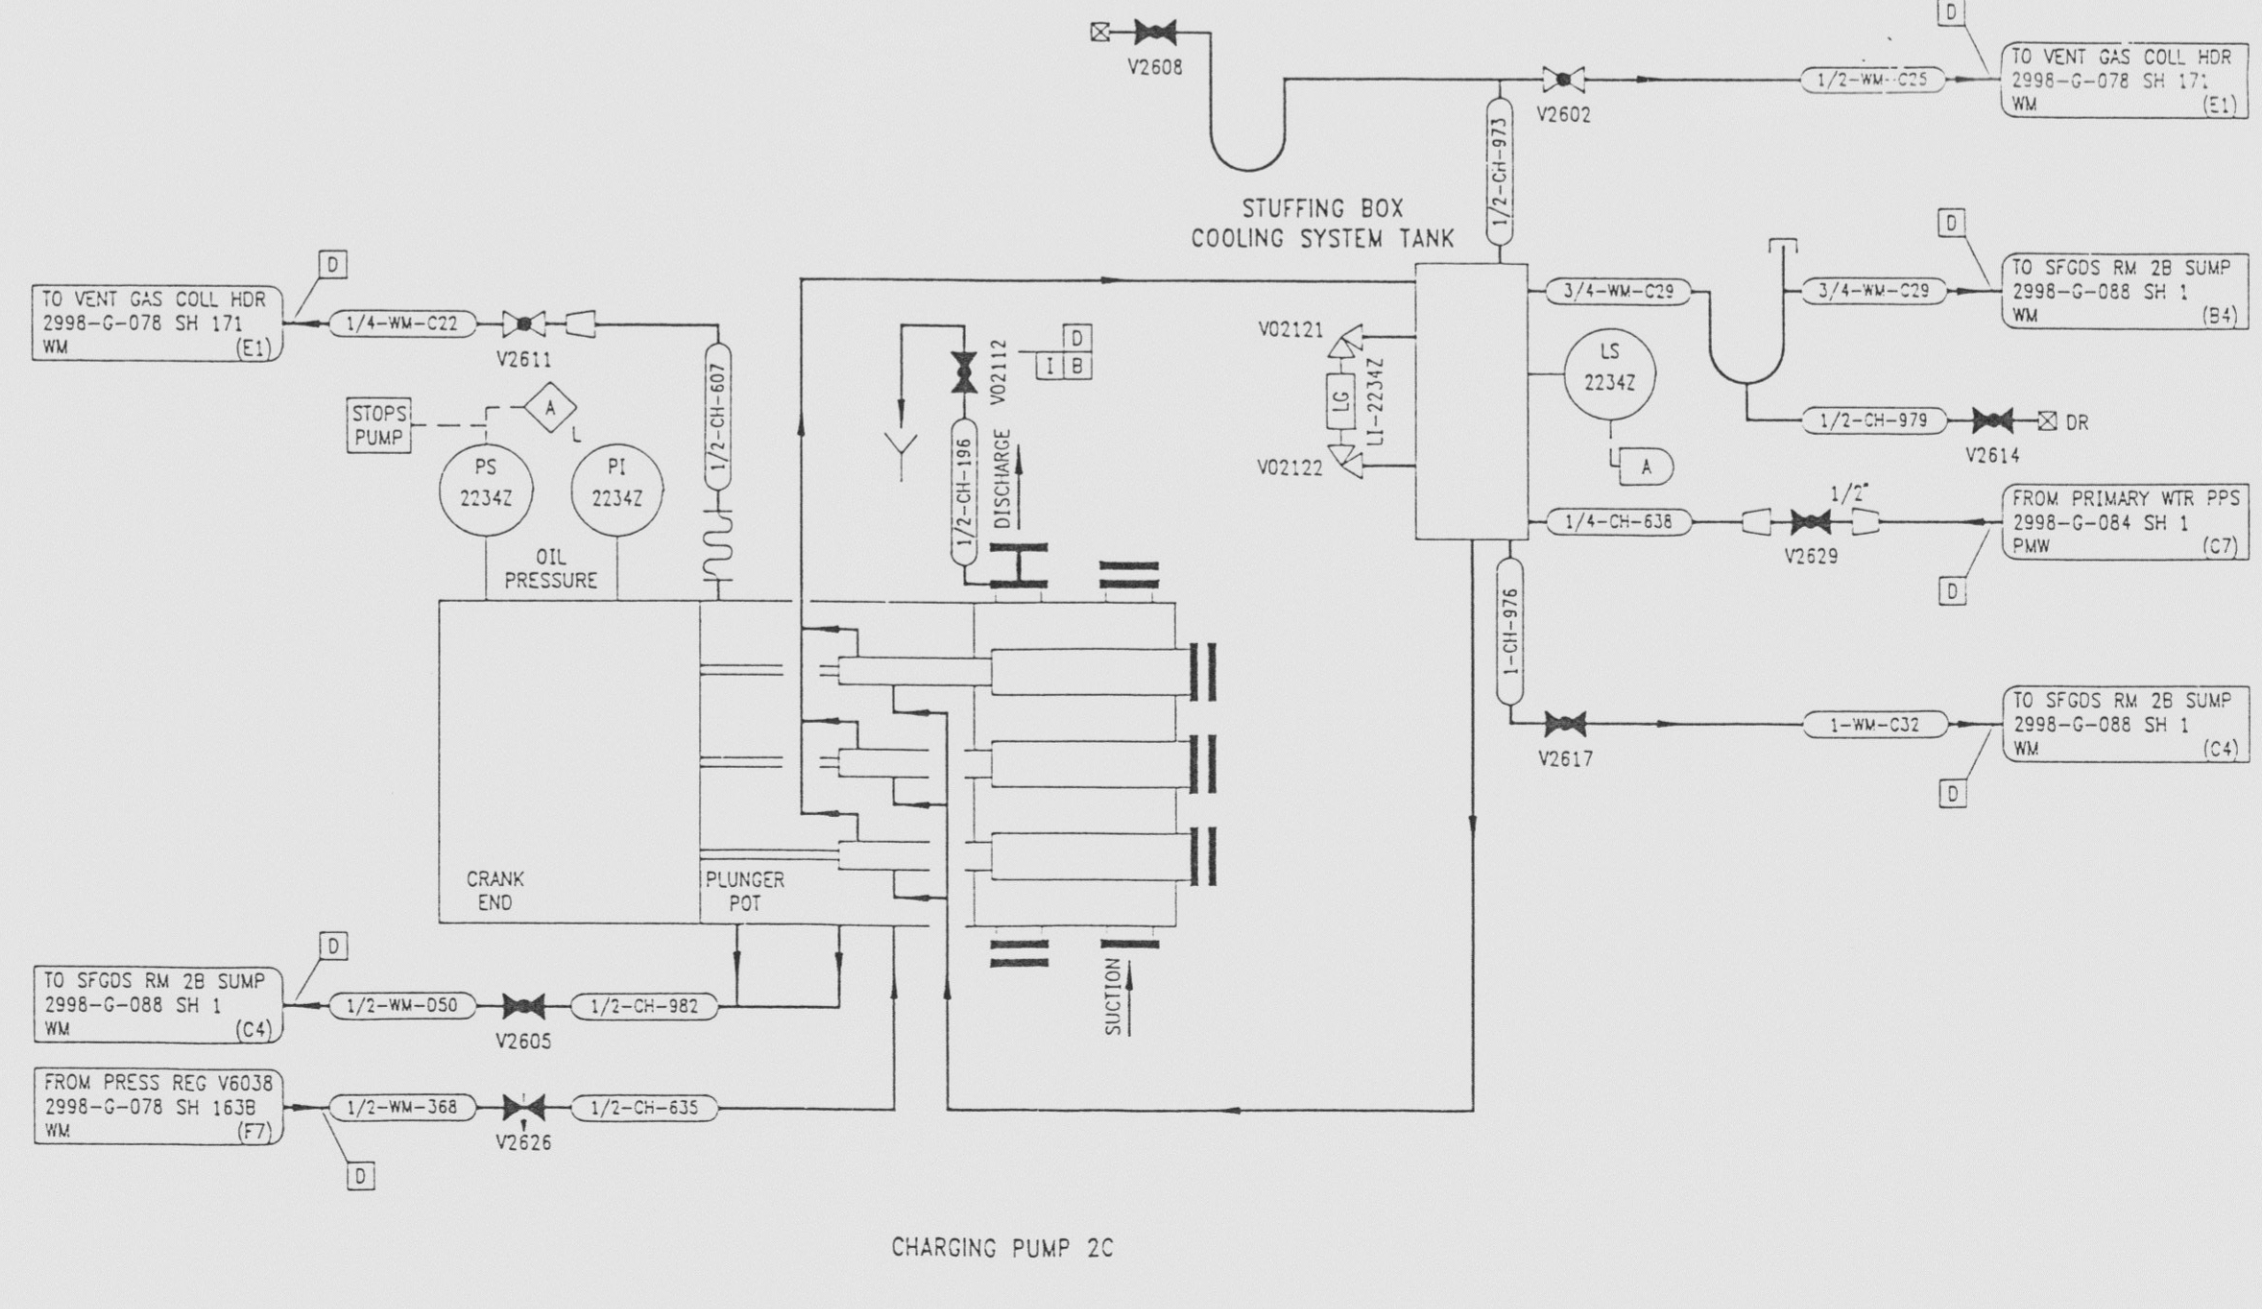

CHARGING PUMP 2C

REFERENCE DRAWINGS

PIPE, VALVE & INSTRUMENT SYMBOLS	2998-G-078 SH 100
VALVE LIST	2998-B-05
LINE LIST	2998-B-052
VALVE OPERATIONAL NUMBER INDEX	2998-B-057A
INSTRUMENT INSTALLATION DETAILS	2998-B-231
INSTRUMENT LIST	2998-B-270C

NOTE:
THIS DRAWING IS MADE FROM REV. 10
OF DRAWING 2998-G-078 SH 105

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF
THE FOLLOWING DOCUMENTS: FSAR FIGURE 1.2-34

**NUCLEAR SAFETY RELATED
IN PART ONLY**

FLORIDA POWER & LIGHT COMPANY
ST LUCIE PLANT
1983 - 890 MWe EXTENSION - UNIT 2
FLOW DIAGRAM
AUXILIARY PUMPS

**ANSTEC
APERTURE
GARD**

**INFORMATION
ONLY**
VERIFY WITH A CONTROLLED
COPY BEFORE USE.

RAYTHEON ENGINEERS & CONSTRUCTORS, INC.		
SCALE: NONE	APPROVAL	DATE:
DR: MECH		2998-G-078
DR: E. PLUM		SHEET
DR: C. MORGAN		105B
		11

97120400 15-125

E

DRAWING NUMBER
2998-G-078
SH-105B

DRAWING NUMBER
2998-G-078
SH-105B

DRAWING NUMBER

NUMBER