

3509-G-116
SH 1


REVISIONS				
NO	DATE	DESCRIPTION	BY	APPROVED
15	8/25/97		CJS	
DCR 360023; REDRAWN				

DRAWING NUMBER
3509-G-116
SH 1

DRAWING NUMBER
3509-G-116
SH 1


DRAWING NUMBER
3509-G-116
SH 1

NUMBER

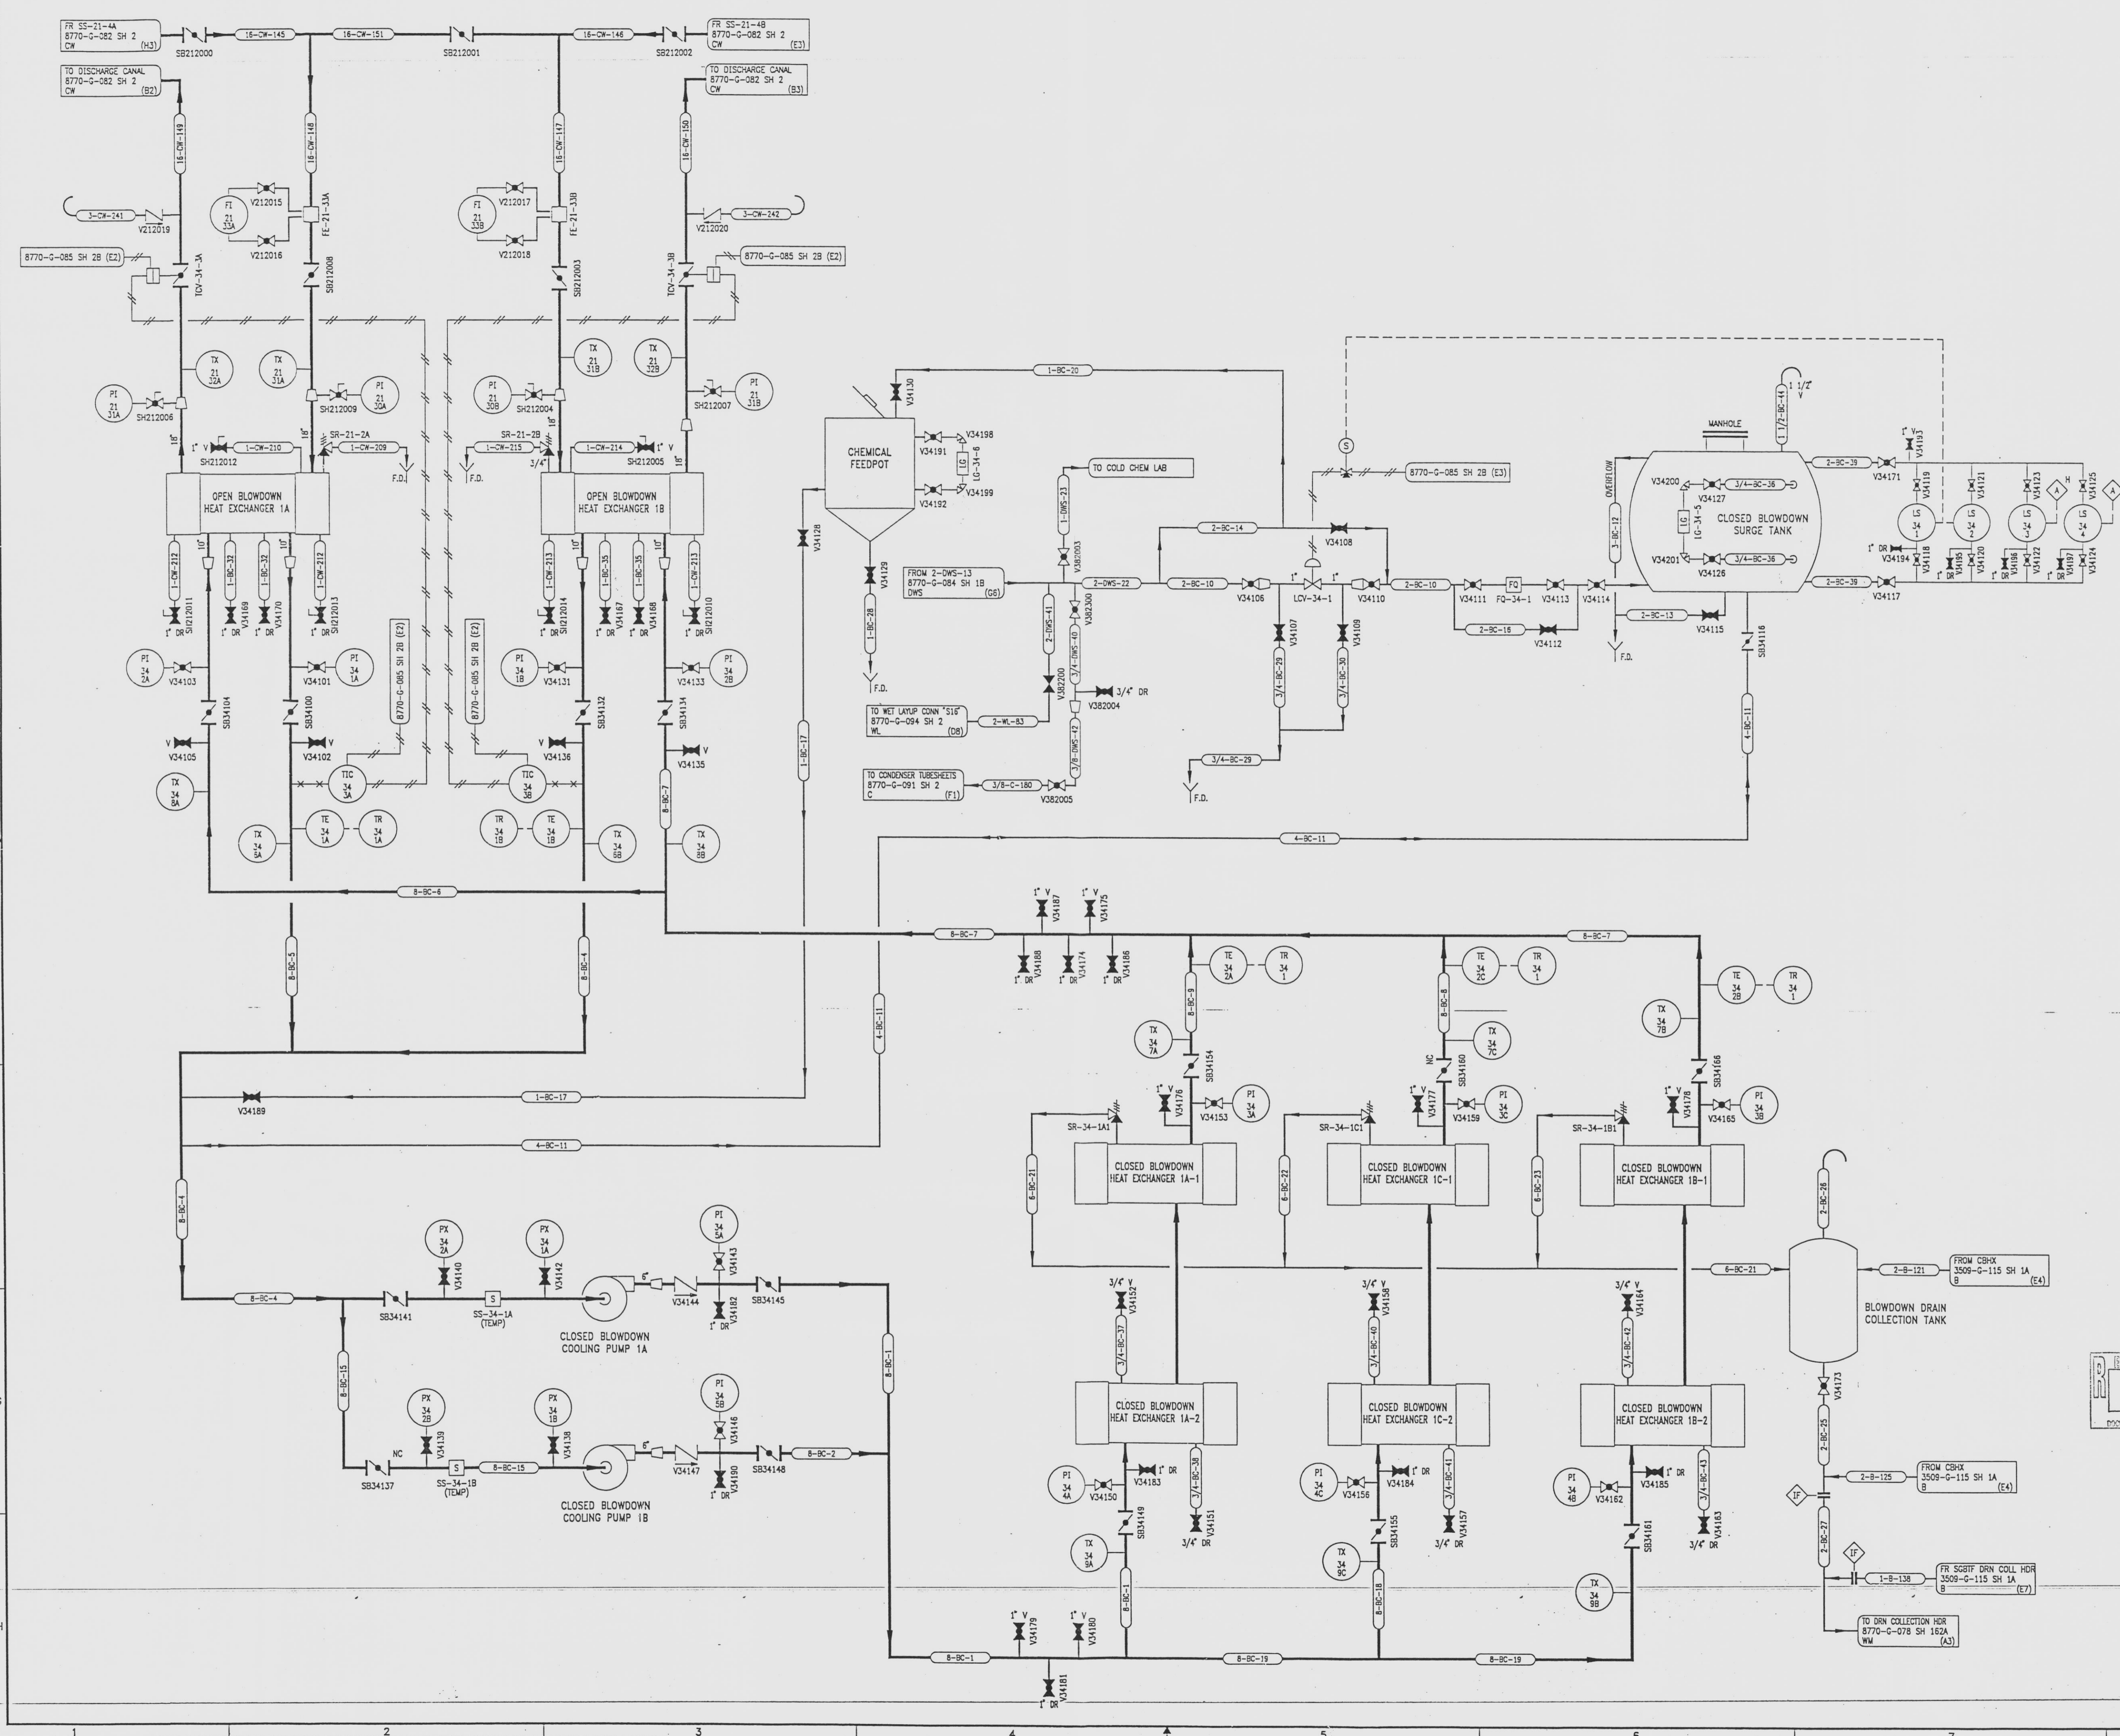

REFERENCE DRAWINGS
 PIPE, VALVES & INSTRUMENT SYMBOLS 8770-G-078 SH 100
 VALVE LIST 8770-A-051
 LINE LIST 8770-B-052
 VALVE OPERATIONAL NUMBER INDEX 8770-B-053
 INSTRUMENT INSTALLATION DETAILS 8770-B-231
 INSTRUMENT LIST 8770-B-270C

INFORMATION ONLY
 VERIFY WITH A CONTROLLED COPY BEFORE USE.

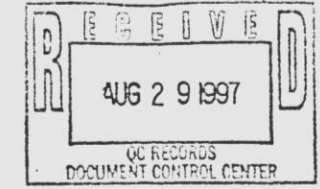

NOTE: THIS DRAWING IS MADE FROM REV. 14 OF DRAWING 3509-G-116

FLORIDA POWER & LIGHT COMPANY ST. LUCIE PLANT 1976 - 890 MWe INSTALLATION - UNIT 1 FLOW DIAGRAM STEAM GENERATOR BLOWDOWN COOLING SYSTEM		
FLORIDA POWER & LIGHT COMPANY		
SCALE: NONE	APPROVAL	DATE
DR: C. GATT		3509-G-116
CH: P. BERGERON		SHEET
		15

E 9712040015 - 123