



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

DOCKET NO. 50-397

WPPSS NUCLEAR PROJECT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

License No. NPF-21
Amendment No. 20

1. The Nuclear Regulatory Commission (the Commission or the NRC) has found that:
 - A. The application for amendment filed by the Washington Public Power Supply System (the Supply System, also the licensee) dated October 17, 1985, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application as amended, the provisions of the Act, and the regulations of the Commission;
 - C. There is reasonable assurance: (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations set forth in 10 CFR Chapter I;
 - D. The issuance of this amendment will not be inimical to the common defense and security or the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, Facility Operating License No. NPF-21 is amended to revise the Technical Specifications as indicated in the attachment to this amendment and paragraph 2.C.(2) of the Facility Operating License is hereby amended to read as follows:

(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 20, and the Environmental Protection Plan contained in Appendix B, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

8601160221 860107
PDR ADDCK 05000397
P PDR



3. This amendment is effective as of October 18, 1985.


FOR THE NUCLEAR REGULATORY COMMISSION

Elinor G. Adensam

Elinor G. Adensam, Director
Project Directorate No. 3
Division of BWR Licensing

Enclosure:
Changes to the Technical
Specifications

Date of Issuance: JAN 07 1986

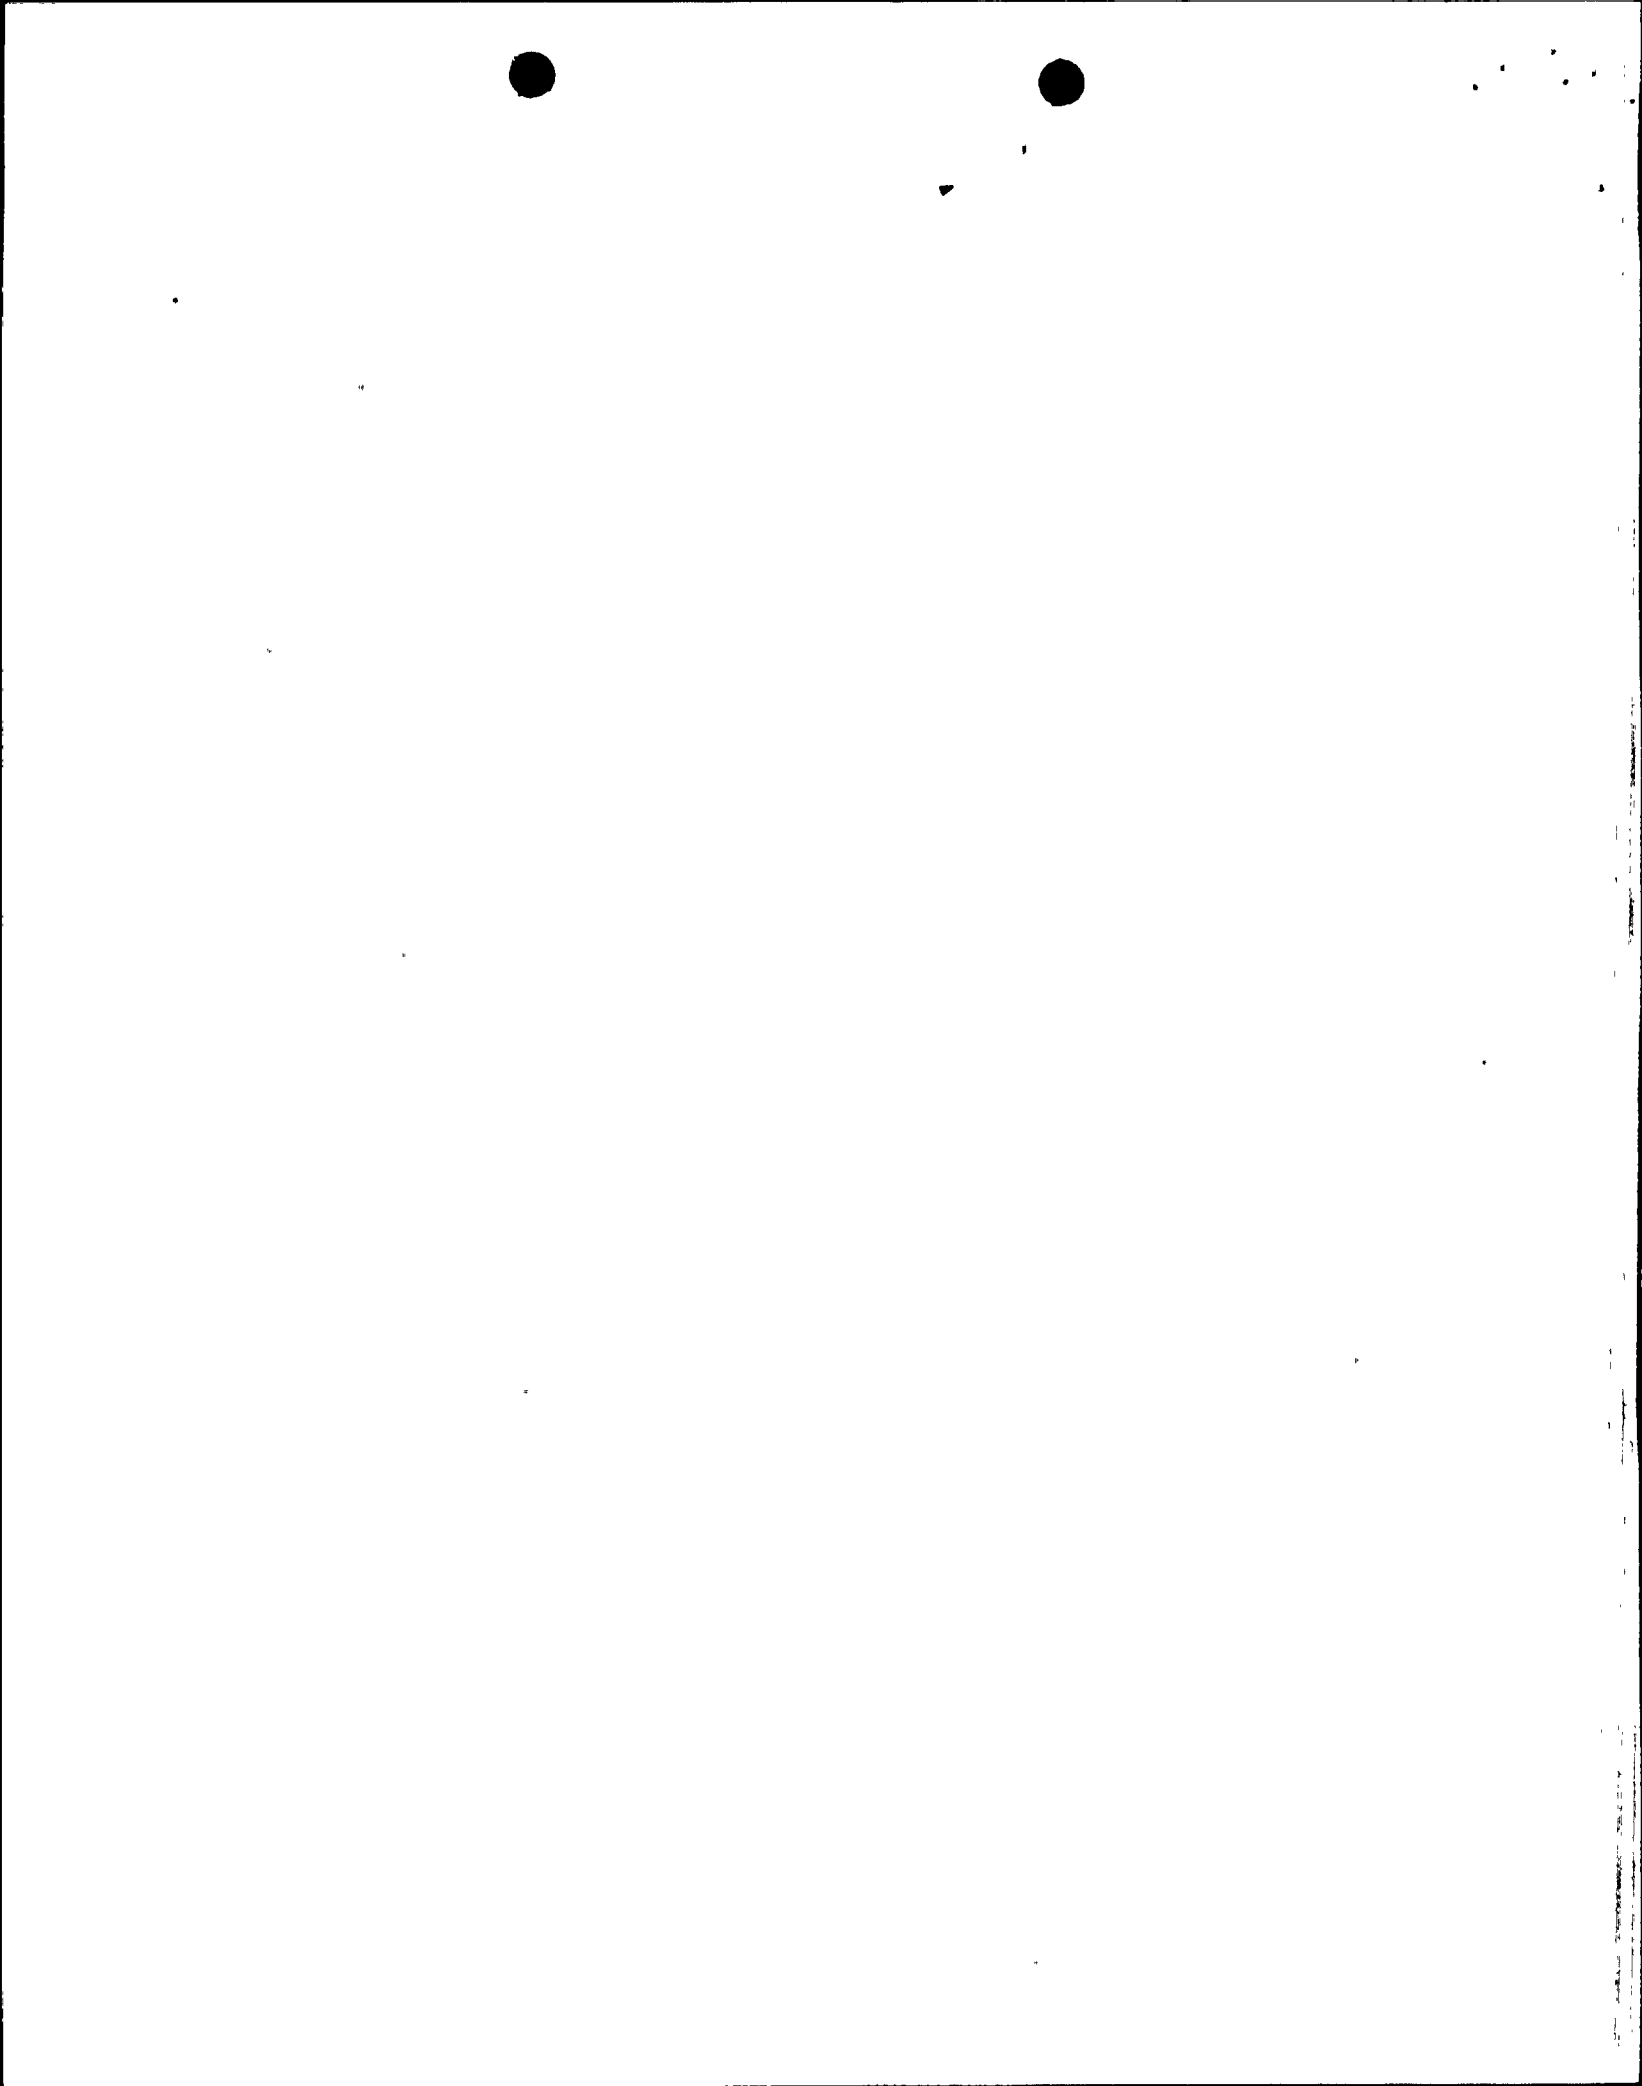

ATTACHMENT TO LICENSE AMENDMENT NO. 20

FACILITY OPERATING LICENSE NO. NPF-21

DOCKET NO. 50-397


Replace the following page of the Appendix "A" Technical Specifications with enclosed page. The revised page is identified by Amendment number and contains a vertical line indicating the area of change.

REMOVE

3/4 3-77

INSERT

3/4 3-77



INSTRUMENTATION

TRAVERSING IN-CORE PROBE SYSTEM

LIMITING CONDITION FOR OPERATION

3.3.7.7. The traversing in-core probe system shall be OPERABLE with:

- a. Five movable detectors, drives, and readout equipment to map the core, and
- b. Indexing equipment to allow all five detectors to be calibrated in a common location;

otherwise: with four traversing in-core probe machines, an inaccessible LPRM string may be calibrated using a traversing in-core probe scan from a symmetric string provided that an 'A' type control rod pattern is in use and that the total core TIP asymmetry is less than 6% (standard deviation).

APPLICABILITY: When the traversing in-core probe is used for:

- a. Recalibration of the LPRM detectors, and
- b.* Monitoring the APLHGR, LHGR, MCPR, or MFLPD.

ACTION:

With the traversing in-core probe system inoperable, suspend use of the system for the above applicable monitoring or calibration functions. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

4.3.7.7 The traversing in-core probe system shall be demonstrated OPERABLE by normalizing each of the above required detector outputs within 72 hours prior to use for the above applicable monitoring or calibration functions.

*Only the detector(s) in the required measurement location(s) are required to be OPERABLE.

