



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

DOCKET NO. 50-397

WPPSS NUCLEAR PROJECT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE


Amendment No. 25  
License No. NPF-21

1. The Nuclear Regulatory Commission (the Commission or the NRC) having found that:
  - A. The application for amendment filed by the Washington Public Power Supply System (the Supply System, also the licensee), dated March 28, 1986, and clarified by letters dated May 7 and 8, 1986, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the regulations of the Commission;
  - C. There is reasonable assurance: (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations set forth in 10 CFR Chapter I;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, Facility Operating License No. NPF-21, Attachment 2, Paragraph 3. of License Condition 2.C.(16) is hereby amended to read as follows:

Attachment 2, Paragraph 3.

- (a) The licensee shall implement (installation or upgrade) requirements of Regulatory Guide 1.97, Revision 2 with the exception of items (b) and (c) below prior to startup following the first refueling outage.
- (b) The licensee shall implement (installation or upgrade) requirements of Regulatory Guide 1.97, Revision 2, for flux monitoring prior to startup following the second refueling outage.

8605300336 860523  
PDR ADDCK 05000397  
PDR

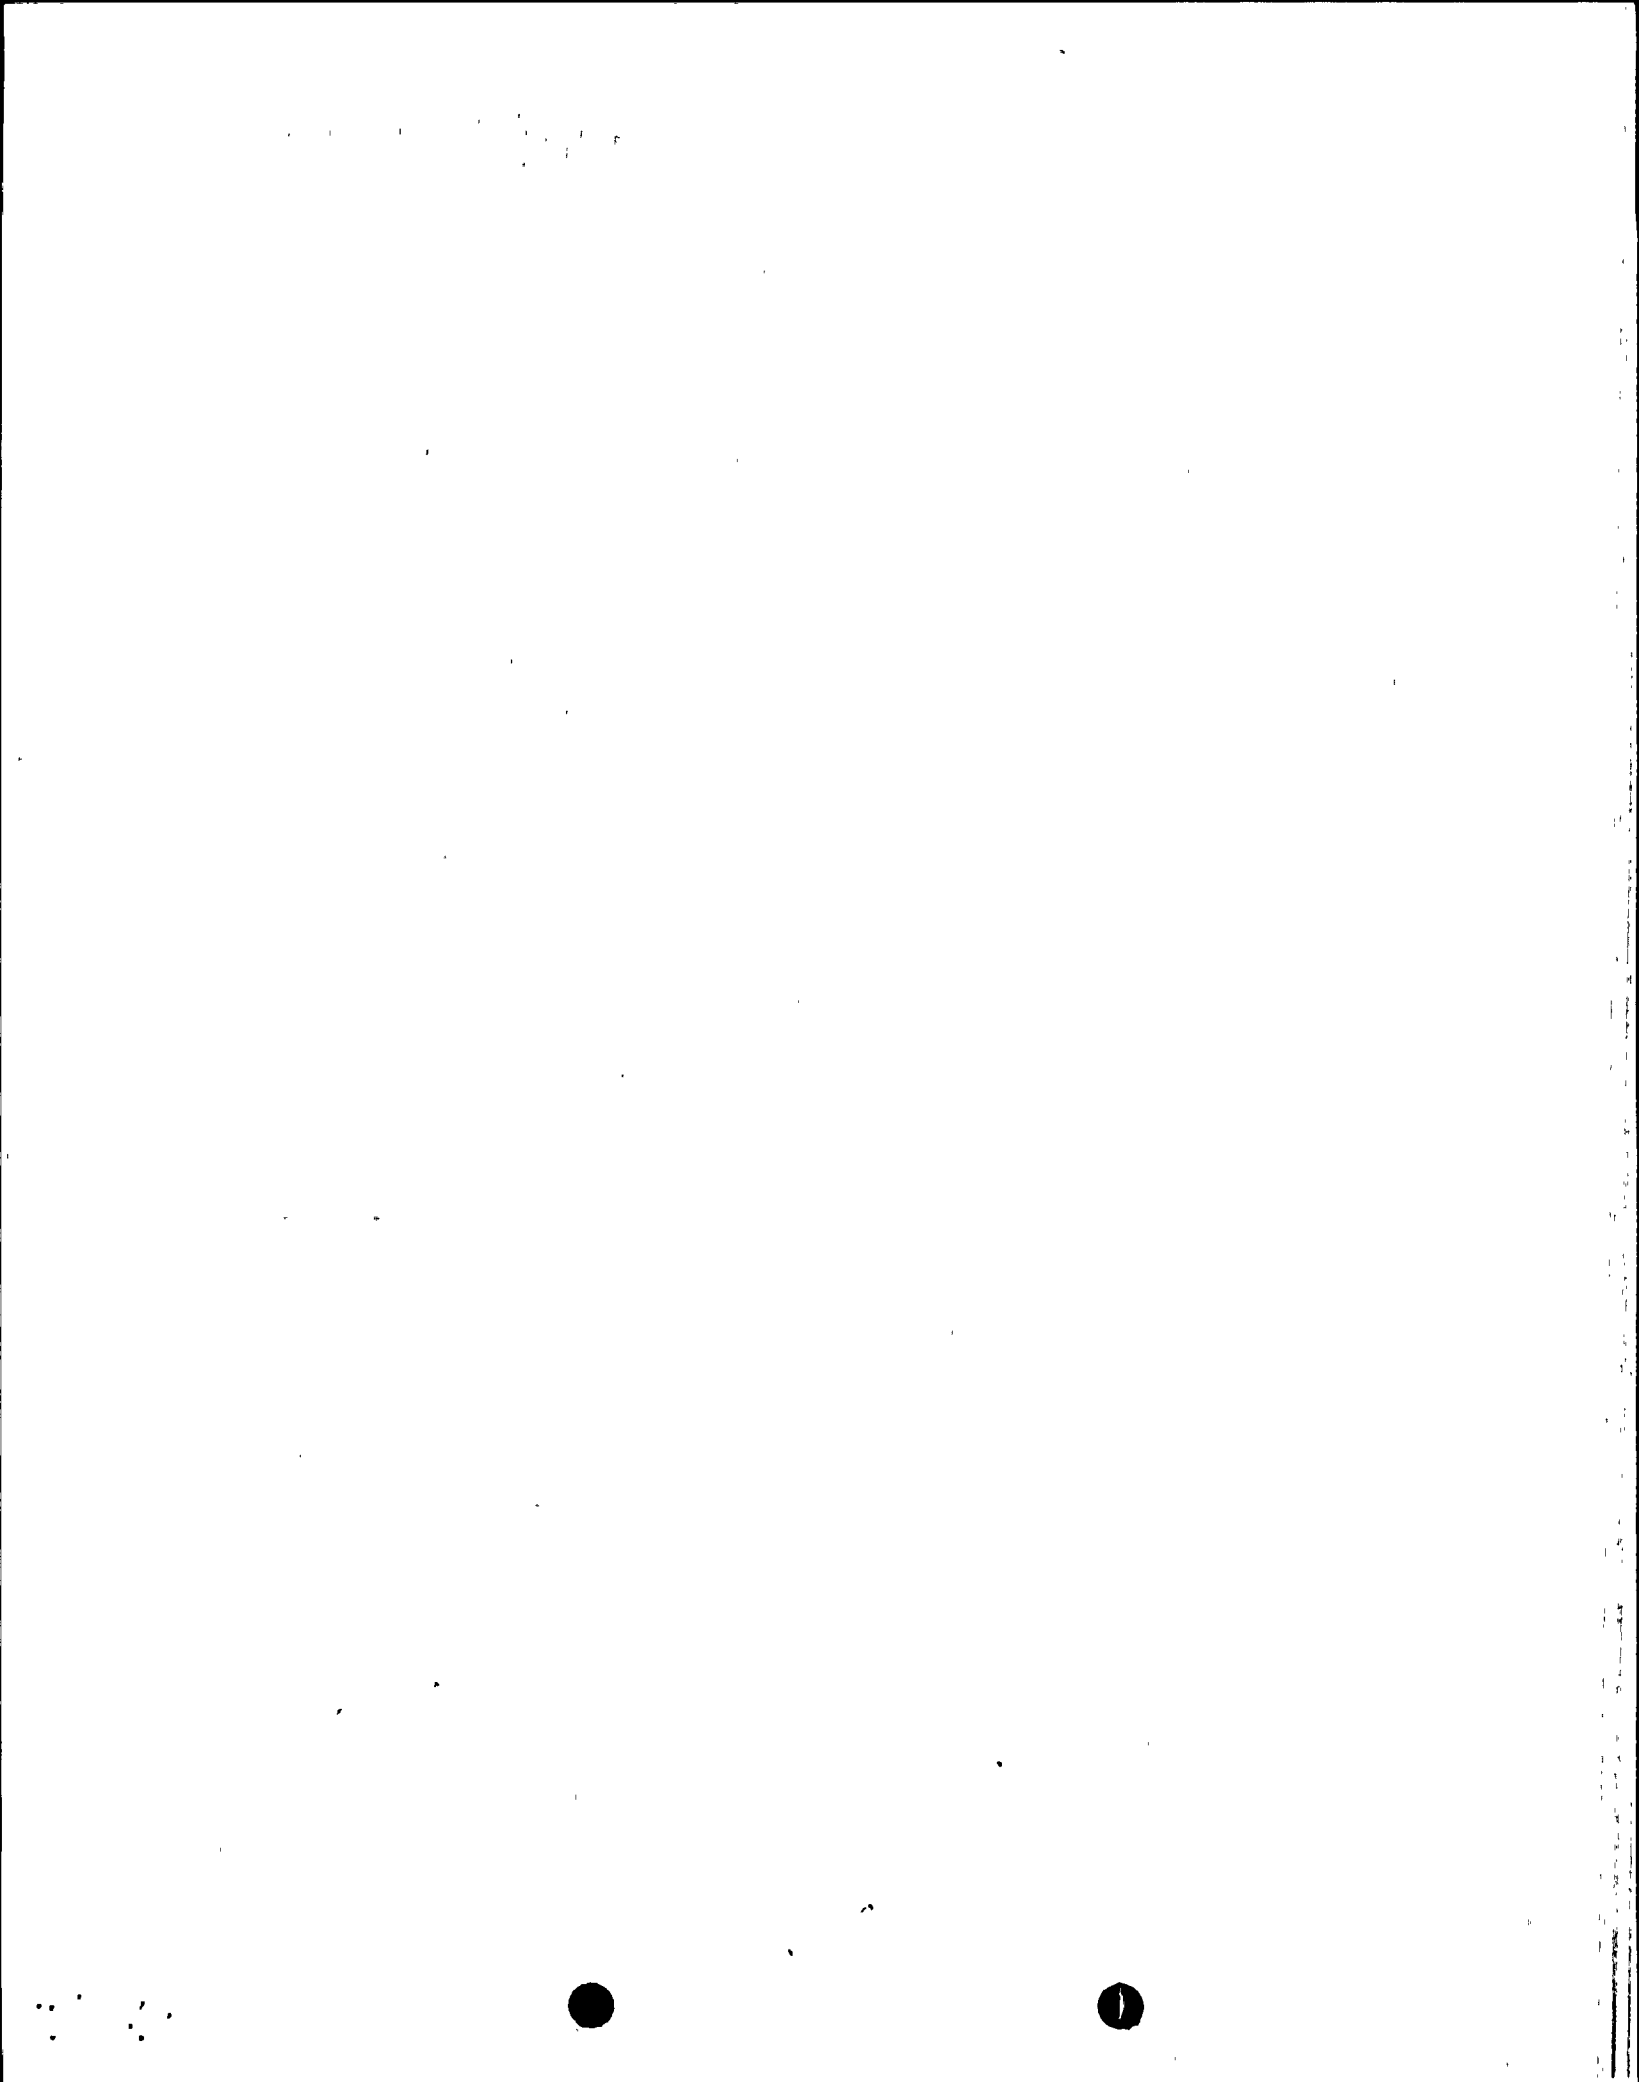

(c) The licensee shall implement (install and have operational) a wide range suppression pool level monitoring system which satisfies the Category 1 equipment specifications in accordance with Regulatory Guide 1.97, Revision 2, prior to startup following the second refueling outage.

3. This amendment is effective as of the date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

*Elinor G. Adensam*

Elinor G. Adensam, Director  
BWR Project Directorate No. 3  
Division of BWR Licensing

Date of Issuance: May 23, 1986

