



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

DOCKET NO. 50-397

WPPSS NUCLEAR PROJECT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 44  
License No. NPF-21-

1. The Nuclear Regulatory Commission (the Commission or the NRC) has found that:
  - A. The application for amendment filed by the Washington Public Power Supply System (the Supply System, also the licensee), dated November 18, 1986 as clarified by letters dated January 7, February 25, and April 15, 1987 complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the regulations of the Commission;
  - C. There is reasonable assurance: (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations set forth in 10 CFR Chapter I;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

8706100239 870602  
PDR ADDOCK 05000397  
P PDR




2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the enclosure to this license amendment and paragraph 2.C.(2) of the Facility Operating License No. NPF-21 is hereby amended to read as follows:

(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 44, and the Environmental Protection Plan contained in Appendix B, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.


3. This amendment is effective as of the date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

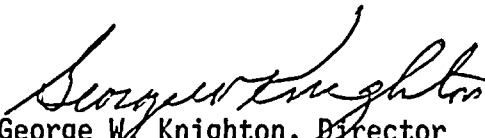  
George W. Knighton, Director  
Project Directorate V  
Division of Reactor Projects - III/IV/V  
& Special Projects

Enclosure: Changes to the Technical  
Specifications

Date of Issuance: June 2, 1987

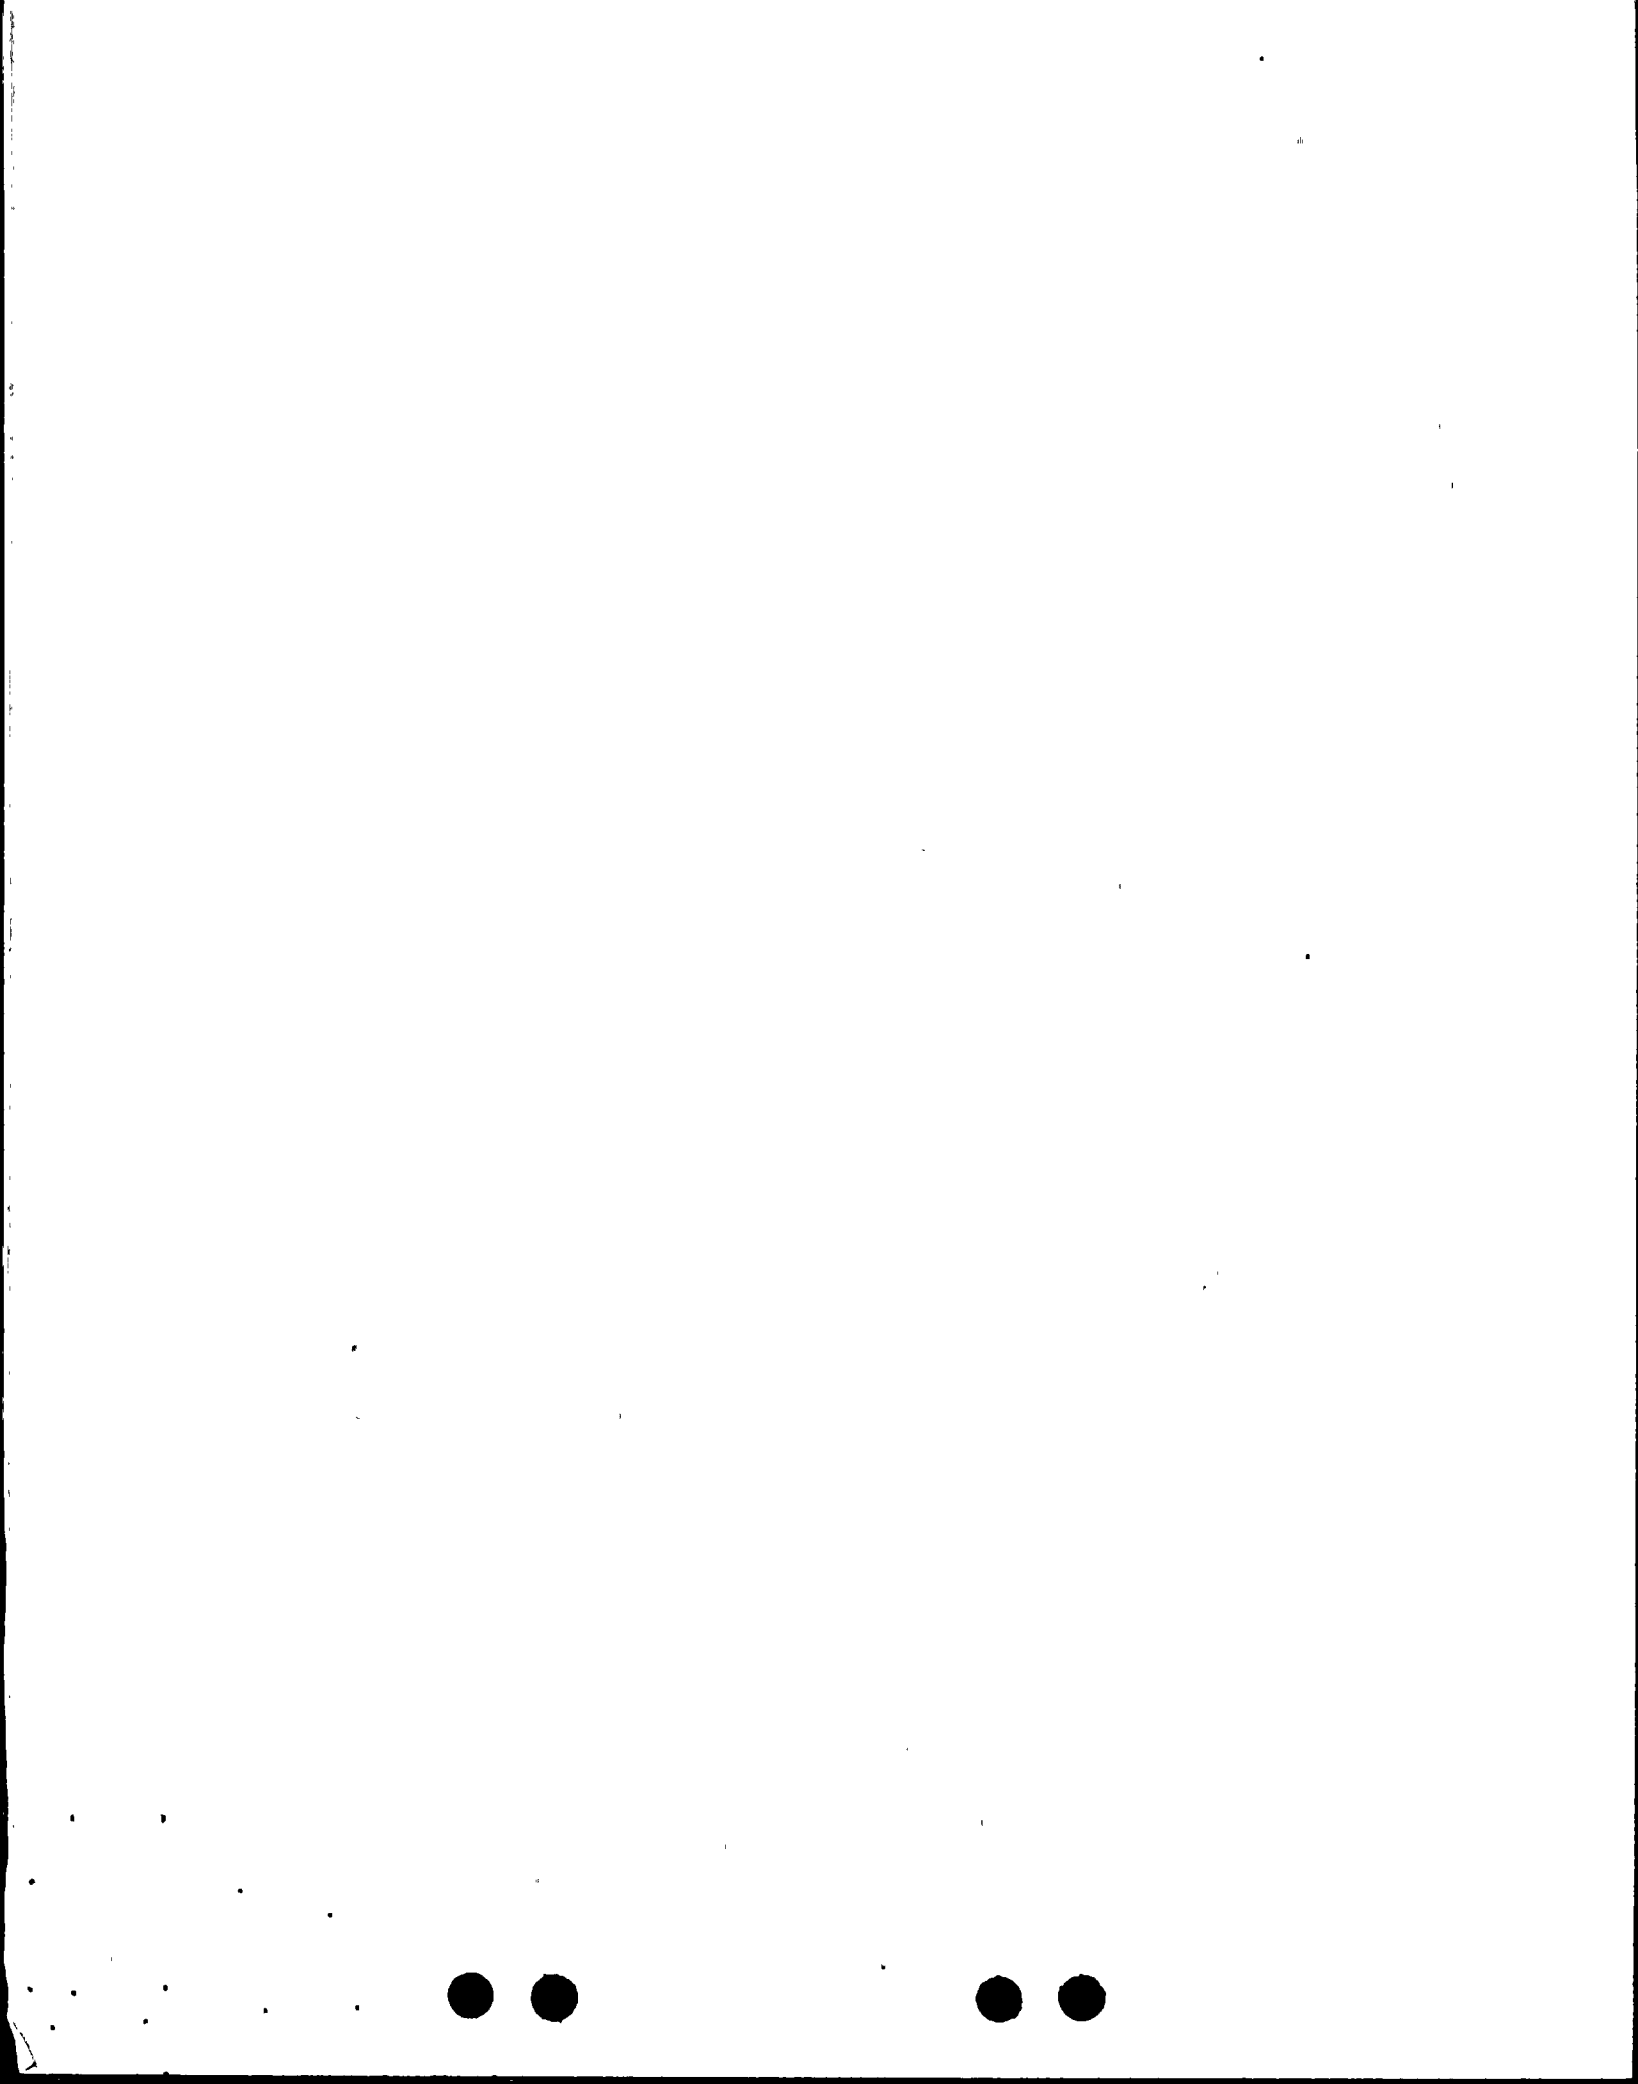

June 2, 1987

ENCLOSURE TO LICENSE AMENDMENT NO. 44

FACILITY OPERATING LICENSE NO. NPF-21

DOCKET NO. 50-397

Replace the following page of the Appendix "A" Technical Specifications with the enclosed page. The revised page is identified by Amendment number and contains vertical lines indicating the areas of change.

REMOVE

3/4 6-22

INSERT

3/4 6-22

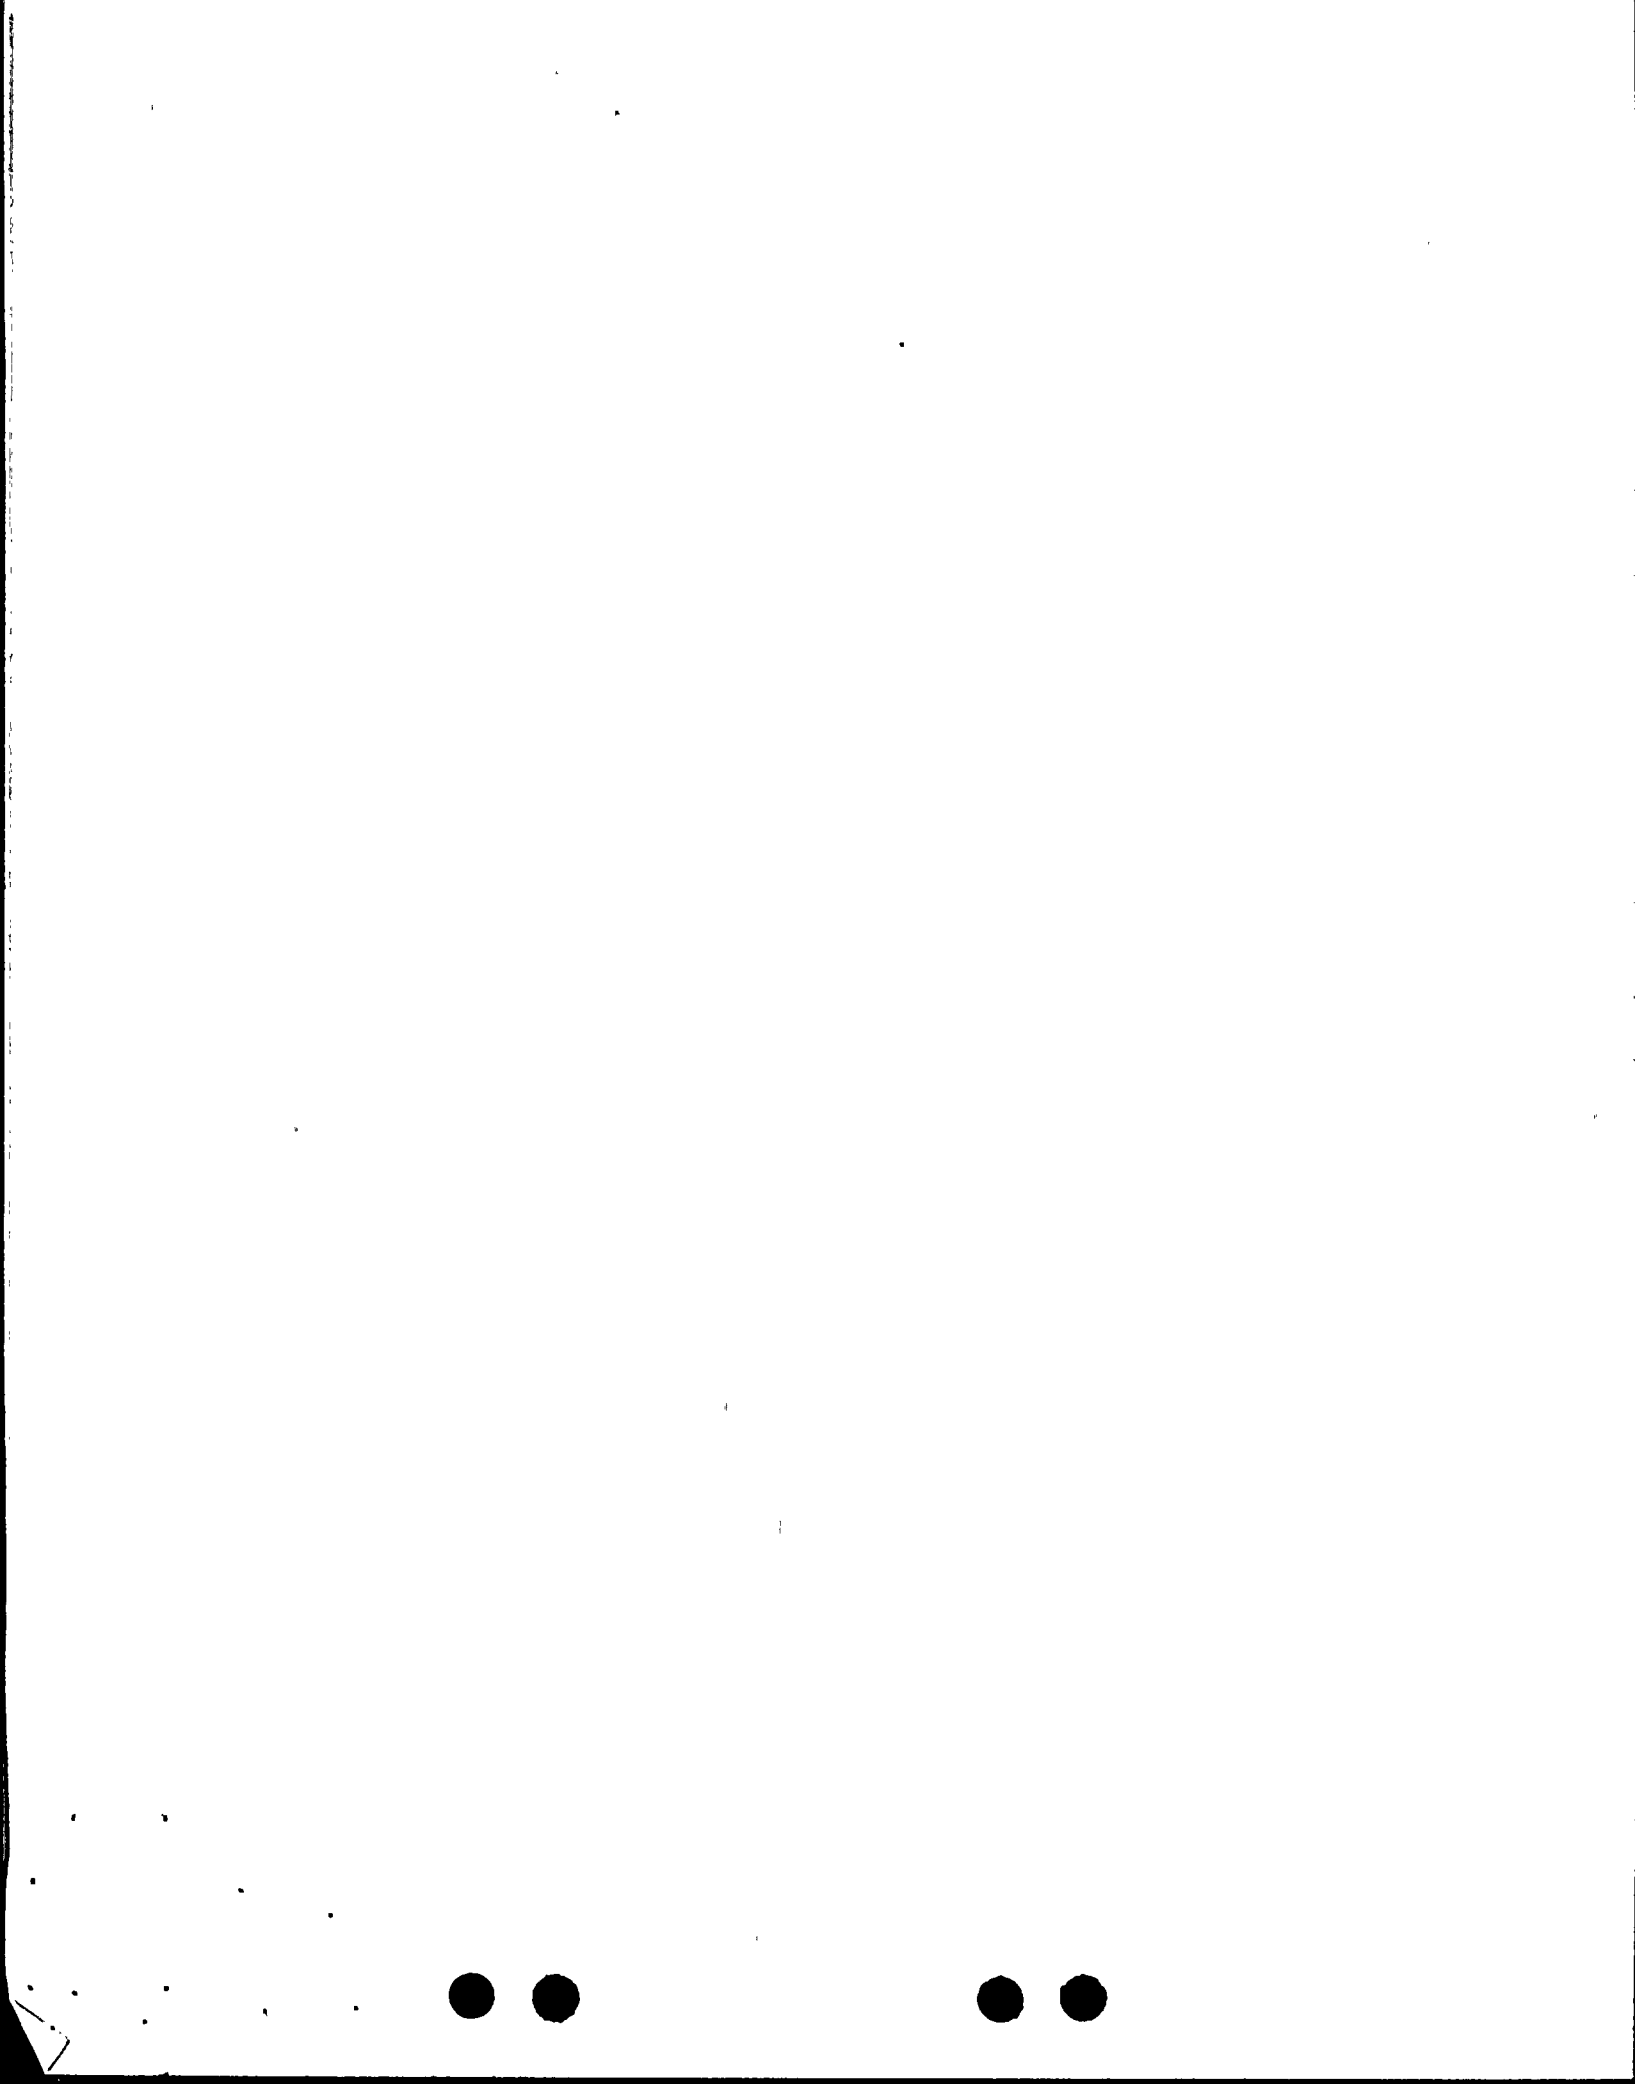


TABLE 3.6.3-1 (Continued)  
PRIMARY CONTAINMENT ISOLATION VALVES

<u>VALVE FUNCTION AND NUMBER</u>	<u>VALVE GROUP(a)</u>	<u>MAXIMUM ISOLATION TIME (Seconds)</u>
a. <u>Automatic Isolation Valves (Continued)</u>		
Equipment Drain (Radioactive)	4	15
EDR-V-19		
EDR-V-20		
Floor Drain (Radioactive)	4	15
FDR-V-3		
FDR-V-4		
Fuel Pool Cooling/Suppression Pool Cleanup	4	35
FPC-V-149		
FPC-V-153(f)		
FPC-V-154(f)		
FPC-V-156		
Reactor Recirculation Hydraulic Control(e)	4	15
HY-V-17A,B		
HY-V-18A,B		
HY-V-19A,B		
HY-V-20A,B		
HY-V-33A,B		
HY-V-34A,B		
HY-V-35A,B		
HY-V-36A,B		
Traversing Incore Probe	4	5
TIP-V-1,2,3,4,5		
TIP-V-15		

