



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

DOCKET NO. 50-397

WPPSS NUCLEAR PROJECT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 49
License No. NPF-21

1. The Nuclear Regulatory Commission (the Commission or the NRC) has found that:
 - A. The application for amendment filed by the Washington Public Power Supply System (the Supply System, also the licensee), dated September 27, 1985 and supplemented by letters dated November 6, 1985 and September 17, 1986 complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act), and the Commission's regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the regulations of the Commission;
 - C. There is reasonable assurance: (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations set forth in 10 CFR Chapter I;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the enclosure to this license amendment and paragraph 2.C.(2) of the Facility Operating License No. NPF-21 is hereby amended to read as follows:


(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 49, and the Environmental Protection Plan contained in Appendix B, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

0801040301 871224
PDR ADDCK 05000397
P PDR

3. This amendment is effective as of the date of issuance.


FOR THE NUCLEAR REGULATORY COMMISSION

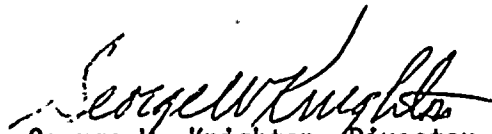

George M. Knighton, Director
Project Directorate V
Division of Reactor Projects III, IV, V
and Special Projects
Office of Nuclear Reactor Regulation

Enclosure:
Changes to the Technical
Specifications

Date of Issuance: December 24, 1987



December 24, 1987

ENCLOSURE TO LICENSE AMENDMENT NO. 49

FACILITY OPERATING LICENSE NO. NPF-21

DOCKET NO. 50-397


Replace the following pages of the Appendix "A" Technical Specifications with the enclosed pages. The revised pages are identified by Amendment number and contain vertical lines indicating the area of change.

REMOVE

6-4
6-5
6-8

INSERT

6-4
6-5
6-8




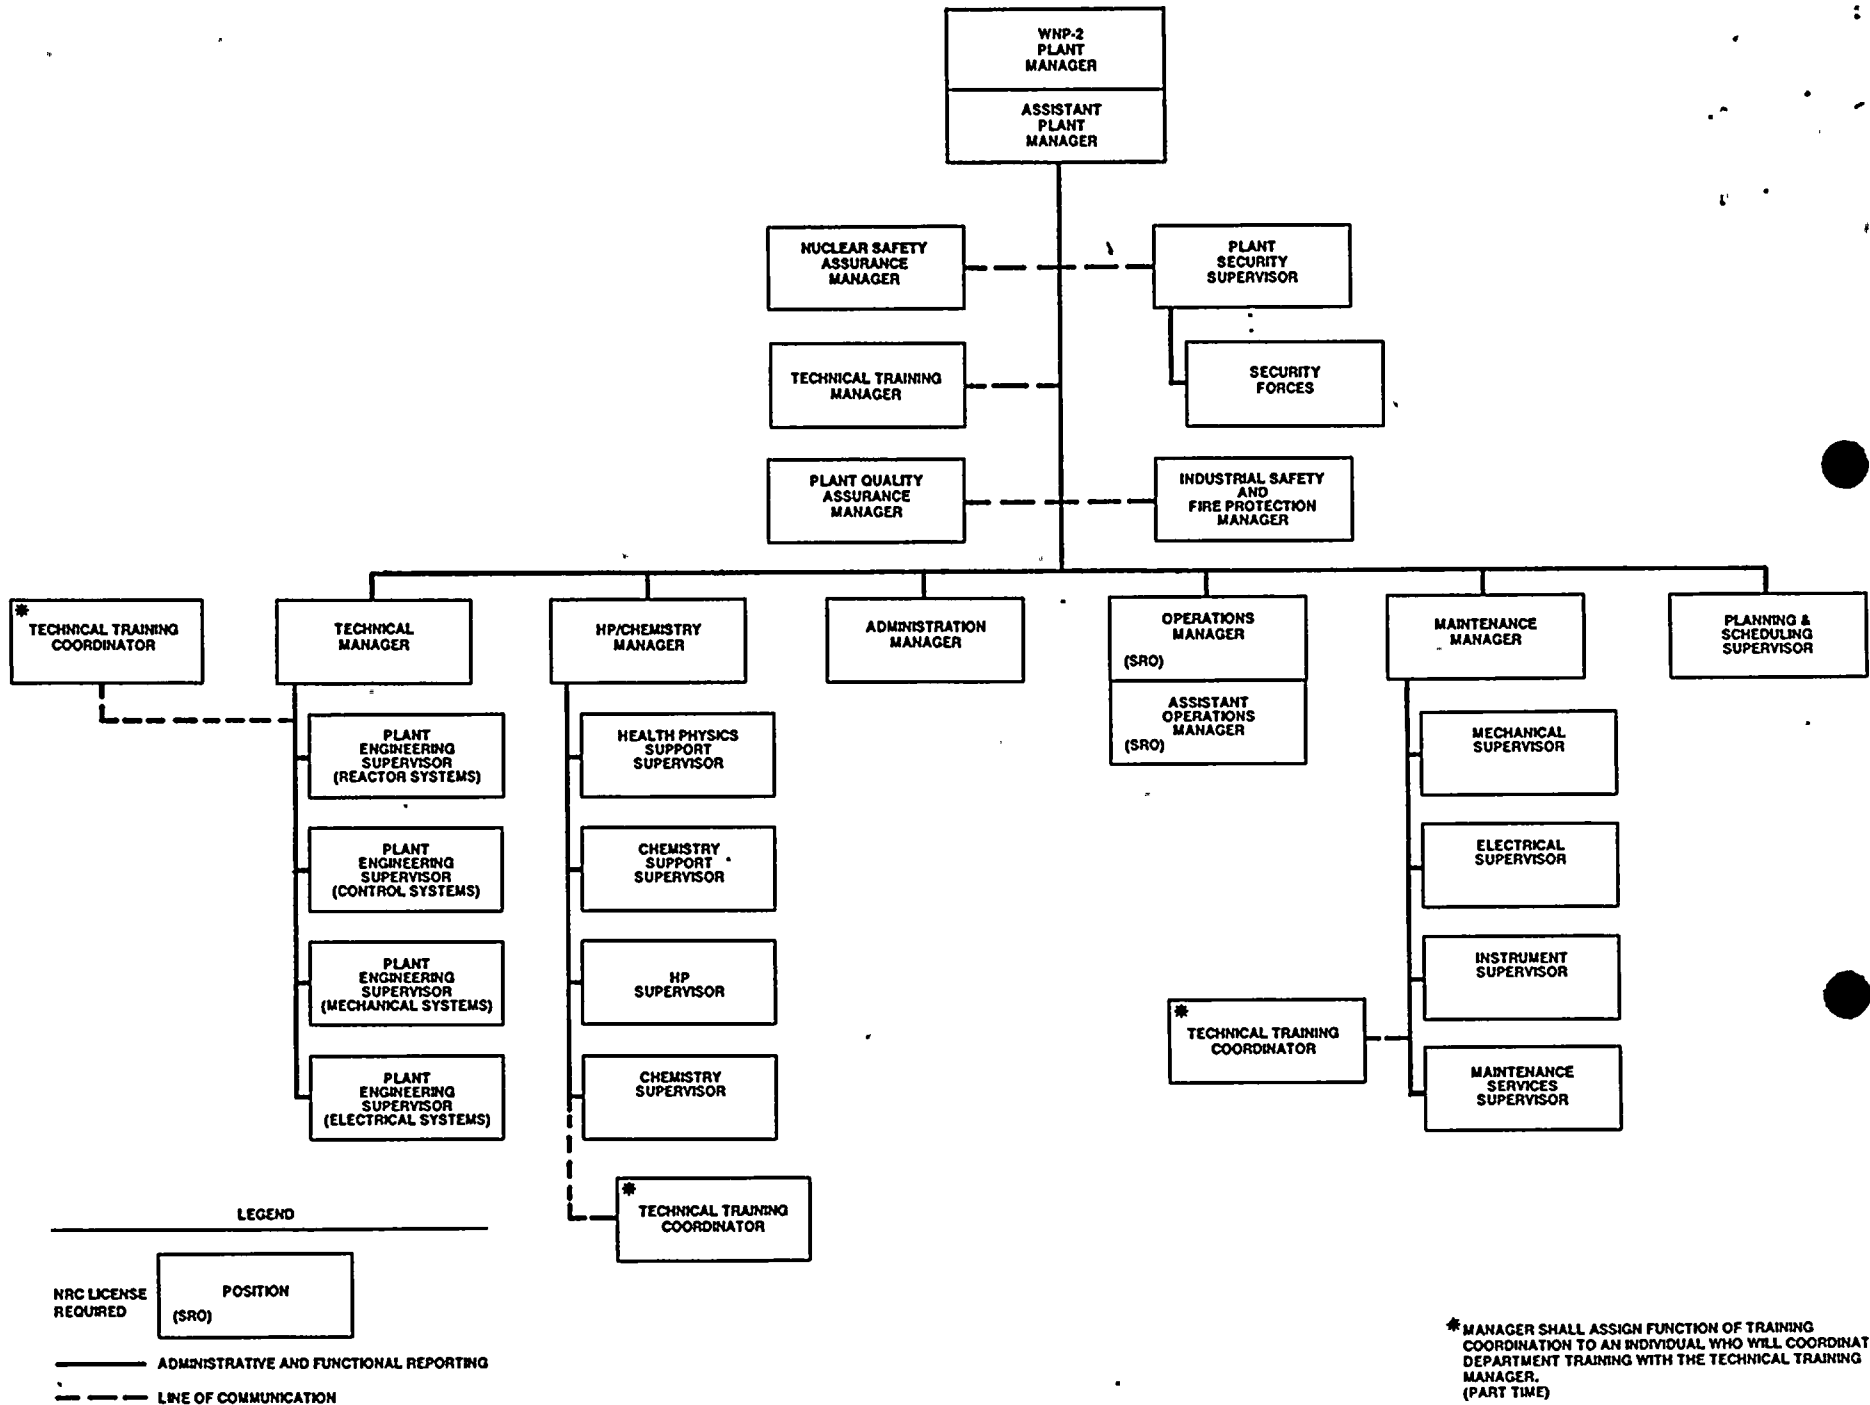


FIGURE 6.2.2-1a
UNIT ORGANIZATION

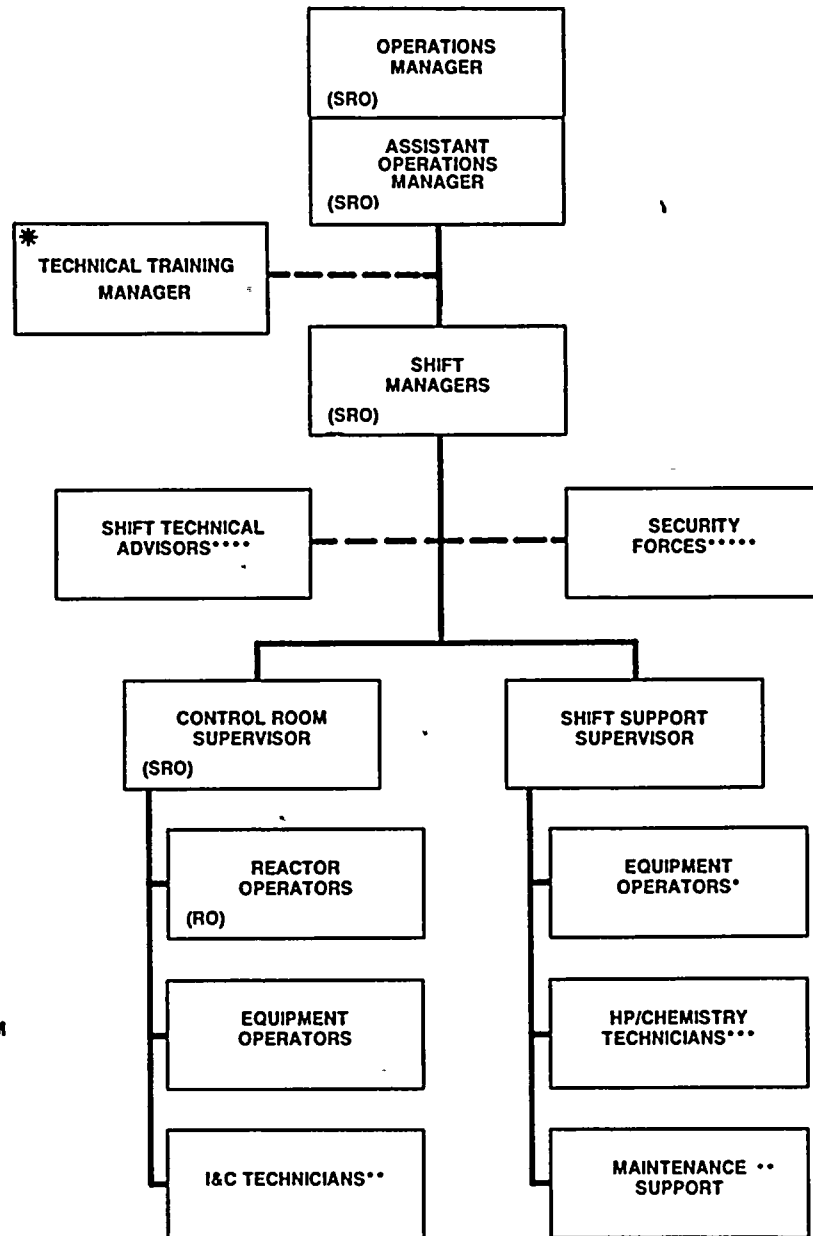

- * TO BE PROVIDED AS NEEDED FROM A POOL OF EQUIPMENT OPERATORS
- ** TO BE PROVIDED FROM MAINTENANCE DEPARTMENT
- *** TO BE PROVIDED FROM HP/CHEM DEPARTMENT
- **** TO BE PROVIDED FROM THE TECHNICAL DEPARTMENT AS REQUIRED
- ***** SEE SECURITY FOR TOTAL SECURITY FORCE STAFFING LEVEL

* MANAGER SHALL ASSIGN FUNCTION TRAINING COORDINATION TO AN INDIVIDUAL WHO WILL COORDINATE DEPARTMENT TRAINING WITH THE TECHNICAL TRAINING MANAGER (PART TIME)

LEGEND

————— FUNCTIONAL REPORTING

- - - - - LINE OF COMMUNICATION

NRC LICENSE REQUIRED	POSITION SRO/RO
----------------------	--------------------

FIGURE 6.2.2-1b
UNIT ORGANIZATION — OPERATIONS DEPARTMENT

ADMINISTRATIVE CONTROLS

6.4 TRAINING

6.4.1 A retraining and replacement training program for the unit staff shall be maintained to meet or exceed the requirements and recommendations of Section 5.5 of ANSI/ANS N18.1-1971 and Appendix A of 10 CFR Part 55 and the supplemental requirements specified in Sections A and C of Enclosure 1 of the March 28, 1980 NRC letter to all licensees, and shall include familiarization with relevant industry operational experience.

6.5 REVIEW AND AUDIT

6.5.1 PLANT OPERATIONS COMMITTEE (POC)

FUNCTION

6.5.1.1 The POC shall function to advise the Plant Manager on all matters related to nuclear safety.

COMPOSITION

6.5.1.2 The POC shall be composed of the:

Chairman:	Plant Manager
Vice Chairman:	Assistant Plant Manager
Member:	Operations Manager
Member:	Technical Manager
Member:	Maintenance Manager
Member:	Administrative Manager
Member:	Plant QA Manager
Member:	Health Physics/Chemistry Manager

ALTERNATES

6.5.1.3 All alternate members shall be appointed in writing by the POC Chairman or Vice Chairman to serve on a temporary basis.

MEETING FREQUENCY

6.5.1.4 The Plant Operations Committee shall meet at least once per calendar month and as convened by the POC Chairman or his designated alternate.

QUORUM

6.5.1.5 The quorum of the POC necessary for the performance of the POC responsibility and authority provisions of these Technical Specifications shall consist of the Chairman or Vice Chairman and four members including alternates. No more than two alternates shall make up the quorum.