


**NOTES:**

1. FOR GENERAL CONCRETE NOTES 4 & 5, CONCRETE DETAILS SEE DWG. 5743 & 5739
2. CONTRACTOR SHALL SUBMIT TO THE ENGINEER FOR APPROVAL, A DEVELOPED VIEW OF THE BIOLOGICAL SHIELD WALL INDICATING THE CONSTRUCTION JOINTS, BEAM ROCKETTS, ETC. (AND OTHER NECESSARY DETAILS) PRIOR TO SUBMISSION OF THE SHOP DWGS.
3. FOR PREPARATION OF HORIZONTAL CONSTRUCTION JOINTS SEE SPECIFICATION.
4. CONCRETE FINISH AT EXTERIOR FACE OF BIOLOGICAL SHIELD WALL SHALL BE TYPE (F-2)
5. RATE OF PLACING CONCRETE IN THE BIOLOGICAL SHIELD WALL SHALL NOT EXCEED 2'0\"/>

**TI APERTURE CARD**

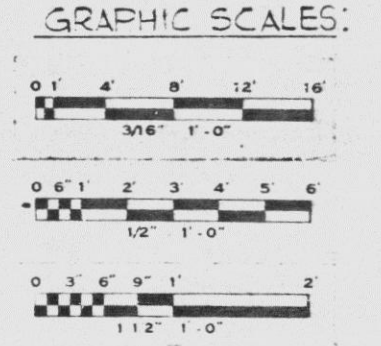

ALL WORK ON THIS DRAWING IS QUALITY CLASS I

**BURNS AND ROE, INC.**  
ENGINEERS AND CONSTRUCTORS  
ORADELL, N. J. HEMPSTEAD, N. Y. LOS ANGELES, CALIF.

**STRUCTURAL**  
REACTOR BUILDING  
BIOLOGICAL SHIELD WALL SH.1  
WASHINGTON PUBLIC POWER SUPPLY SYSTEM  
HARTFORD NO. 2

ENGINEERING REVIEW	DATE	BY	DATE

W.O. 2800  
DWG. 5741

NO.	REVISION	DATE	BY	CHKD.	APP'D.	REASON
1						
2						
3						
4						
5						

8802110222