


PROPOSED MODIFICATION

2 POSITION
(ENABLE/DISABLE)
KEYLOCK MAINTAINED
CONTACT SWITCH

EXISTING
CONTINUOUS
VALVE POSITION
INDICATION ON
SPDS

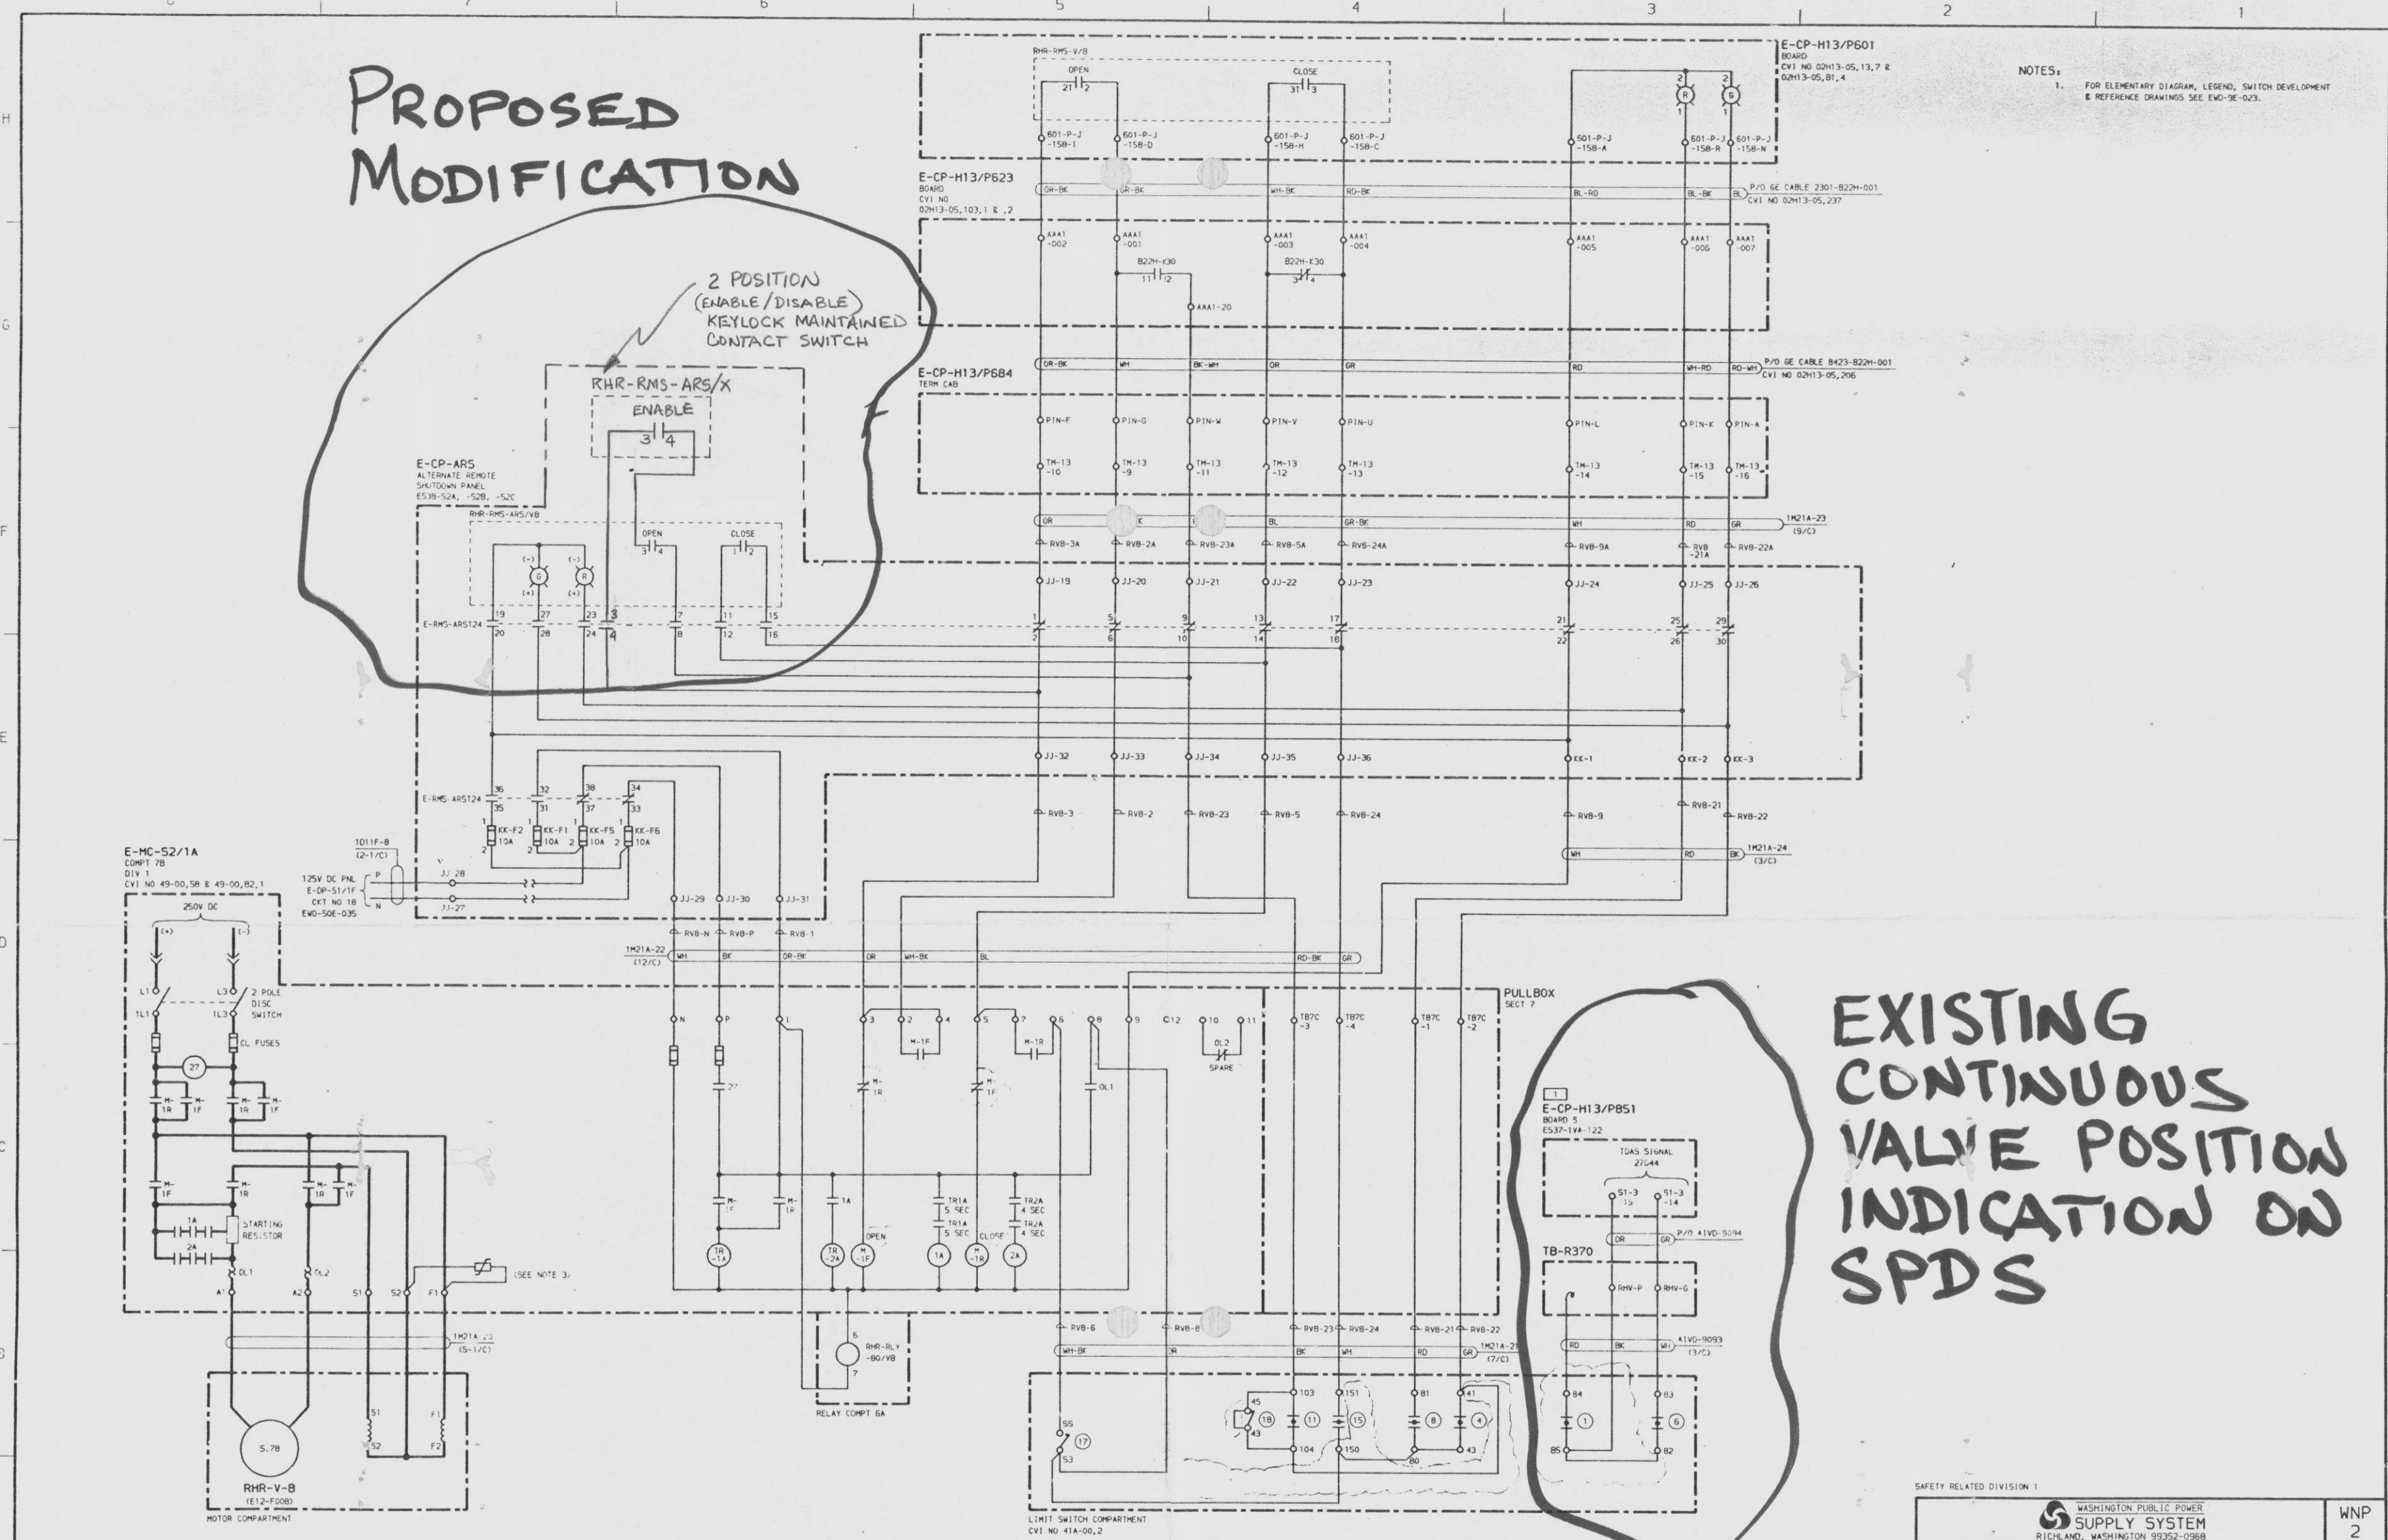

NOTES:
1. FOR ELEMENTARY DIAGRAM, LEGEND, SWITCH DEVELOPMENT & REFERENCE DRAWINGS SEE EWD-9E-023.

REV	DATE	REMARKS	DRWN	CHKD	ENGR
4	7-2-86	REDRAWN AND REVISED PER DCP 83-0050-00-385	DRJ	FRAN	EBF
5	7-21-86	REV PER DCP 84-1165-04-035	SPP	JHM	CCR
6	10-2-87	REV PER DCP 83-0050-00-029 (B/A) AND 86-0190-04-008 (A-B/3-5, C/5-6)	SR

SAFETY RELATED DIVISION 1		WASHINGTON PUBLIC POWER SUPPLY SYSTEM RICHLAND, WASHINGTON 99352-0568		WNP 2	
SIGNED	DATE	TITLE			
APPROVED	W. HOLLE	ELECTRICAL WIRING DIAGRAM			
ENGINEER	W. HOLLE	RESIDUAL HEAT REMOVAL SYSTEM			
DESIGN SUPV	EBF	MOV RHR-V-B (E12-F00B)			
CHECKED	FRAN	DRAWING # EWD-9E-024			
DRAWN	D. JACOBSEN	SCALE N/A REV. 6 SHEET OF			

MTI APERTURE CARD

TOP TIER

8802220232