

CONTROLED COPY

MCPR OPERATING LIMITS

MCPR Operating Limit
Up to 106% Core Flow

	<u>Cycle Exposure</u>	<u>Equipment Status</u>	<u>GE Fuel</u>	<u>ANF Fuel</u>
1.	0 <u>MWD</u> - <u>3750</u> <u>MWD</u> <u>MTU</u> - <u>4150</u> <u>MWD</u> <u>MTU</u>	*	<u>1.40</u> <u>1.29</u>	<u>1.28</u> <u>1.25</u>
2.	<u>3750</u> <u>MWD</u> - EOC <u>MWD</u> <u>MTU</u>	Normal scram times**	<u>1.40</u> <u>1.32</u>	<u>1.31</u> <u>1.30</u>
3.	<u>4150</u> <u>MWD</u> - EOC <u>MWD</u> <u>MTU</u>	Control rod insertion bounded by Tech. Spec. limits (3.1.3.4 - p 3/4 1-7)	<u>1.50</u> <u>1.29</u>	<u>1.38</u> <u>1.35</u>
4.	<u>3750</u> <u>MWD</u> - EOC <u>MWD</u> <u>MTU</u>	RPT inoperable Normal scram times	<u>1.50</u> <u>1.37</u>	<u>1.37</u> <u>1.35</u>
5.	<u>4150</u> <u>MWD</u> - EOC <u>MWD</u> <u>MTU</u>	RPT inoperable Control rod insertion bounded by Tech. Spec. limits (3.1.3.4 - p 3/4 1-7)	<u>1.55</u> <u>1.43</u>	<u>1.43</u> <u>1.39</u>
6.	<u>*** EOC MWD</u> <u>MTU</u>	FFTR NORMAL SCRAM TIMES	<u>1.40</u>	<u>1.34</u>

*In this portion of the fuel cycle, operation with the given MCPR operating limits is allowed for both normal and Tech. Spec. scram times and for both RPT operable and inoperable.

**These MCPR values are based on the ANF Reload Safety Analysis performed using the control rod insertion times shown below (defined as normal scram). In the event that surveillance 4.1.3.2 shows these scram insertion times have been exceeded, the plant thermal limits associated with normal scram times default to the values associated with Tech. Spec. scram times (3.1.3.4-p 3/4 1-7), and the scram insertion times must meet the requirements of Tech. Spec. 3.1.3.4.

Slowest measured average control rod insertion times to specified notches for all operable control rods for each group of 4 control rods arranged in a two-by-two array (seconds)

Position Inserted From
Fully Withdrawn

Notch 45	.404
Notch 39	.660
Notch 25	1.504
Notch 5	2.624

7. <u>EOC MWD</u> <u>MTU</u>	FFTR, CONTROL ROD INSERTION BOUNDED BY TECH. SPEC. LIMITS (3.1.3.4-P 3/4 1-7)	1.50	1.40
8. <u>*** EOC MWD</u> <u>MTU</u>	SINGLE LOOP OPERATION RPT NORMAL SCRAM TIMES	1.40	1.37


WASHINGTON NUCLEAR - UNIT 2


3/4 2-7

Amendment No. 45

*** PENDING NRC APPROVAL OF FFTR LICENSING AMENDMENT
*** PENDING NRC APPROVAL OF SINGLE LOOP LICENSING AMENDMENT

PDR
8804210079
ADOCK
05000397
DCD



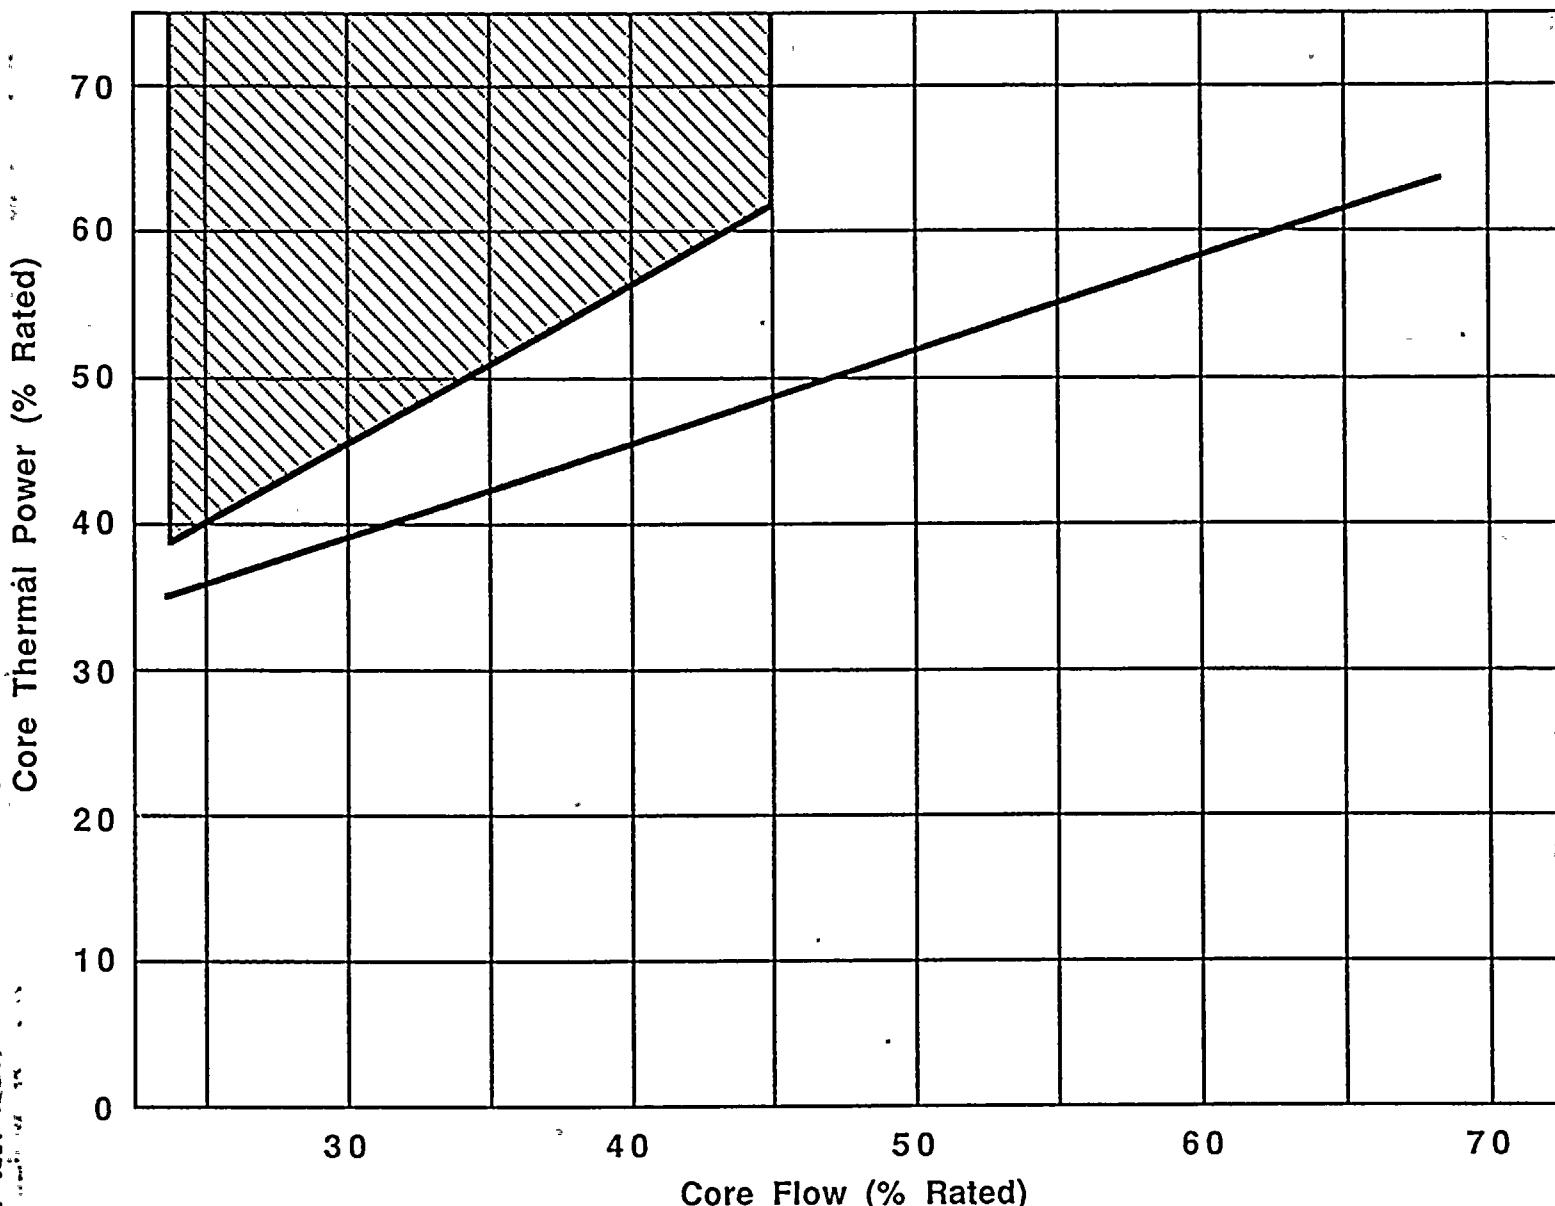

880197.5M

Thermal Power Limits of Specification 3.3.10-1
Figure 3.3.10-1

4. 5. 6.

7. 8. 9.

10.
11.

12.

13.

14.

15.

16.

17.

18. 19.

20.

21.

22.

23.

24.

25.

WNP-2 Power History (Cycle 3)

% of Rated Thermal Power

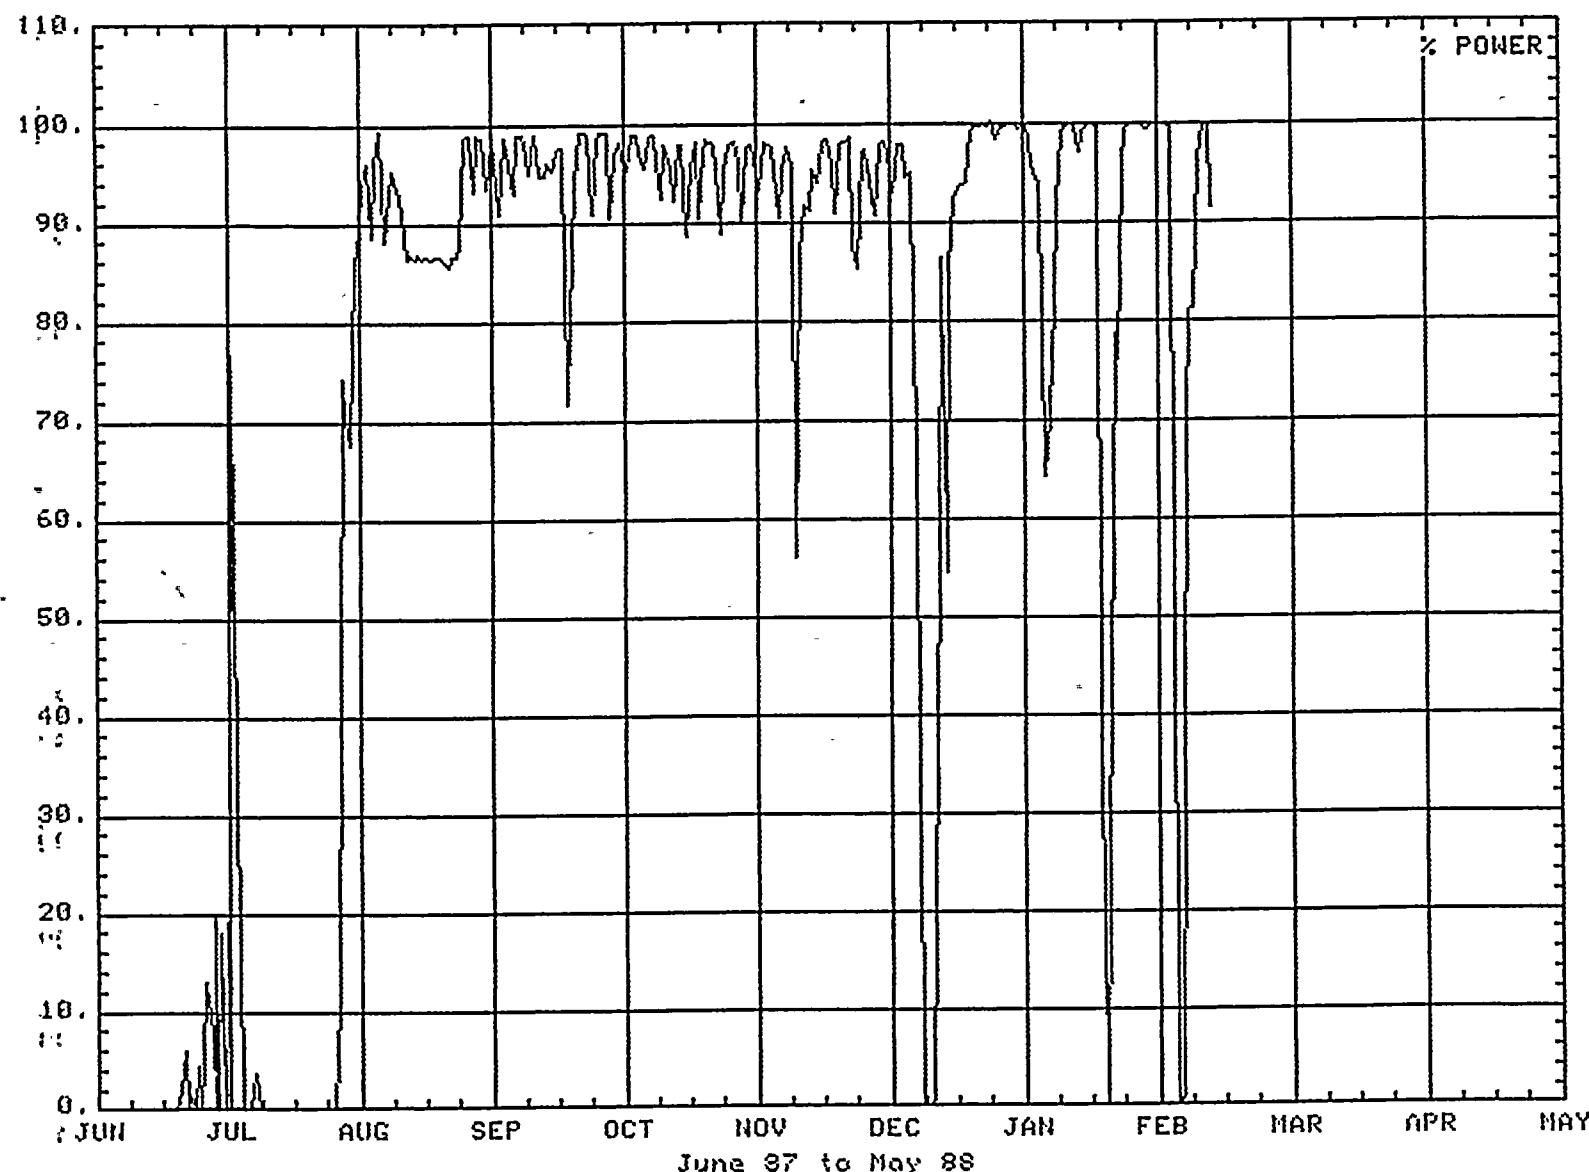


Figure 3.1 Power History For WNP-2 For Cycle 3