

TABLE 3.3.7.5-1 (Continued)
ACCIDENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>REQUIRED NUMBER OF CHANNELS</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE OPERATIONAL CONDITIONS</u>	<u>ACTION</u>
14. Neutron Flux:				
APRM	2	1	1, 2	80
IRM	2	1	1, 2	80
SRM	2	1	1, 2	80
15. RCIC Flow	1	1	1, 2	80
16. HPCS Flow	1	1	1, 2	80
17. LPCS Flow	1	1	1, 2	80
18. Standby Liquid Control System Flow	1	1	1, 2	80
19. Standby Liquid Control System Tank Level	1	1	1, 2	80
20. RIIR Flow	1/loop	1/loop	1, 2	80
21. RIIR Heat Exchanger Outlet Temperature	1/heat exchanger	1/heat exchanger	1, 2	80
22. Standby Service Water Flow	1/loop	1/loop	1, 2	80
23. Standby Service Water Spray Pond Temperature	2	1	1, 2	80
24. Post-Accident Sampling Containment Atmospheric Radiation Monitor	1	1	1, 2, 3	81
25. Emergency Ventilation Damper Position	2/duct	1/duct	1, 2	80
26. Standby Power and Other Energy Sources	2/source	1/source	1, 2	80
27. Primary Containment Valve Position	1/valve	1/line	1, 2	80
28. Primary Containment Gross Radiation Monitors#	2	1	1, 2, 3	81
29. Post-Accident Sampling Primary Coolant Radiation Monitor	1	1	1, 2, 3	81
30. Effluent Noble Gas Radiation Monitor#	1	1	1, 2, 3	81
31. Reactor Building Post LOCA Grab Sampler	1	1	1, 2, 3	81

#High range monitors.

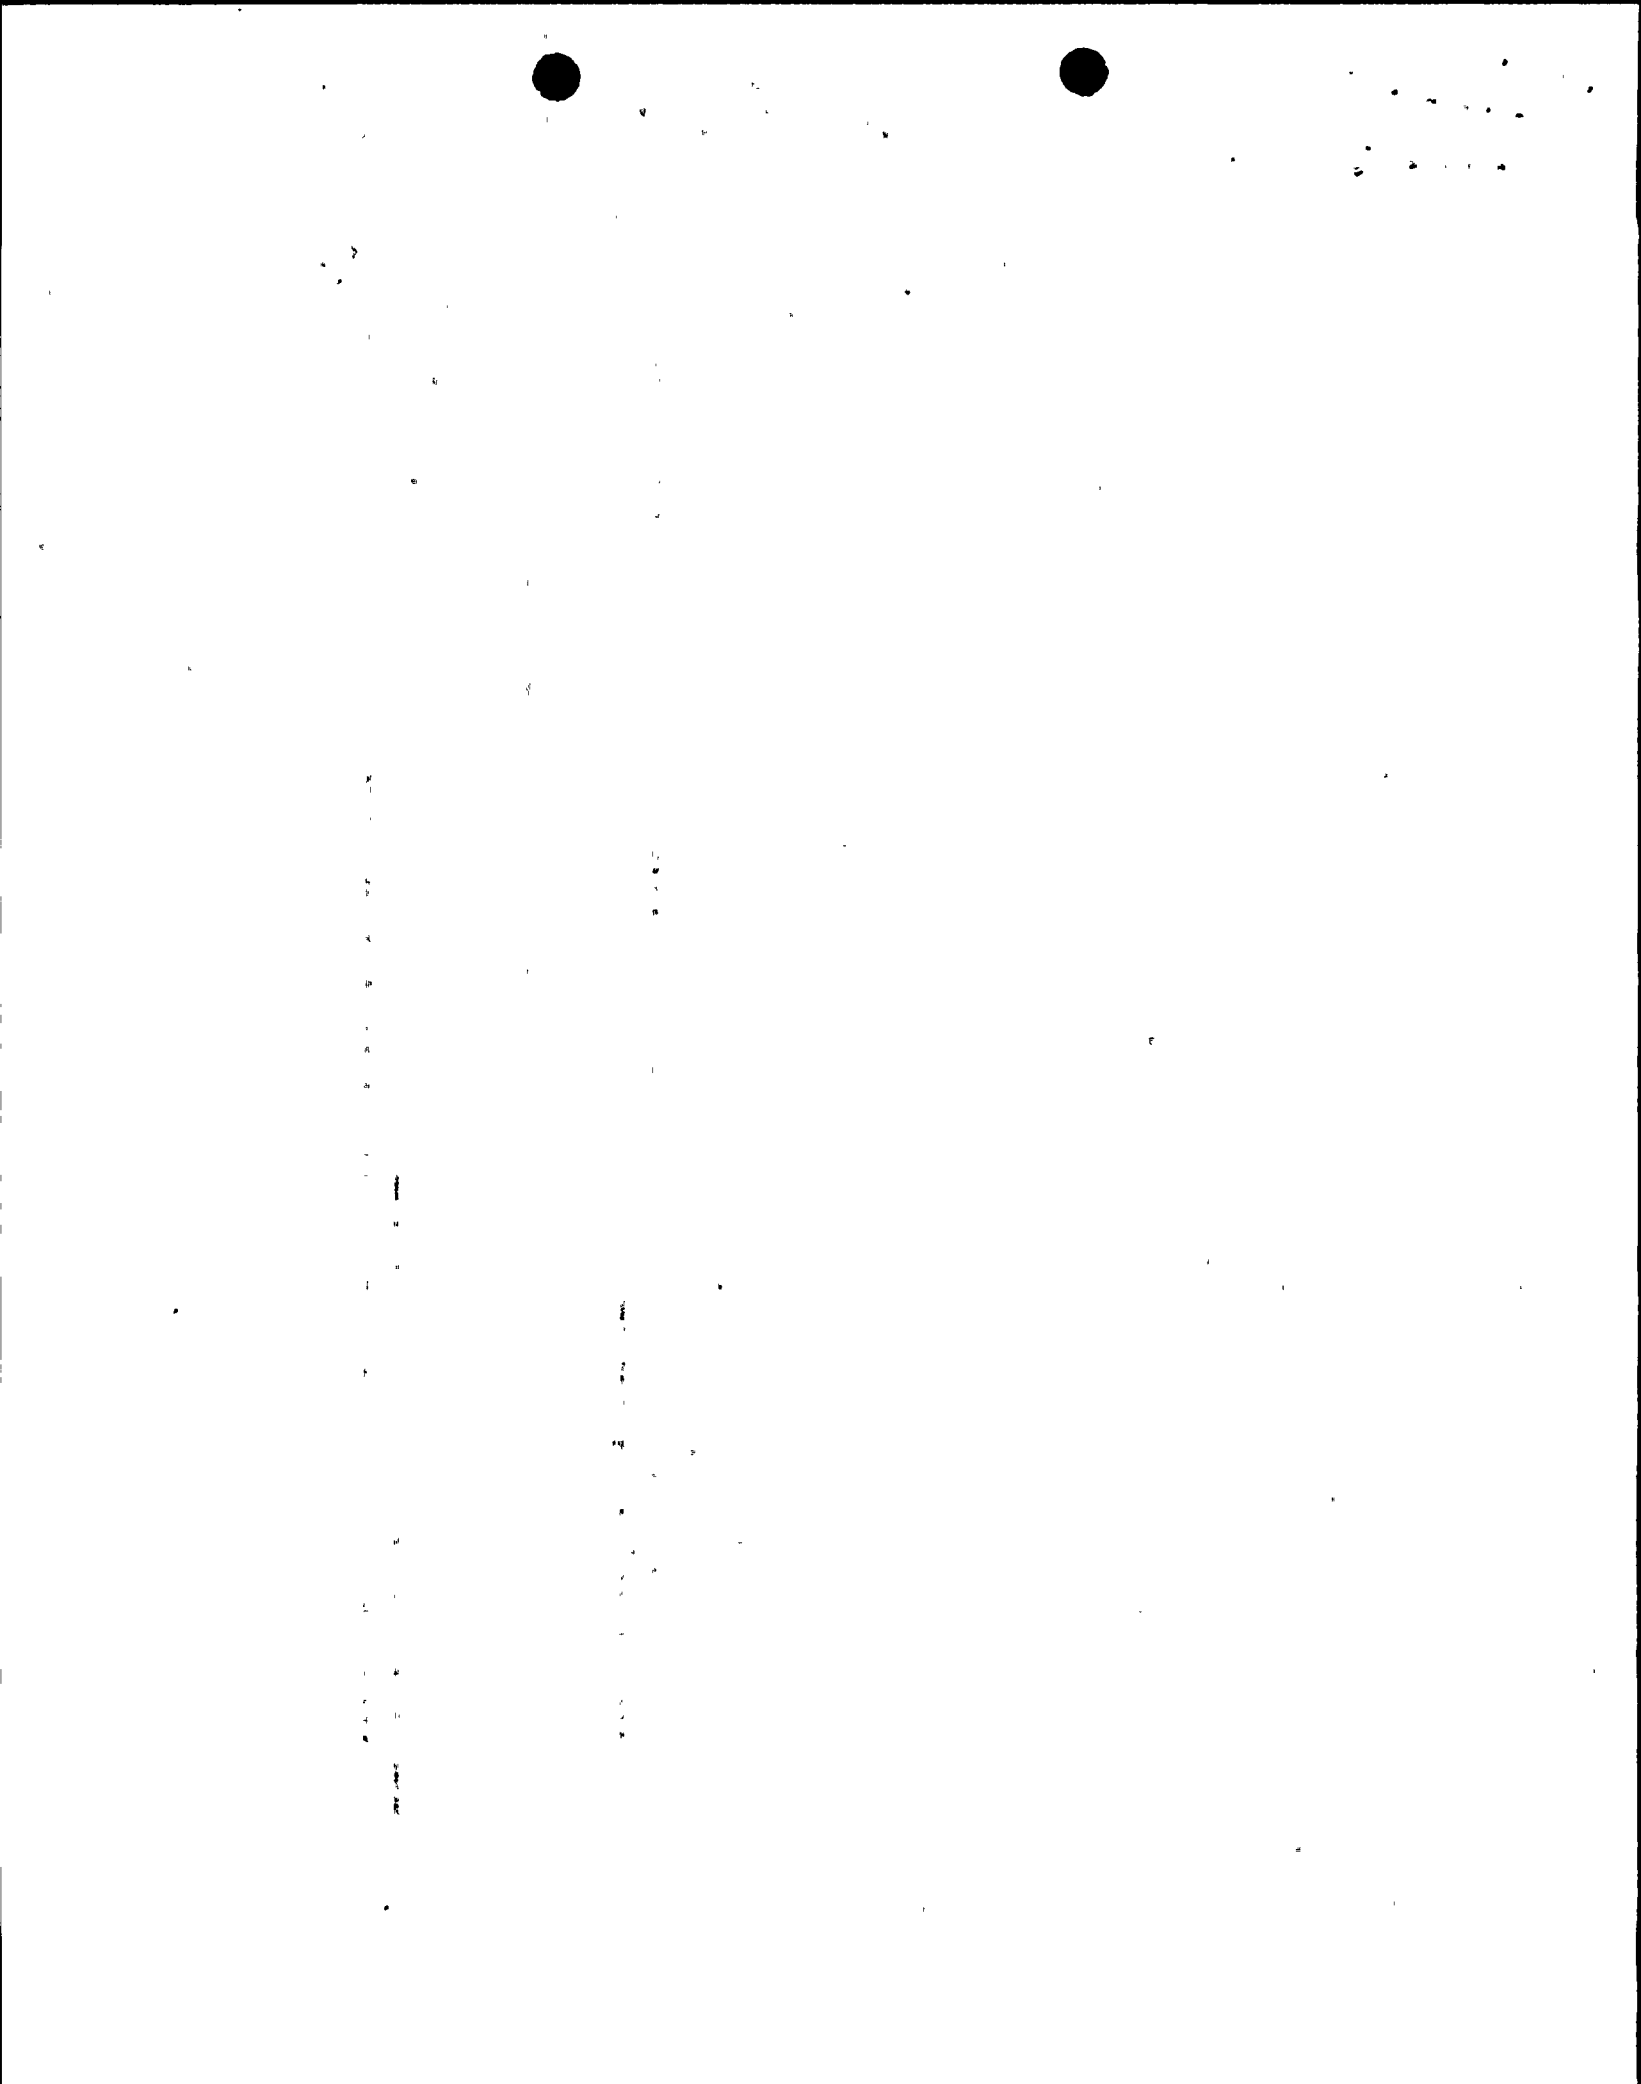


TABLE 4.3.7.5-1 (Continued)

ACCIDENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>APPLICABLE OPERATIONAL CONDITIONS</u>
18. Standby Liquid Control System Flow	M	R	1, 2
19. Standby Liquid Control System Tank Level	M	R	1, 2
20. RHR Flow	M	R	1, 2
21. RHR Heat Exchanger Outlet Temperature	M	R	1, 2
22. Standby Service Water Flow	M	R	1, 2
23. Standby Service Water Spray Pond Temperature	M	R	1, 2
24. Post Accident Sampling Containment Atmosphere Radiation Monitor	M	R	1, 2, 3
25. Emergency Ventilation Damper Position	M	R	1, 2
26. Standby Power and Other Energy Sources	M	R	1, 2
27. Primary Containment Valve Position	M	R	1, 2
28. Primary Containment Gross Radiation Monitors	M	R*	1, 2, 3
29. Post Accident Sampling Primary Coolant Radiation Monitor	M	R	1, 2, 3
30. Effluent Noble Gas Radiation Monitor#	M	R	1, 2, 3
31. Reactor Building Post LOCA Grab Sampler	M	R	1, 2, 3

TABLE NOTATION

*CHANNEL CALIBRATION shall consist of an electronic calibration of the channel, not including the detector, for range decades above 10 R/h and a one point calibration check of the detector below 10 R/h with an installed or portable gamma source.

WASHINGTON NUCLEAR - UNIT 2

3/4 3-75

Amendment No. 37

CONTROLLED COPY

