

April 25, 1990

Docket No. 50-397

Mr. G. C. Sorensen, Manager
Regulatory Programs
Washington Public Power Supply System
P.O. Box 968
3000 George Washington Way
Richland, Washington 99352

DISTRIBUTION
Docket File
NRC & Local PDRs
PD5 Reading
J. Zwolinski
P. Shea
R. Samworth
GPA/PA
OGC (for info only)
D. Hagan

E. Jordan
JRHall
G. Hill (4)
Wanda Jones
E. Butcher
ACRS (10)
ARM/LFMB
Region V (4)
G. West

Dear Mr. Sorensen:

SUBJECT: RESPONSE TO NRC GENERIC LETTER 89-06 ON THE SAFETY PARAMETER
DISPLAY SYSTEM FOR WNP-2 (MPA F-072, TAC NO. 73725)

Generic Letter (GL) 89-06, dated April 12, 1989, requested you to provide certification regarding the implementation of a safety parameter display system (SPDS) at your facility. The GL and its attachment, NUREG-1342, provided clarification of the requirements for an acceptable SPDS as originally defined in NUREG-0737, Supplement 1, issued in January 1983. The GL further requested you to complete a checklist and take photographs of your SPDS and to retain these records for three years from the date of certification.

On July 24, 1989, WPPSS certified that the SPDS at WNP-2 fully meets the requirements of NUREG-0737, Supplement 1, taking into account the information provided in NUREG-1342. Based on this certification, the NRC staff concludes that your facility has satisfactorily met all the requirements for a SPDS specified in NUREG-0737, Supplement 1. Therefore, the staff review and license implementation of the SPDS are considered complete for your facility

By copy of this memorandum, Region 5 is advised of your position on this matter.

Sincerely,

original signed by Robert B. Samworth
Robert B. Samworth, Senior Project Manager
Project Directorate V
Division of Reactor Projects - III,
IV, V and Special Projects
Office of Nuclear Reactor Regulation


cc: See next page

*See previous concurrence

DRSP/PD5* DRSP/PD5* (A)DRSP/D:PD5*
PShea RSamworth:sg JLarkins
4/23/90 4/24/90 4/24/90

9004300215 900425
PDR ADOCK 05000397
P PDC

DF01
1/0
m/A-4
cut

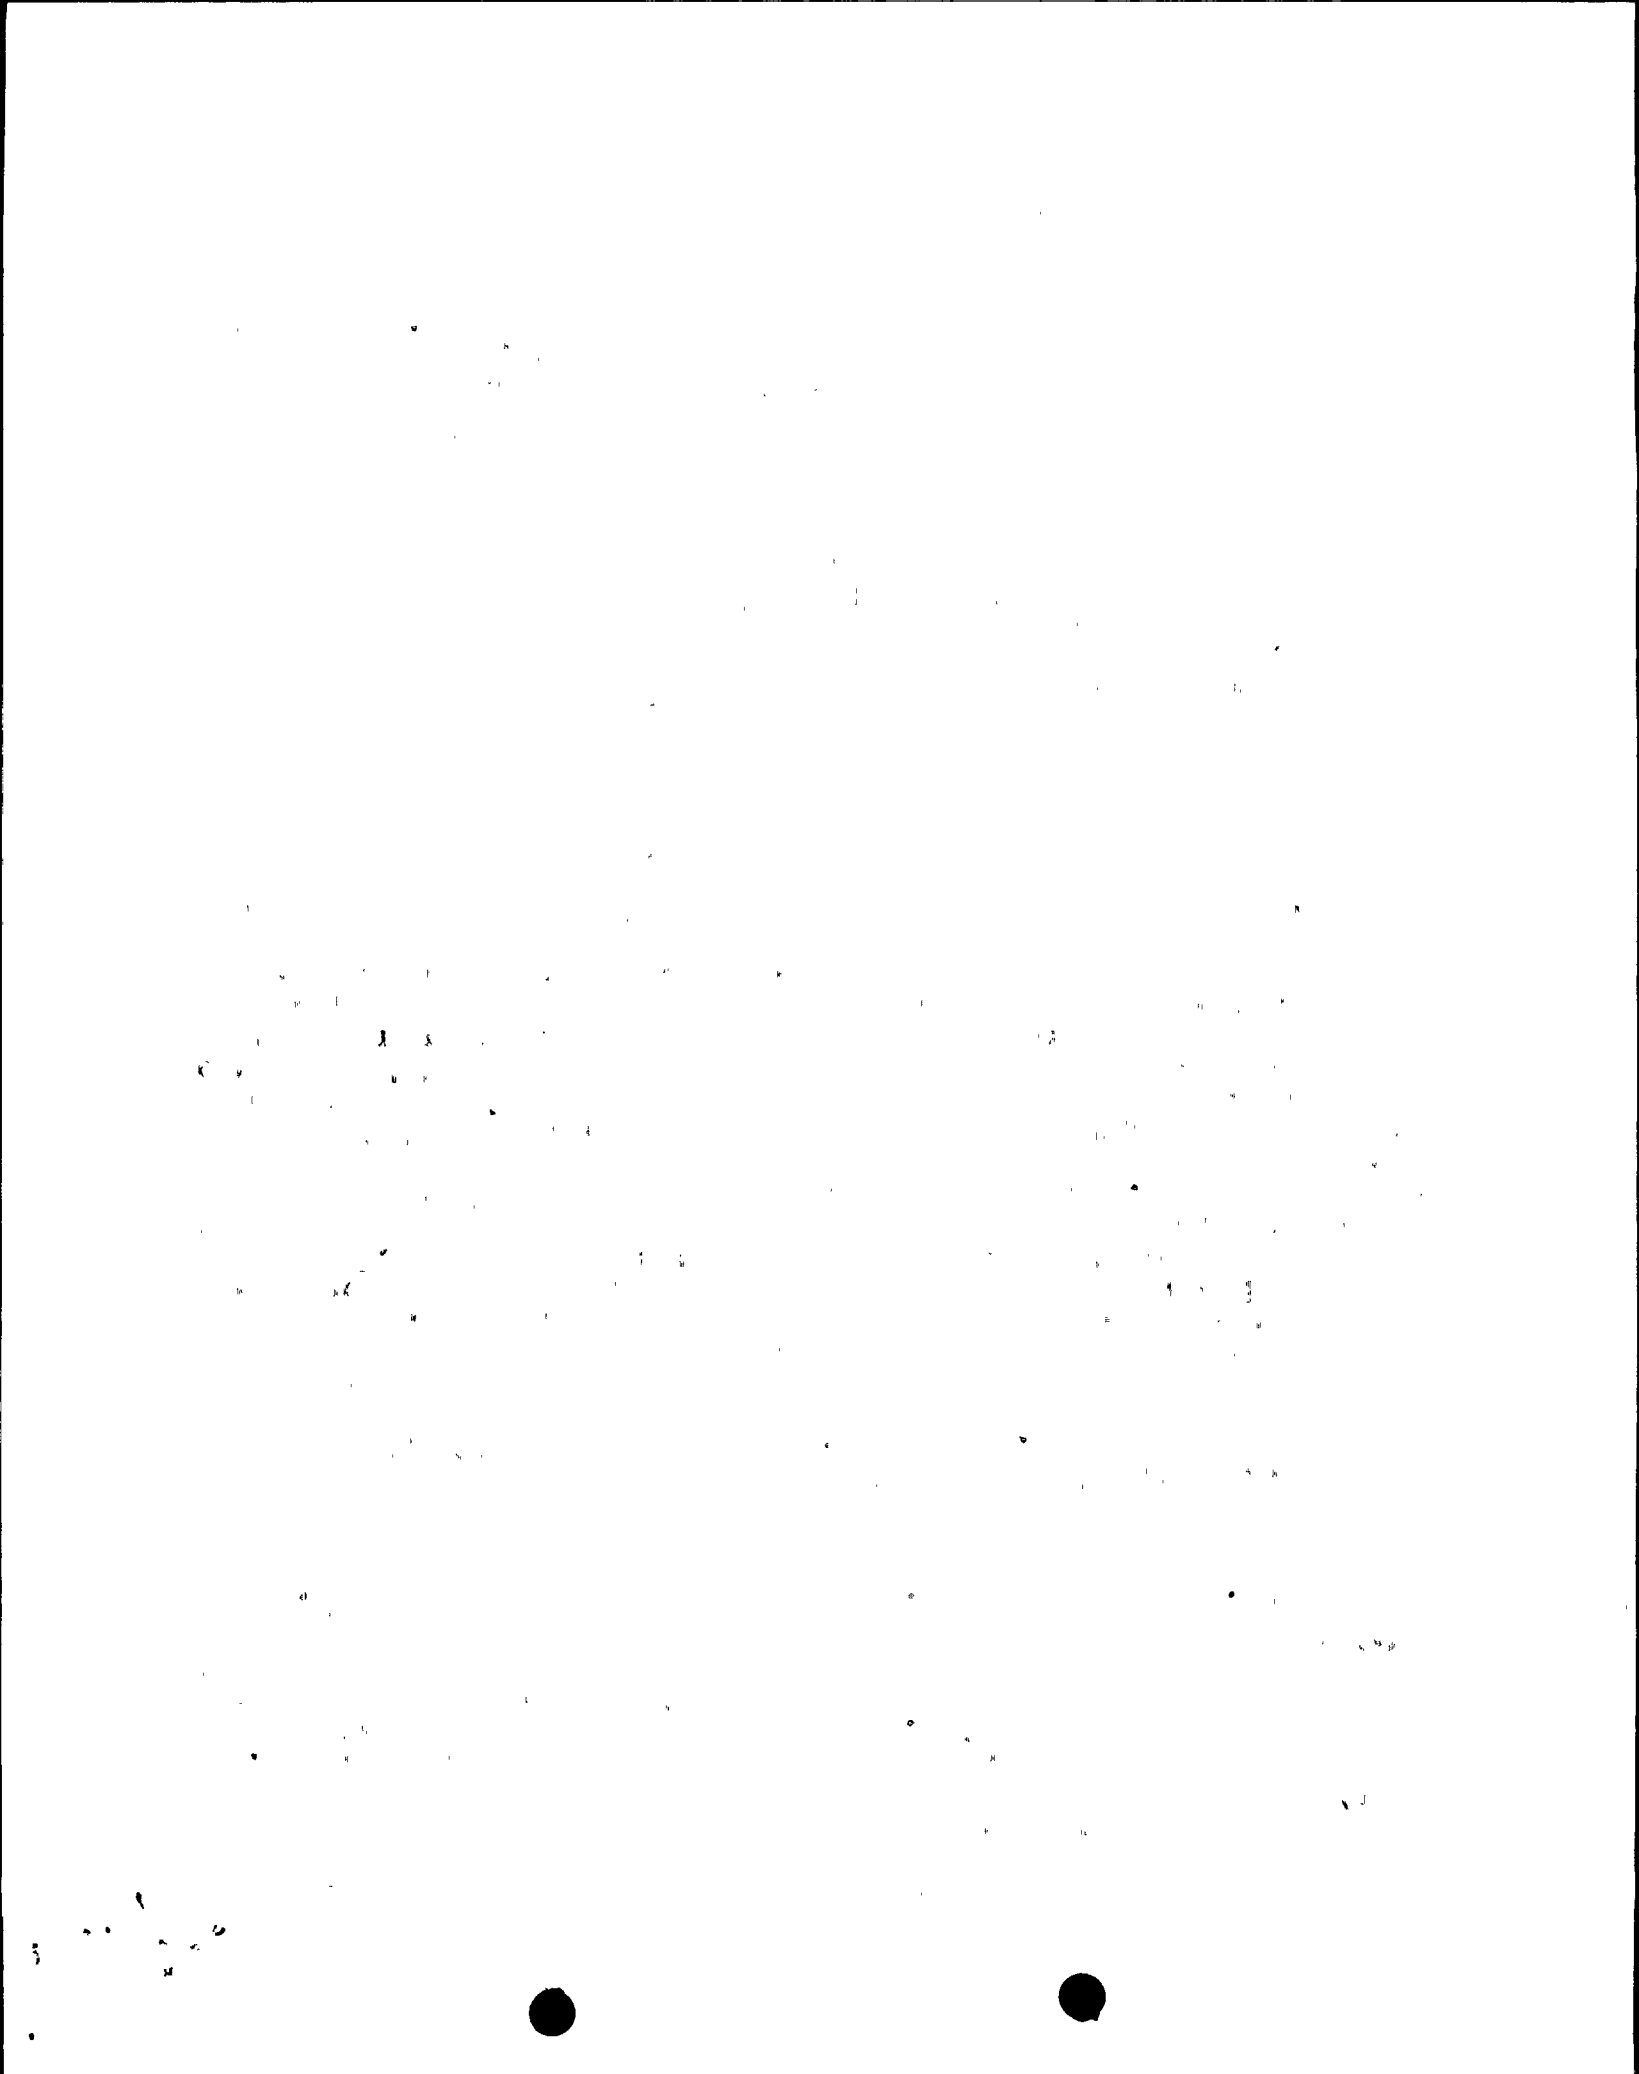



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

April 25, 1990

Docket No. 50-397

Mr. G. C. Sorensen, Manager
Regulatory Programs
Washington Public Power Supply System
P.O. Box 968
3000 George Washington Way
Richland, Washington 99352

Dear Mr. Sorensen:

SUBJECT: RESPONSE TO NRC GENERIC LETTER 89-06 ON THE SAFETY PARAMETER
DISPLAY SYSTEM FOR WNP-2 (MPA F-072, TAC NO. 73725)

Generic Letter (GL) 89-06, dated April 12, 1989, requested you to provide certification regarding the implementation of a safety parameter display system (SPDS) at your facility. The GL and its attachment, NUREG-1342, provided clarification of the requirements for an acceptable SPDS as originally defined in NUREG-0737, Supplement 1, issued in January 1983. The GL further requested you to complete a checklist and take photographs of your SPDS and to retain these records for three years from the date of certification.

On July 24, 1989, WPPSS certified that the SPDS at WNP-2 fully meets the requirements of NUREG-0737, Supplement 1, taking into account the information provided in NUREG-1342. Based on this certification, the NRC staff concludes that your facility has satisfactorily met all the requirements for a SPDS specified in NUREG-0737, Supplement 1. Therefore, the staff review and license implementation of the SPDS are considered complete for your facility.

By copy of this memorandum, Region 5 is advised of your position on this matter.

Sincerely,

A handwritten signature in cursive script that reads "Robert B. Samworth".

Robert B. Samworth, Senior Project Manager
Project Directorate V
Division of Reactor Projects - III,
IV, V and Special Projects
Office of Nuclear Reactor Regulation

cc: See next page



Mr. G. C. Sorensen

WPPSS Nuclear Project No. 2
(WNP-2)

cc:

Mr. C. M. Powers
WNP-2 Plant Manager
Washington Public Power Supply System
P.O. Box 968, MD 927M
Richland, Washington 99352

Regional Administrator, Region V
U.S. Nuclear Regulatory Commission
1450 Maria Lane, Suite 210
Walnut Creek, California 94596

Mr. G. E. Doupe, Esquire
Washington Public Power Supply System
P. O. Box 968
3000 George Washington Way
Richland, Washington 99532

Chairman
Benton County Board of Commissioners
Prosser, Washington 99350

Mr. Curtis Eschels, Chairman
Energy Facility Site Evaluation Council
Mail Stop PY-11
Olympia, Washington 98504

Mr. Christian Bosted
U. S. Nuclear Regulatory Commission
P. O. Box 69
Richland, Washington 99352

Mr. Alan G. Hosler, Licensing Manager
Washington Public Power Supply System
P. O. Box 968, MD 956B
Richland, Washington 99352

Nicholas S. Reynolds, Esq.
Bishop, Cook, Purcell
& Reynolds
1400 L Street NW
Washington, D.C. 20005-3502

Mr. A. Lee Oxsen
Assistant Managing Director for Operations
Washington Public Power Supply System
P. O. Box 968, MD 1023
Richland, Washington 99352

Mr. Gary D. Bouchey, Director
Licensing and Assurance
Washington Public Power Supply System
P. O. Box 968, MD 280
Richland, Washington 99352

(10)