

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9103070007    DOC. DATE: 91/02/28    NOTARIZED: YES    DOCKET #  
 FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe    05000397  
 AUTH. NAME    AUTHOR AFFILIATION  
 SORENSEN, G.C.    Washington Public Power Supply System  
 RECIPIENT AFFILIATION  
 MARTIN, J.B.    Region 5 (Post 820201)

SUBJECT: Confirms that util issued Technical Assessment 90-015,  
 "Safety Sys Functional Insp, Svc Water," in Dec 1990, per  
 Generic Ltr 89-13 re svc water sys. problems affecting  
 safety-related equipment.

DISTRIBUTION CODE: A065D    COPIES RECEIVED: LTR 1 ENCL 1    SIZE: 2+18  
 TITLE: Generic Ltr 89-13 - Svc Water Sys Problems Affecting Safety-Related E

NOTES:

	RECIPIENT		COPIES		RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL	ID CODE/NAME		LTTR	ENCL
	ENG, P.L.		1	1				
INTERNAL:	CHU, A NRR/PD1-3		1	1	<u>REG FILE</u>		1	1
EXTERNAL:	NRC PDR		1	1	NSIC		1	1


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 5 ENCL 5

*m/1A-4*

R  
I  
D  
S  
/  
A  
D  
D  
S

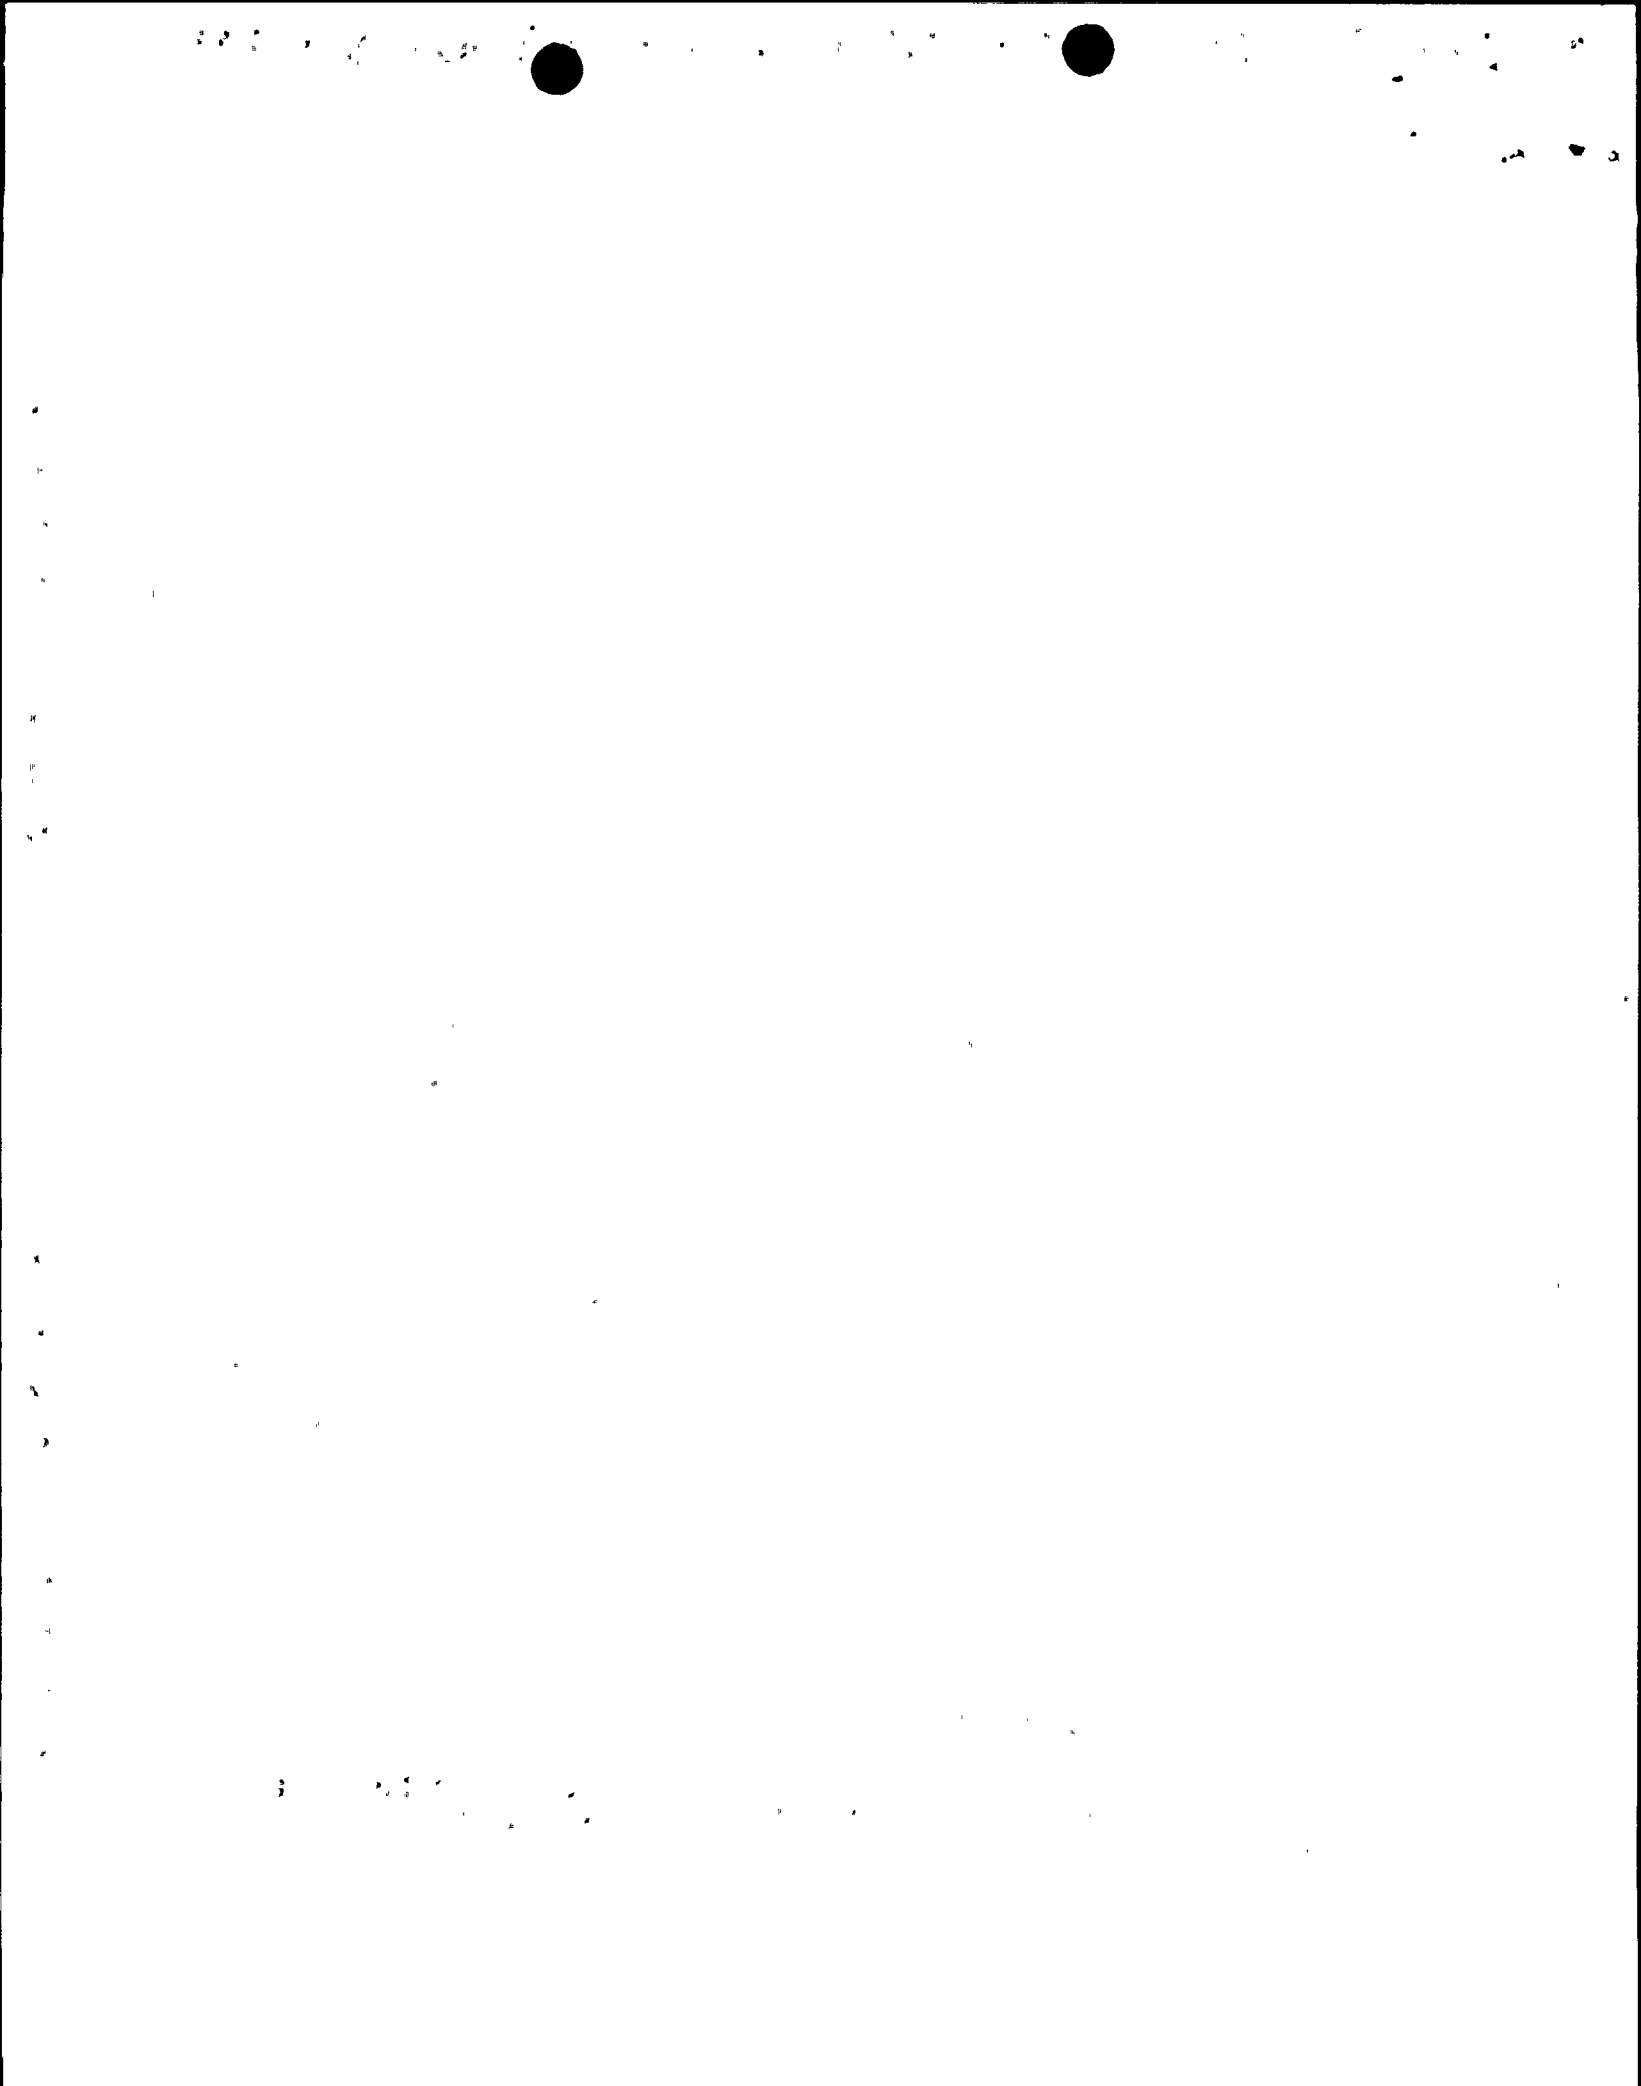



WASHINGTON PUBLIC POWER SUPPLY SYSTEM

P.O. Box 968 • 3000 George Washington Way • Richland, Washington 99352

February 28, 1991  
G02-91-041

Docket No. 50-397

J. B. Martin  
U.S. Nuclear Regulatory Commission  
Region V  
1450 Maria Lane, Suite 210  
Walnut Creek, CA 94596

Dear Mr. Martin:

Subject: NUCLEAR PLANT NO. 2, OPERATING LICENSE NPF-21  
RESPONSE TO GENERIC LETTER 89-13; SERVICE WATER SYSTEM PROBLEMS  
AFFECTING SAFETY RELATED EQUIPMENT

Reference: Letter, G02-90-017, GC Sorensen (SS) to NRC Region V,  
same subject, dated February 5, 1990

In the reference letter, the-Supply System advised the NRC that we would include the confirmation of item IV of Generic Letter 89-13 (i.e., that the Service Water System will perform its intended function in accordance with the licensing basis of the plant) as part of a Safety System Functional Inspection (SSFI) on the entire service water system. The Supply System committed to provide confirmation of the completion of this activity by February 1991. The purpose of this letter is to provide such confirmation.

In December, 1990 the Supply System issued Technical Assessment 90-015, "Safety System Functional Inspection, Service Water". As required by Generic Letter 89-13, a complete system walkdown inspection was performed as part of the SSFI. The timing of this walkdown satisfies the "within the past 2 years" requirement of the generic letter. The ability to perform required safety functions in the event of failure of a single active component is satisfied by having two totally redundant systems. The overall result of the SSFI with the walkdown was to confirm that the service water system will perform its intended functions in accordance with the licensing basis for the plant.

This completes the Supply System's response to Generic Letter 89-13.

Very truly yours,


G. C. Sorensen, Manager  
Regulatory Programs

cc: JB Martin - NRC RV  
NS Reynolds - Winston & Strawn  
PL Eng - NRC

DL Williams - BPA/399  
NRC Site Inspector - 901A

9103070007 910228  
PDR ADOCK 05000397  
P PDR

AD65  
11

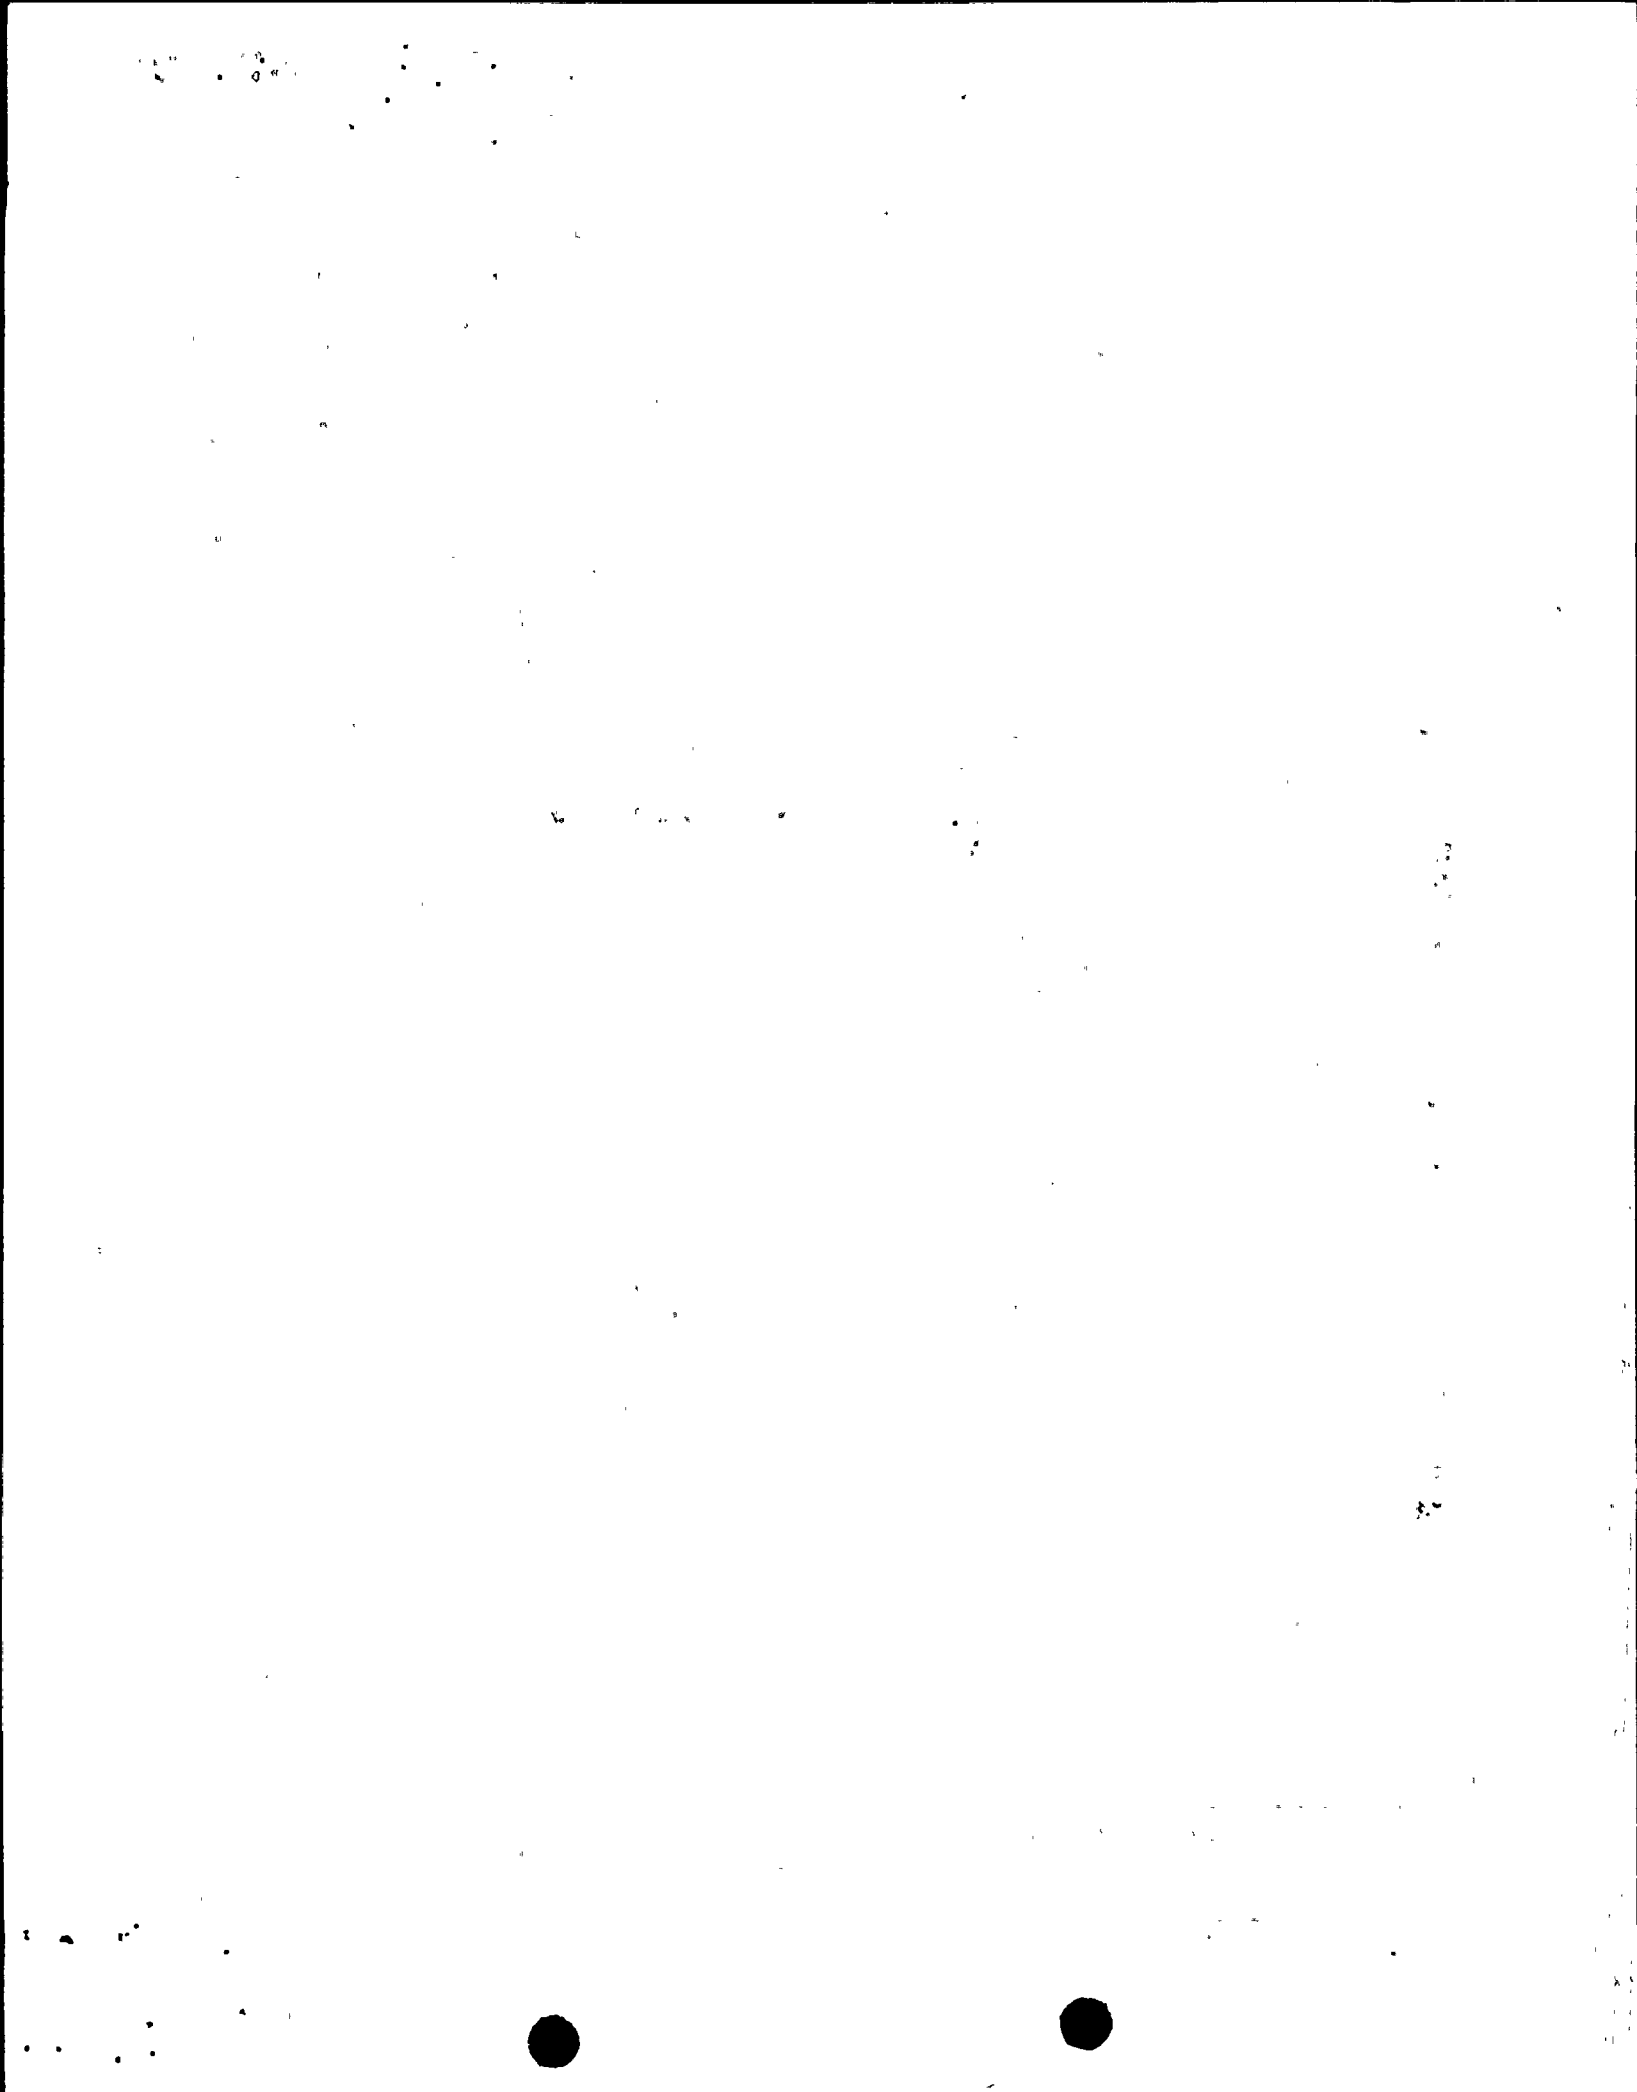

STATE OF WASHINGTON )  
COUNTY OF BENTON )

Subject: Response to GH 89-13 service  
water system problems affecting  
safety Related Equipment

I, G. C. SORENSEN, being duly sworn, subscribe to and say that I am the Manager, Regulatory Programs, for the WASHINGTON PUBLIC POWER SUPPLY SYSTEM, the applicant herein; that I have full authority to execute this oath; that I have reviewed the foregoing; and that to the best of my knowledge, information, and belief the statements made in it are true.

DATE: 28 FEB, 1991

G. C. Sorensen  
G. C. Sorensen, Manager  
Regulatory Programs

On this date personally appeared before me G. C. SORENSEN, to me known to be the individual who executed the foregoing instrument, and acknowledged that he signed the same as his free act and deed for the uses and purposes herein mentioned.

GIVEN under my hand and seal this 28th day of February 1991.

Notary Public in and for the  
STATE OF WASHINGTON

Residing at Kennewick, WA

My Commission Expires 4/28/94

