## WASHINGTON PUBLIC POWER SUPPLY SYSTEM V

P.O. Box 968 • 3000 George Washington Way • Richland, Wolshington 69352 10: 27

January 31, 1992 602-92-031

Docket No. 50-397

U.S. Nuclear Regulatory Commission Attn: Document Control Desk

Washington, D.C. 20555

Gentlemen:

Subject:

NUCLEAR PLANT NO. 2, OPERATING LICENSE NPF-21

RESPONSE TO INSPECTION REPORT 91-41

Reference:

Letter. DF Kirsch (NRC) to GC Sorensen (SS),

"NRC Inspection of WNP-2 (IR 91-41)", dated December 16, 1991

In the reference letter, the NRC indicated that fire brigade personnel at WNP-2 received stress tests. This letter is to inform the NRC that the Supply System does not require routine stress tests for any personnel. In discussions with Mr. W. Wagner, NRC Region V, it was explained that we believe this is acceptable as the Supply System's examination process provides for stress tests to be performed on fire brigade personnel if the examining physician deems it necessary to ensure the job function can be performed.

Very truly yours,

G. C. Sorensen, Manager Regulatory Programs

REF/bk

cc: JB Martin - NRC RV

NS Reynolds - Winston & Strawn

PL Eng - NRC

DL Williams - BPA/399

NRC Site Inspector - 901A

-92021-0007-1

ŧ

## ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

91-41 REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS) ACCESSION NBR:9202100071 DOC.DATE: 92/01/31 NOTARIZED: NO DOCKET # FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe 05000397 AUTH. NAME AUTHOR AFFILIATION SORENSEN, G.C. Washington Public Power Supply System RECIP.NAME RECIPIENT AFFILIATION Document Control Branch (Document Control Desk) R SUBJECT: Informs NRC that Supply Sys does not require routine stress Ĭ tests for any personnel. Exam process provides for stress tests to be performed on fire brigade personnel. D DISTRIBUTION CODE: IE01D COPIES RECEIVED:LTR ( ENCL  $\mathcal O$  SIZE: S TITLE: General (50 Dkt)-Insp Rept/Notice of Violation Response NOTES: RECIPIENT Α COPIES RECIPIENT . COPIES ID CODE/NAME LTTR ENCL ID CODE/NAME · LTTR ENCL .PD5 ·PD D ENG, P.L. INTERNAL: ACRS 2 **AEOD** D AEOD/DEIIB 1 AEOD/DSP/TPAB **DEDRO** 1 NRR HARBUCK, C. S NRR MORISSEAU, D NRR/DLPQ/LHFBPT NRR/DLPQ/LPEB10 NRR/DOEA/OEAB NRR/DREP/PEPB9H 1 NRR/DST/DIR 8E2 NRR/PMAS/ILRB12 1 NUDOCS-ABSTRACT OE\_DIR 1 OGC/HDS1 1 REG FILE 02 1 RGN5 FILE 01

NRC PDR

1

NOTE TO ALL "RIDS" RECIPIENTS:

EXTERNAL: EG&G/BRYCE, J.H.

NSIC

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK, ROOM PI-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 24 ENCL

1


R I D

S

Á

D

D

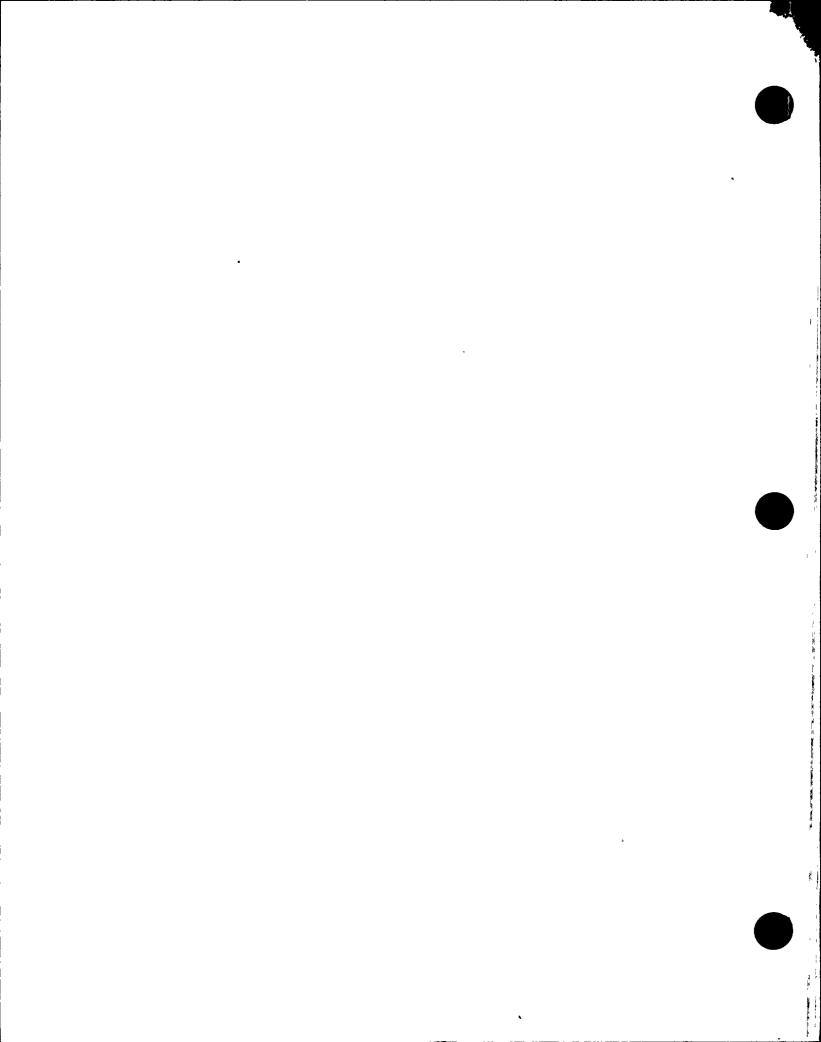

## WASHINGTON PUBLIC POWER SUPPLY SYSTEM

P.O. Box 968 • 3000 George Washington Way • Richland, Washington 99352

January 31, 1992 G02-92-031

Docket No. 50-397

U.S. Nuclear Regulatory Commission

Attn: Document Control Desk

Washington, D.C. 20555

Gentlemen:

· Subject:

NUCLEAR PLANT NO. 2, OPERATING LICENSE NPF-21

RESPONSE TO INSPECTION REPORT 91-41

Reference:

Letter. DF Kirsch (NRC) to GC Sorensen (SS),

"NRC Inspection of WNP-2 (IR 91-41)", dated December 16, 1991

In the reference letter, the NRC indicated that fire brigade personnel at WNP-2 received stress tests. This letter is to inform the NRC that the Supply System does not require routine stress tests for any personnel. In discussions with Mr. W. Wagner, NRC Region V, it was explained that we believe this is acceptable as the Supply System's examination process provides for stress tests to be performed on fire brigade personnel if the examining physician deems it necessary to ensure the job function can be performed.

Very truly yours,

G. C. Sorensen, Manager

Regulatory Programs

REF/bk

cc:

JB Martin - NRC RV

NS Reynolds - Winston & Strawn

PL Eng - NRC DL Williams - BPA/399 NRC Site Inspector - 901A

