

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9204290046 DOC. DATE: 92/04/23 NOTARIZED: NO DOCKET #  
 FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe 05000397  
 AUTH. NAME AUTHOR AFFILIATION  
 SORENSEN, G.C. Washington Public Power Supply System  
 RECIP. NAME RECIPIENT AFFILIATION

Document Control Branch (Document Control Desk)

SUBJECT: Corrects info re cutoffs for cocaine & amphetamines  
 described in performance data rept for Jul-Dec 1991,  
 transmitted via util 920228 ltr.

DISTRIBUTION CODE: A021D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1  
 TITLE: "Semiannual Fitness for Duty Program Performance Rept/Data" 10CFR26.7

### NOTES:


	RECIPIENT		COPIES			RECIPIENT		COPIES		
	ID	CODE/NAME	LTTR	ENCL		ID	CODE/NAME	LTTR	ENCL	
	PD5	LA	1	1		PD5	PD	1	1	
	DEAN,	W.	1	1						
INTERNAL:	ACRS		1	1		NRR/DRIS/RSGB		1	1	
	NUDOCS-ABSTRACT		1	1		REG FILE	01	1	1	
	RGN5	02	1	1						
EXTERNAL:	NRC	PDR	1	1		NSIC		1	1	

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 10 ENCL 100

MAY

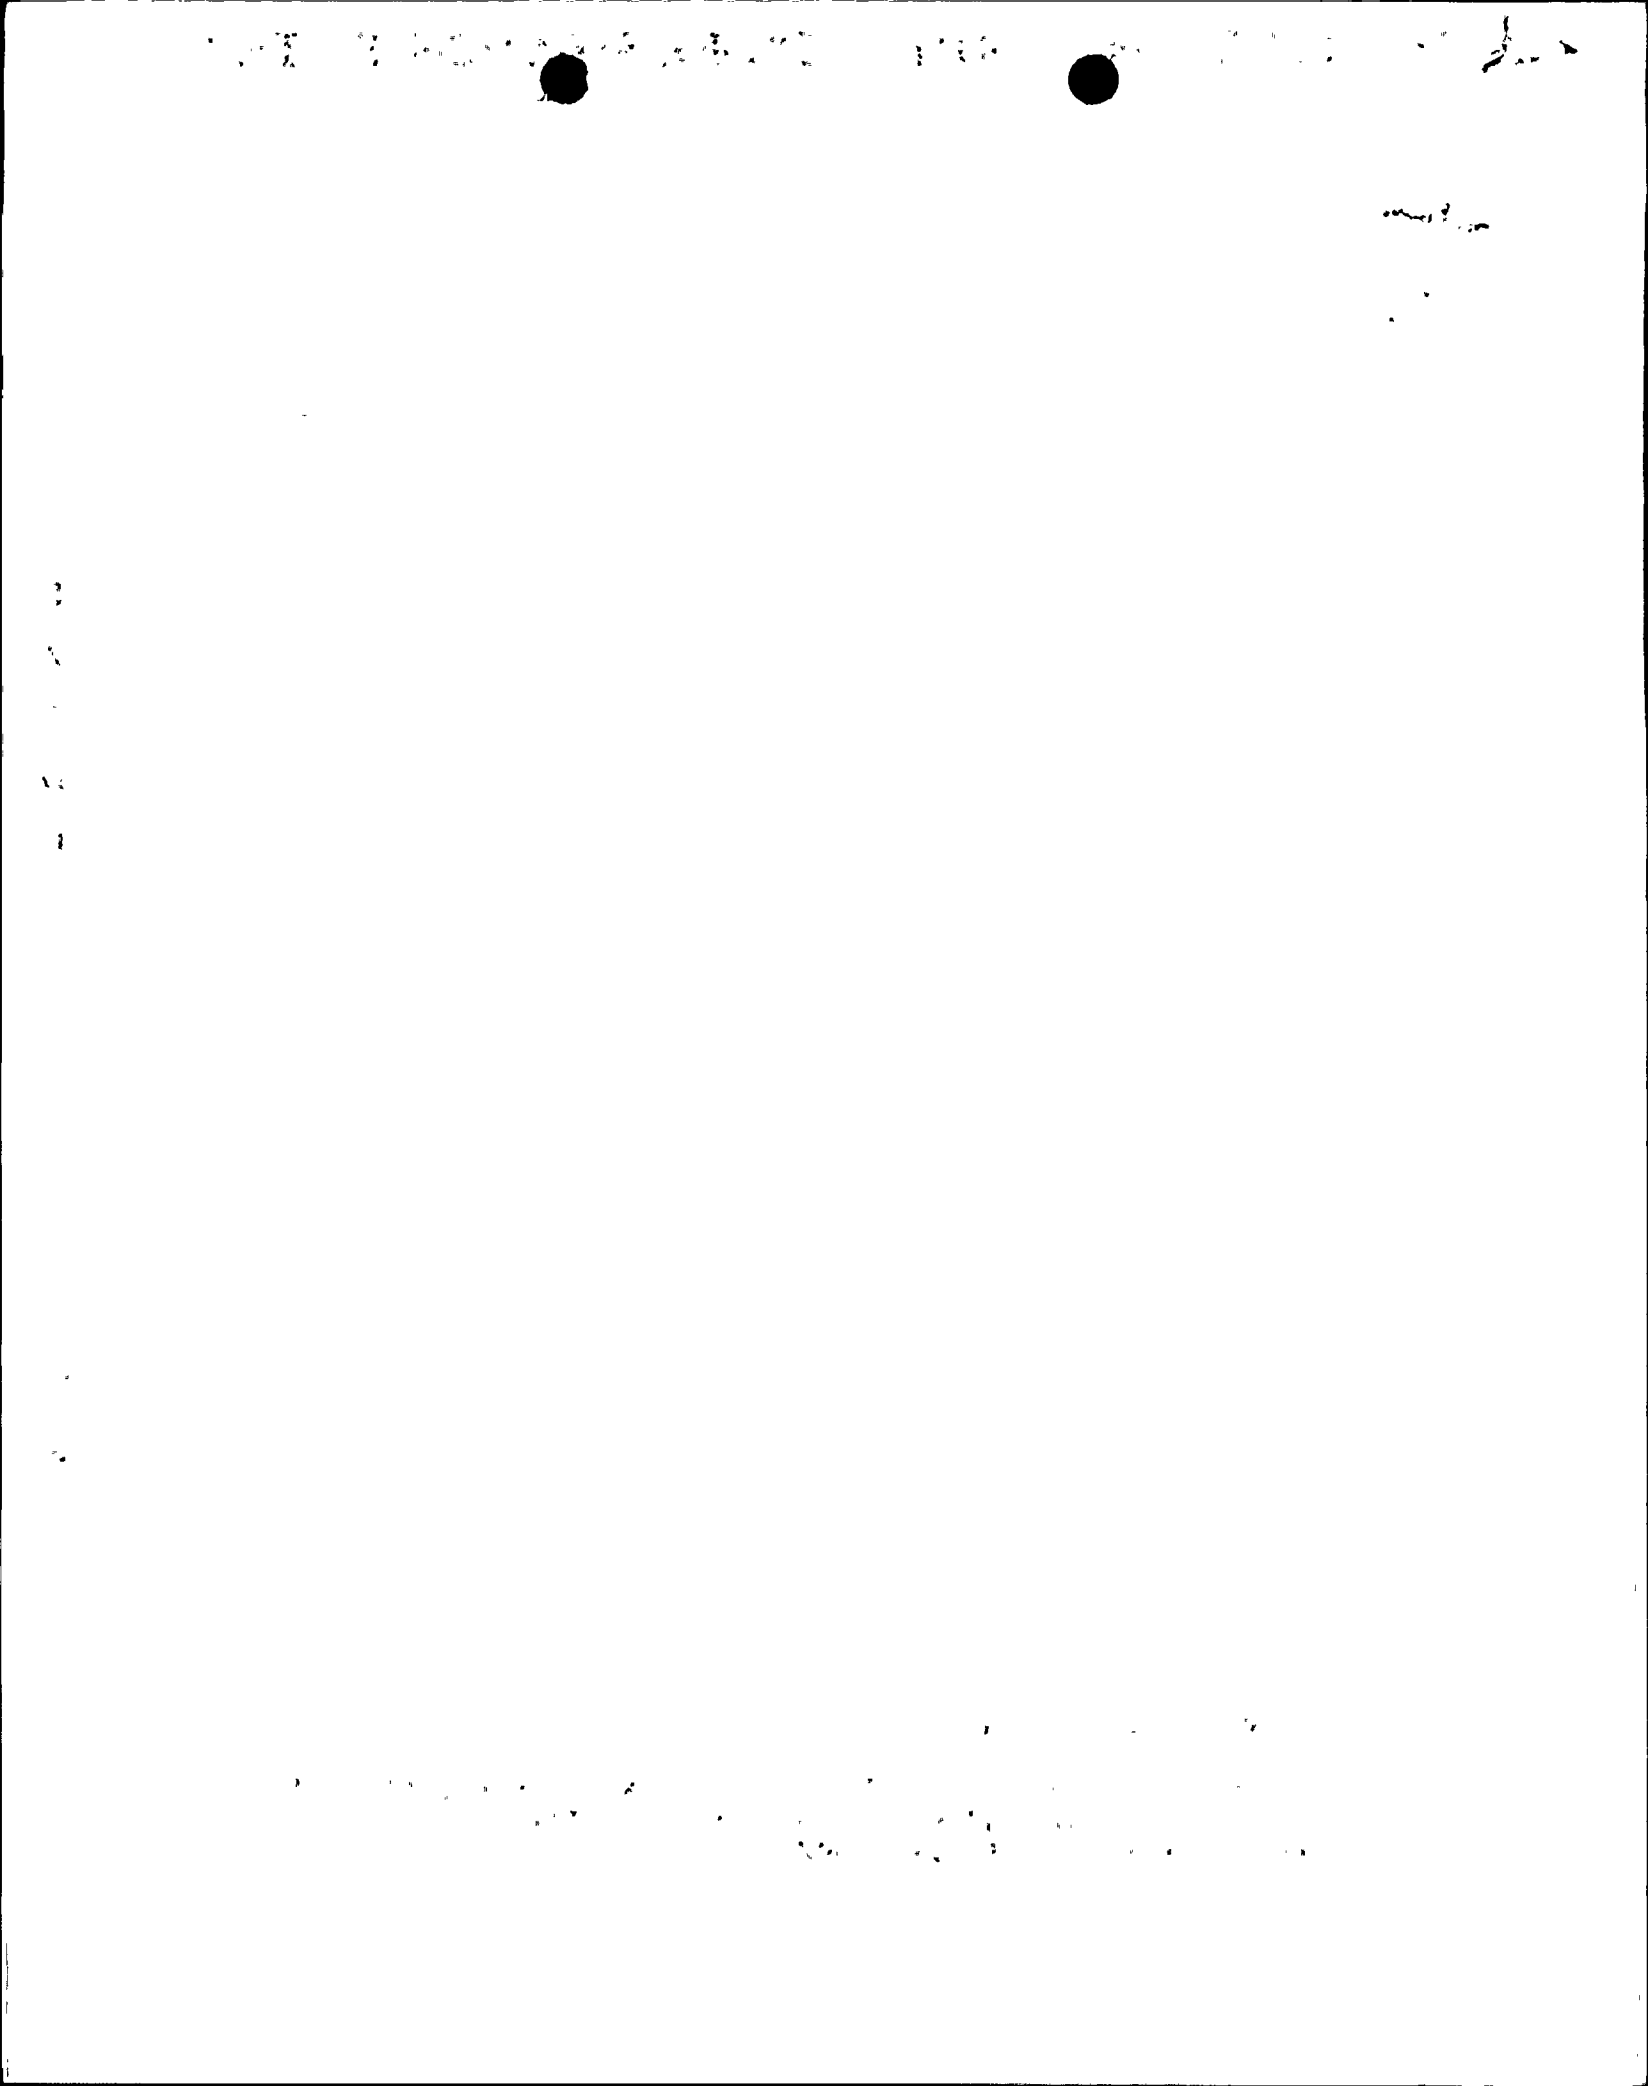

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

P.O. Box 968 • 3000 George Washington Way • Richland, Washington 99352

9204290046 920423  
PDR ADDCK 05000397  
R PDR

Docket No. 50-397  
April 23, 1992  
G02-92-105

U.S. Nuclear Regulatory Commission  
Document Control Desk  
Washington, D.C. 20555

Gentlemen:


**Subject:** Nuclear Plant No. 2 Performance Data Report -  
July 1 to December 31, 1991

**Reference:** Letter Dated February 28, 1992, G.C. Sorensen to  
USNRC Document Control Desk, Same Subject

The subject report was transmitted by the referenced letter. The Performance Data Report incorrectly listed the "confirmation" cutoffs for cocaine and amphetamines as 50 ng/ml and 15 ng/ml respectively. The correct "confirmation" cutoff level for cocaine is 150 ng/ml and the correct level for amphetamines is 500 ng/ml.

If you have any questions regarding this error, please contact M.M. (Matt) Monopoli, Manager, Support Services, at (509) 377-8473.

Very truly yours,



G.C. Sorensen  
Manager, Regulatory Programs (280)

cc: R.C. Sorensen, NRC Resident Inspector/901A  
J.B. Martin/NRC Region V  
N.S. Reynolds/Winston and Strawn  
F. Wenslawski, NRC Region V  
L. Norderhaug, NRC Region V  
W.M. Dean, NRC  
D.L. Williams - BPA/399

280043

A021



ML14350A148

Suppls 920306 & 0415 response to NRC safety evaluation of util station blackout analysis, addressing NRC concerns re providing capability to achieve or confirm containment isolation valve closure during station blackout event. Dated May 14, 1992.

431-97-0141 Box #8