



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

DOCKET NO. 50-397

NUCLEAR PROJECT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 119
License No. NPF-21

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by the Washington Public Power Supply System (licensee) dated October 2, 1993, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 2.C.(2) of Facility Operating License No. NPF-21 is hereby amended to read as follows:

9310200297 931015
PDR ADOCK 05000397
P PDR

(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 119 and the Environmental Protection Plan contained in Appendix B, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This amendment is effective as of the date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

Elinor G. Adensam

Elinor G. Adensam, Assistant Director
for Regions IV & V Reactors
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: October 15, 1993



Faint vertical text along the right edge of the page, possibly a page number or margin indicator.

ATTACHMENT TO LICENSE AMENDMENT

AMENDMENT NO. _____ TO FACILITY OPERATING LICENSE NO. NPF-21

DOCKET NO. 50-397


Replace the following pages of the Appendix A Technical Specifications with the enclosed pages. The revised pages are identified by amendment number and contain vertical lines indicating the areas of change. The corresponding overleaf pages are also provided to maintain document completeness.

REMOVE

3/4 3-11

INSERT

3/4 3-11

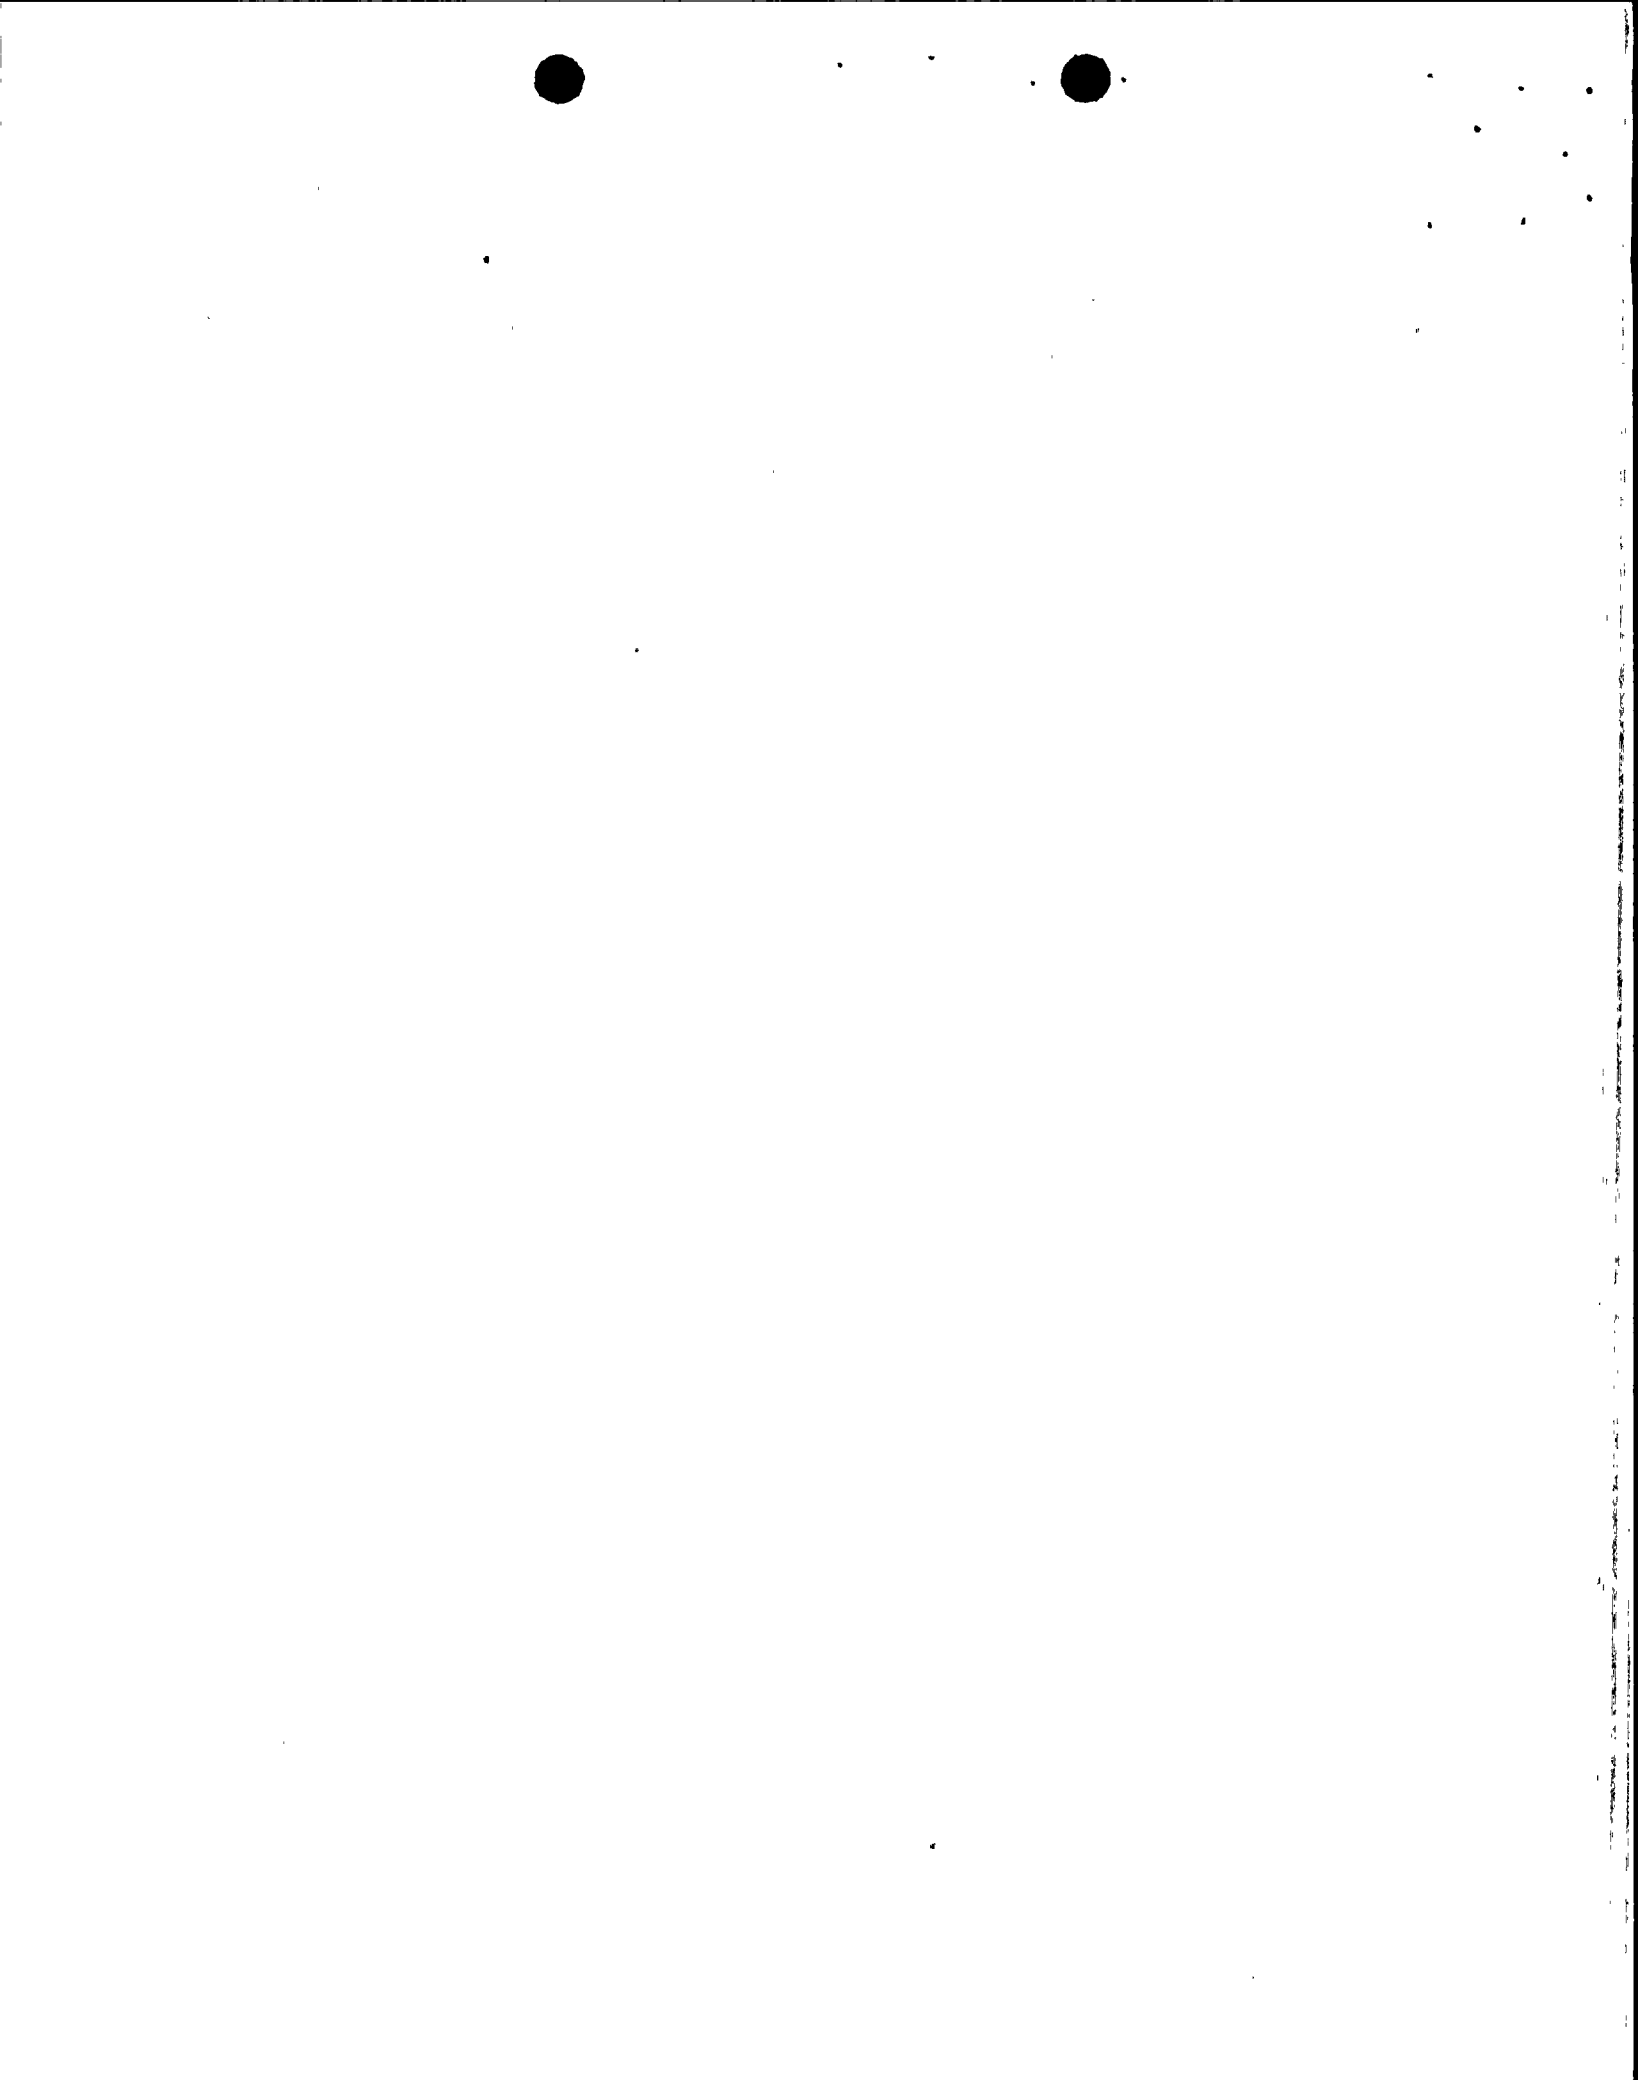

INSTRUMENTATION

SURVEILLANCE REQUIREMENTS

4.3.2.1 Each isolation actuation instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations for the OPERATIONAL CONDITIONS and at the frequencies shown in Table 4.3.2.1-1.

4.3.2.2 LOGIC SYSTEM FUNCTIONAL TESTS and simulated automatic operation of all channels shall be performed at least once per 18 months.

4.3.2.3 The ISOLATION SYSTEM RESPONSE TIME of each isolation trip function shown in Table 3.3.2-3 shall be demonstrated to be within its limit at least once per 18 months.* Each test shall include at least one channel per trip system such that all channels are tested at least once every N times 18 months, where N is the total number of redundant channels in a specific isolation trip system.

*Response time testing of the Isolation Actuation Instrumentation Response Times for Isolation Groups 3 and 4, as specified in Technical Specification Table 3.3.2-1, is not a requirement for OPERABILITY until entry into a COLD SHUTDOWN condition no later than startup from the Spring 1994 Refueling Outage.

