



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D.C. 20555-0001

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

DOCKET NO. 50-397


NUCLEAR PROJECT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 125
License No. NPF-21

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by the Washington Public Power Supply System (licensee) dated February 8, 1994, as supplemented March 25, 1994, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment and paragraph 2.C.(2) of Facility Operating License No. NPF-21 is hereby amended to read as follows:

9406290282 940617
PDR ADOCK 05000397
P PDR

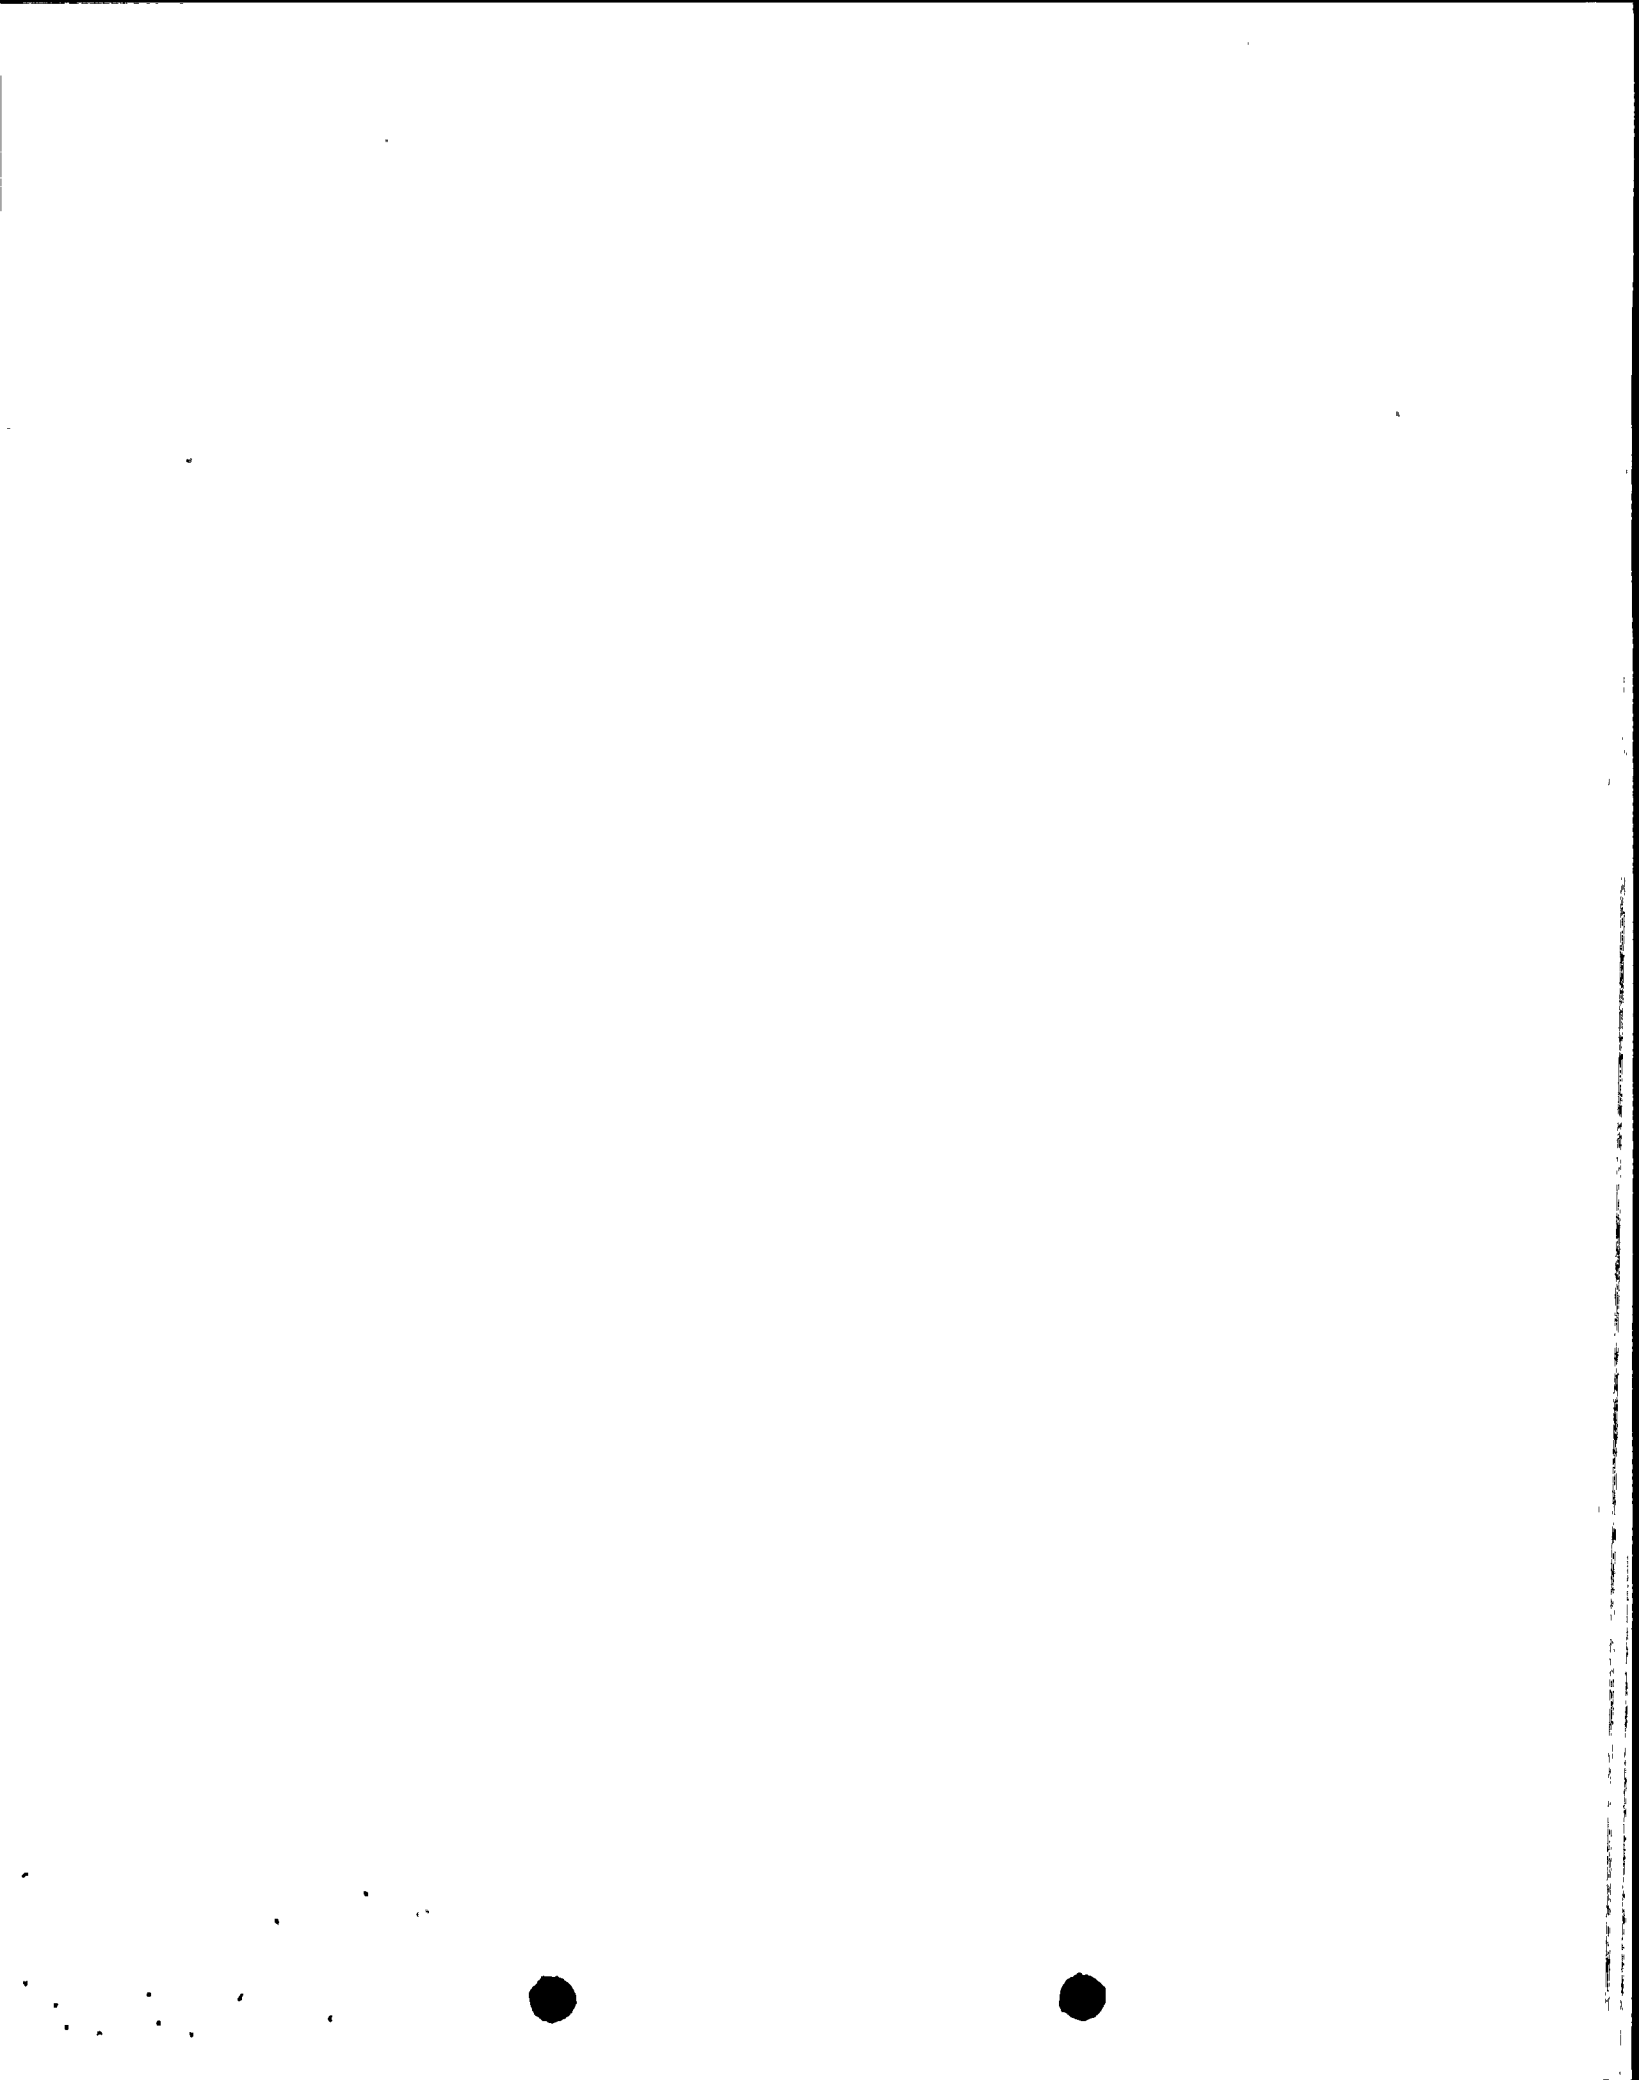

(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 125 and the Environmental Protection Plan contained in Appendix B, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan.

3. This amendment is effective on the date of issuance.


FOR THE NUCLEAR REGULATORY COMMISSION

W. D. Reckley for:

Theodore R. Quay, Director
Project Directorate IV-3
Division of Reactor Projects III/IV
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications.

Date of Issuance: June 17, 1994

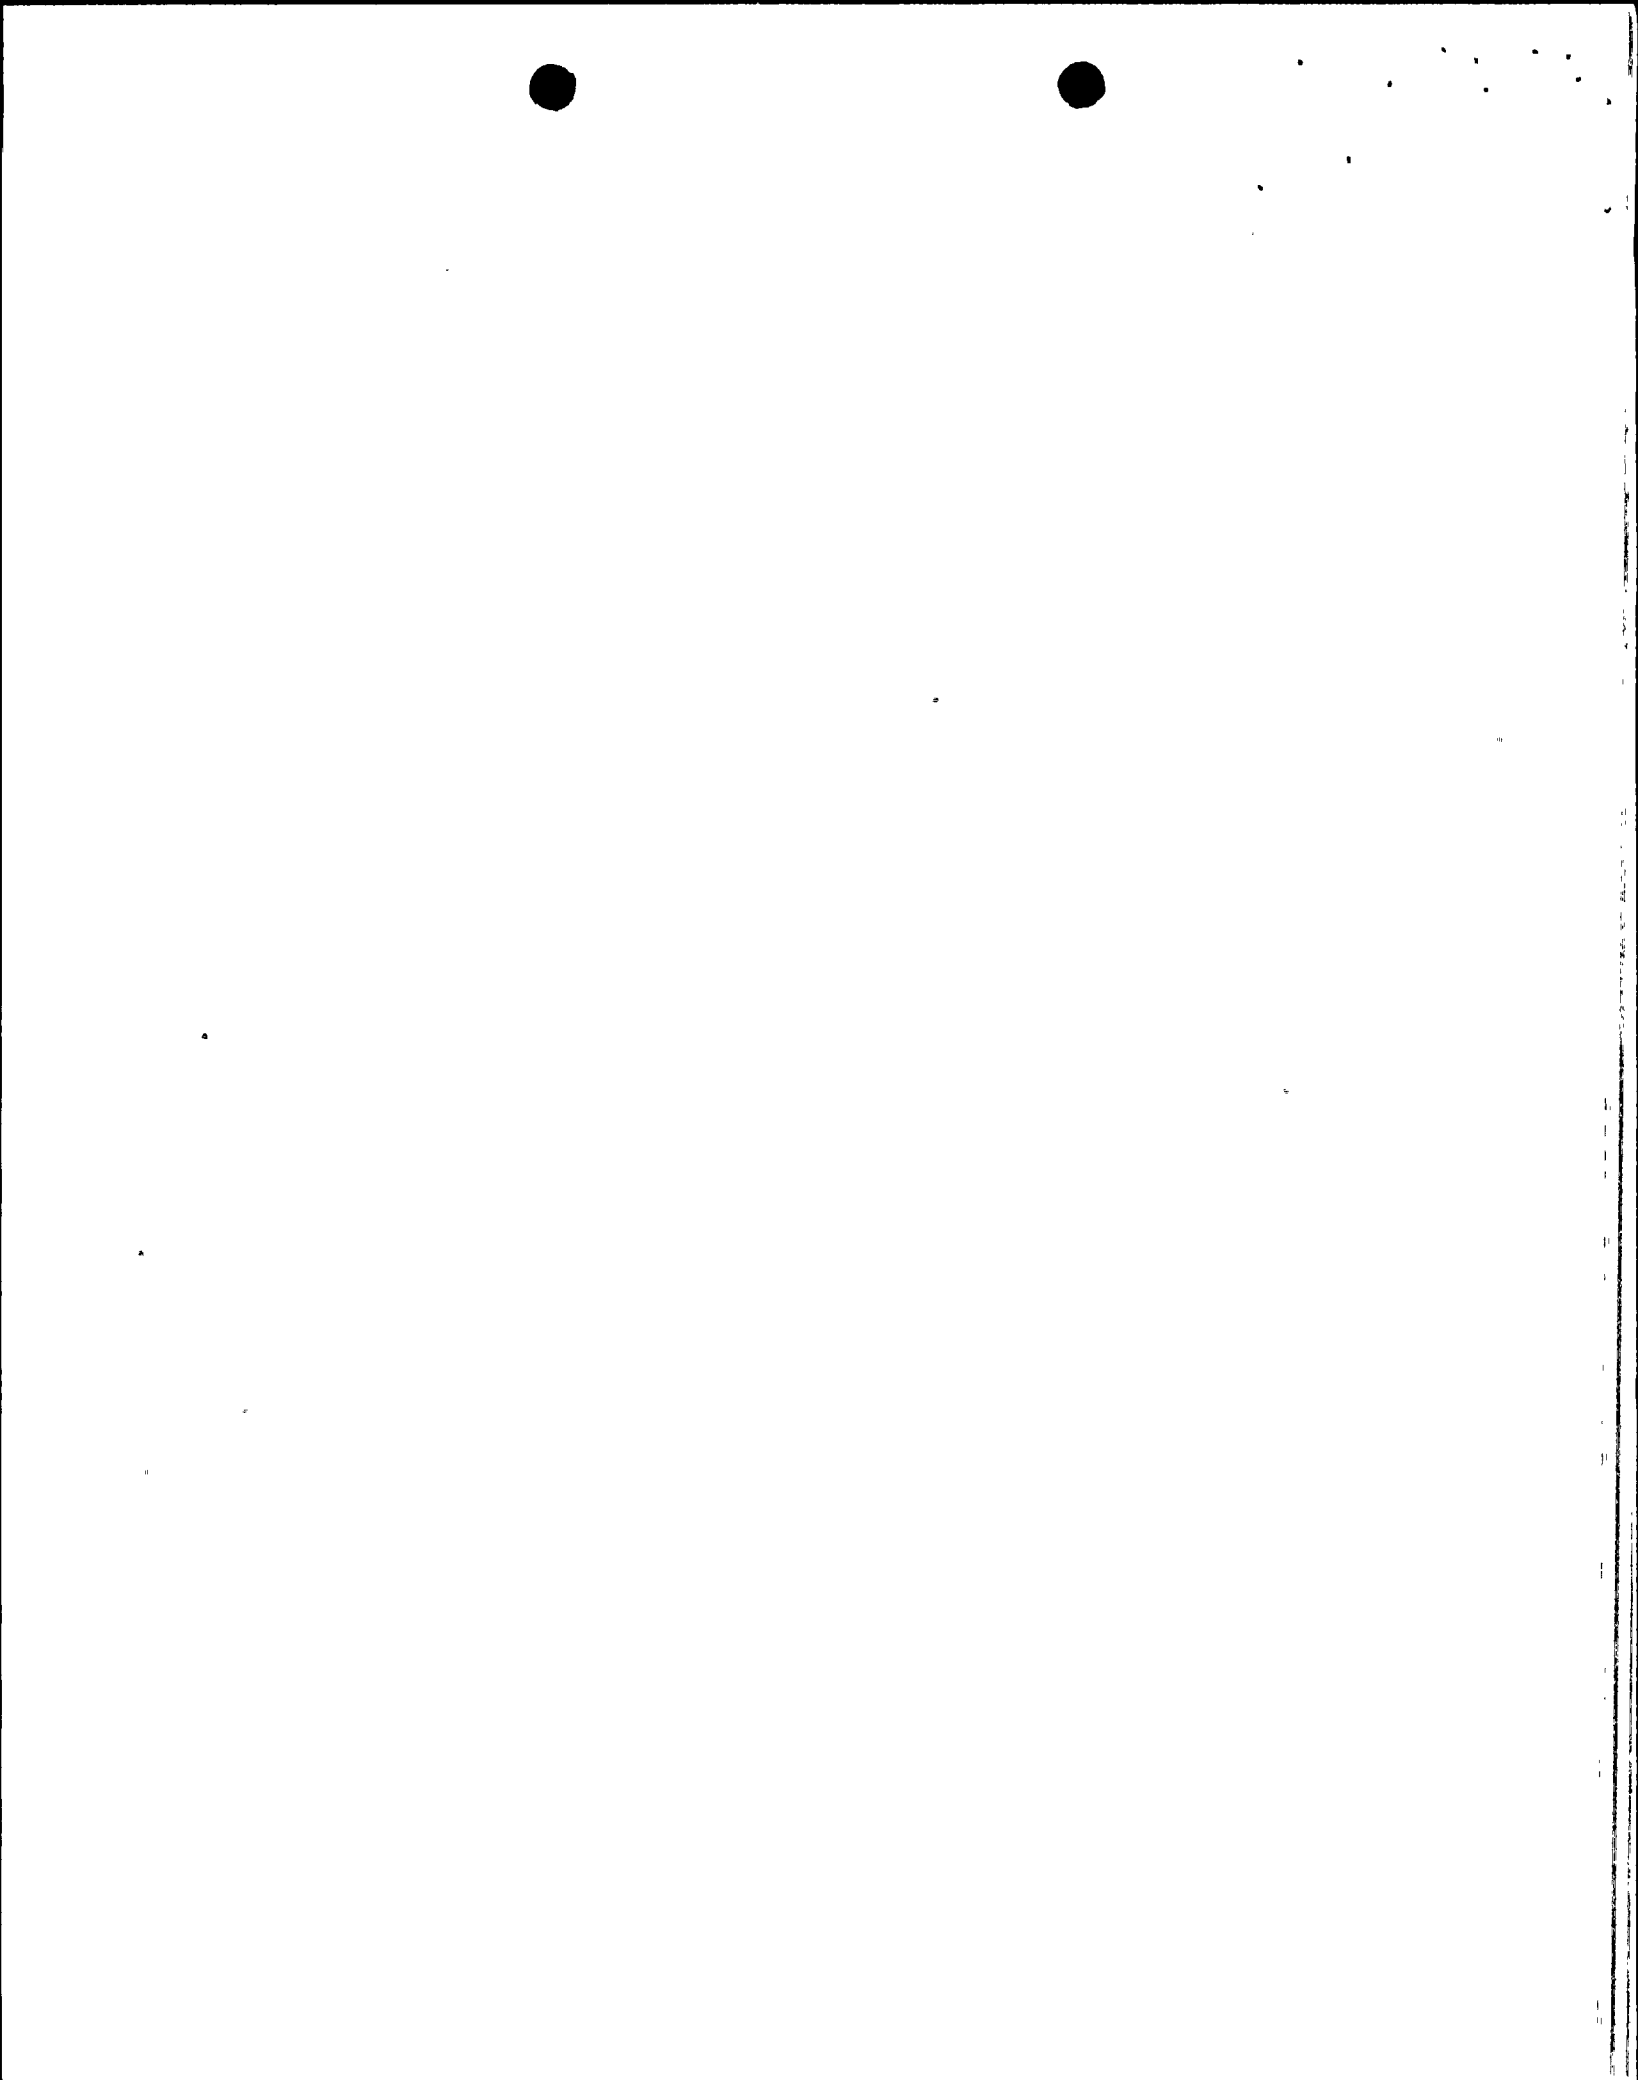

ATTACHMENT TO LICENSE AMENDMENT

AMENDMENT NO. 125 TO FACILITY OPERATING LICENSE NO. NPF-21

DOCKET NO. 50-397

Replace the following pages of the Appendix A Technical Specifications with the enclosed pages. The revised pages are identified by amendment number and contain vertical lines indicating the areas of change. The corresponding overleaf pages are also provided to maintain document completeness.

REMOVE

3/4 6-24

INSERT

3/4 6-24

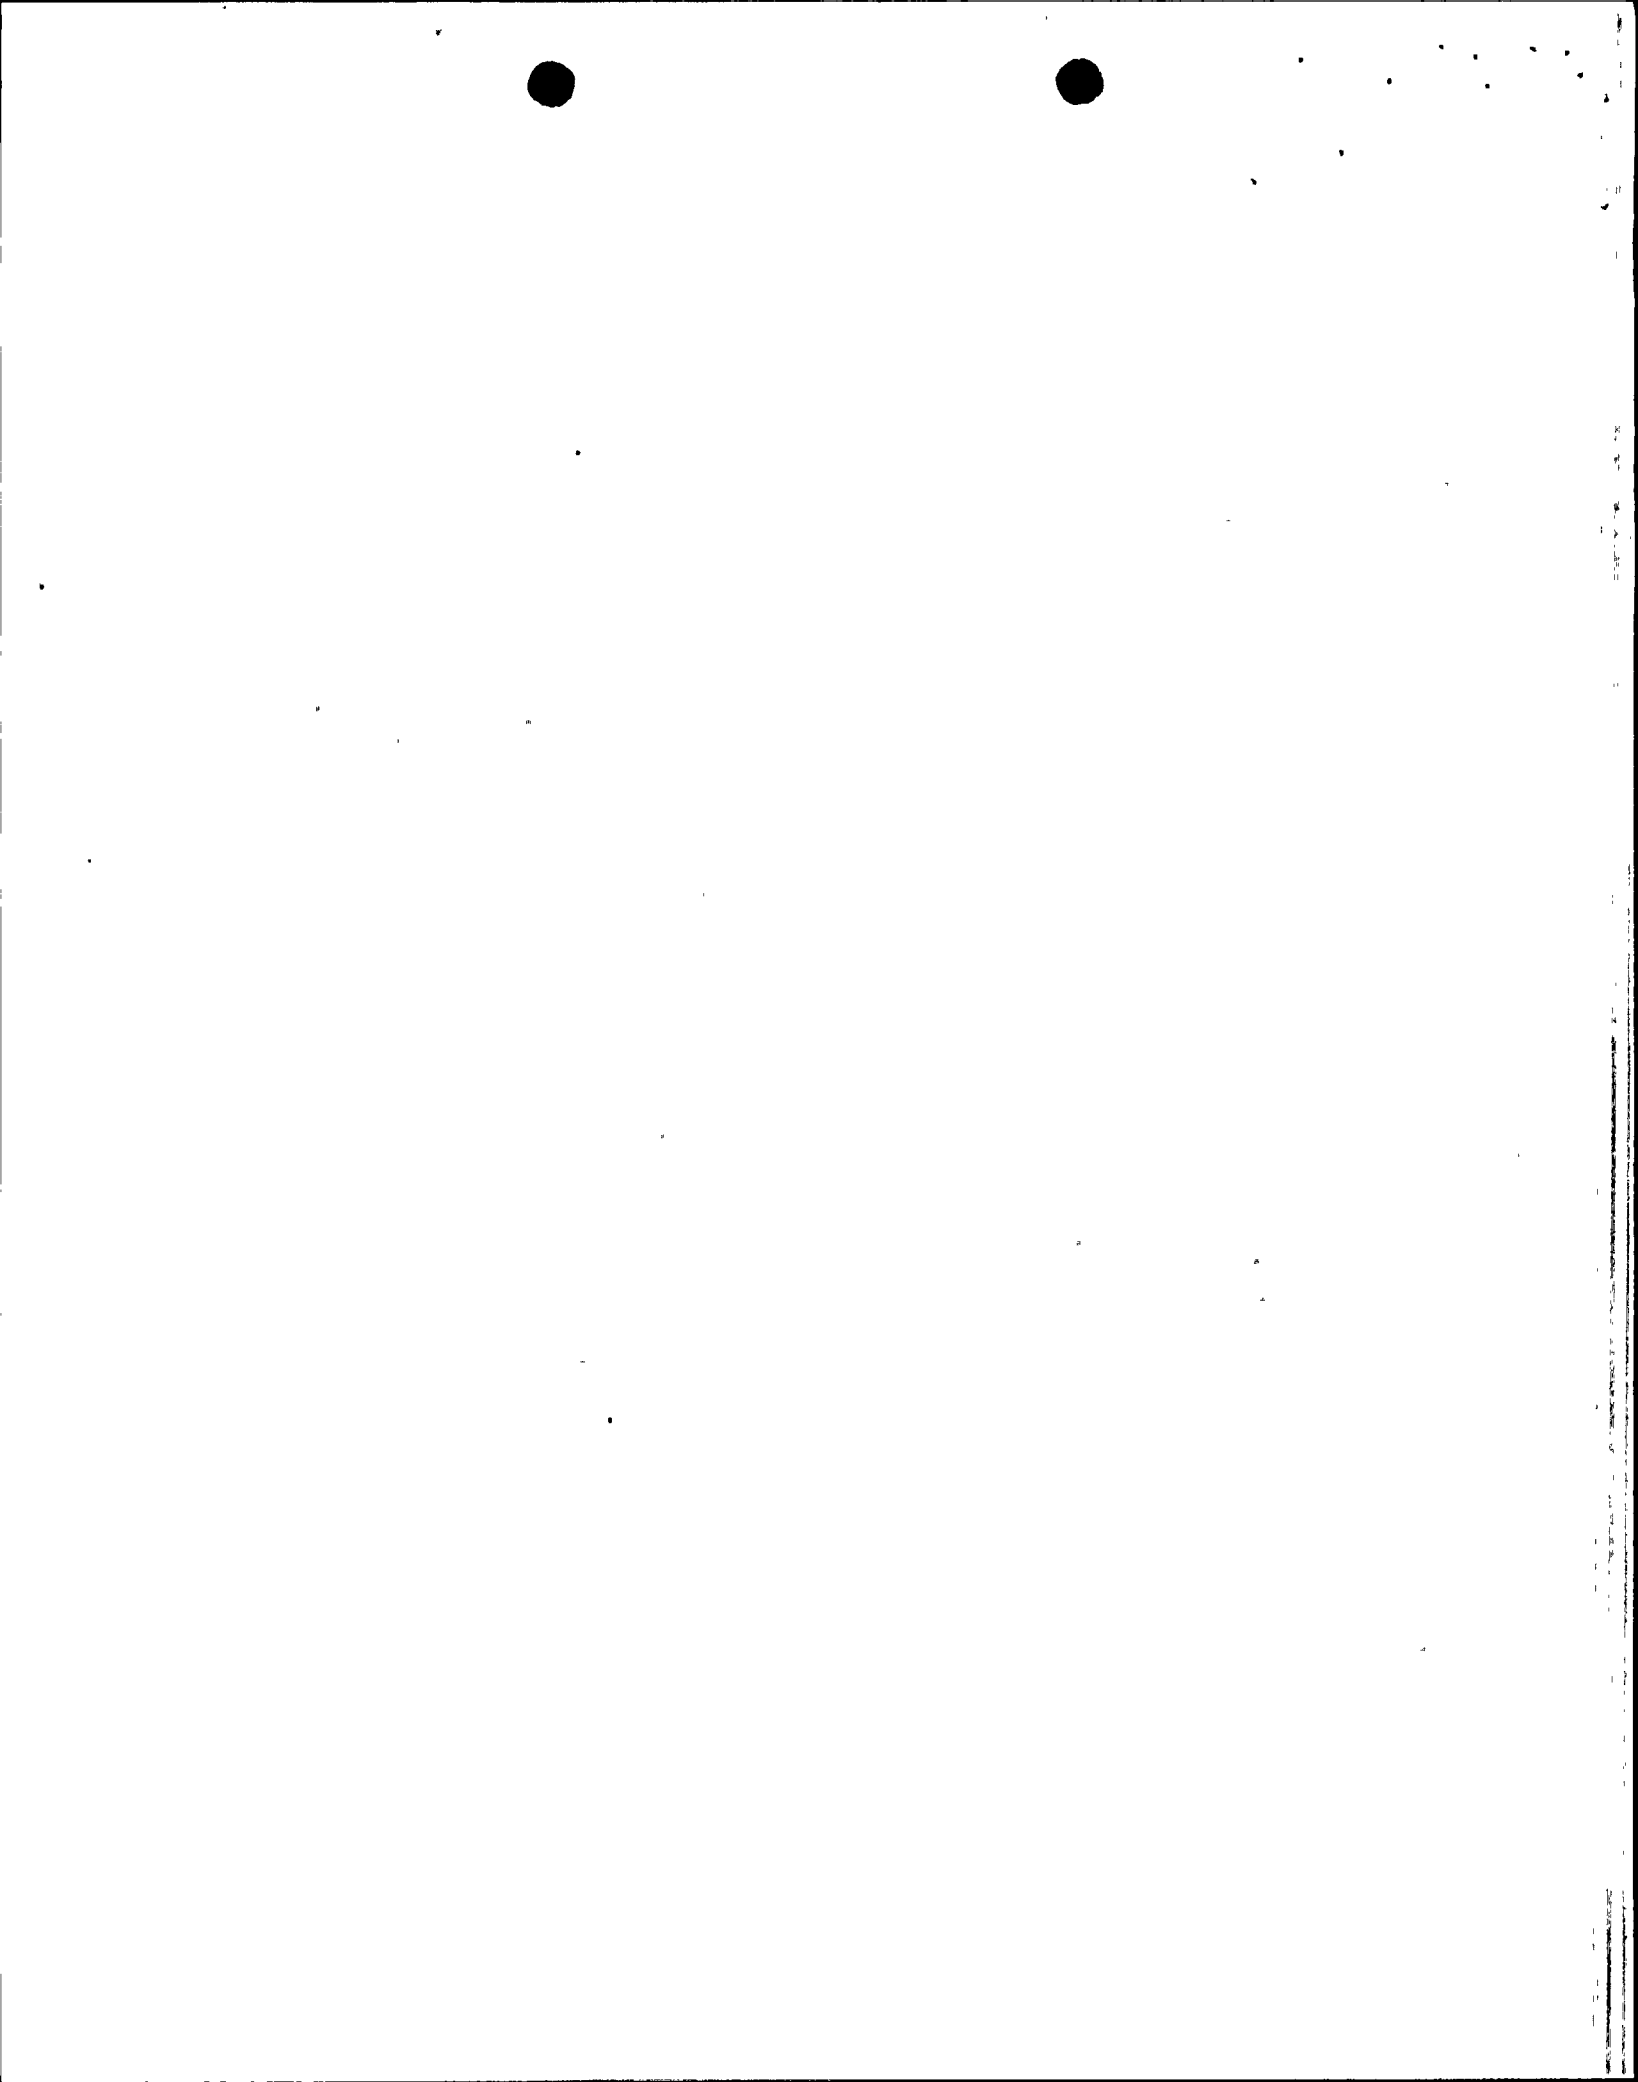


TABLE 3.6.3-1 (Continued)

PRIMARY CONTAINMENT ISOLATION VALVES

<u>VALVE FUNCTION AND NUMBER</u>	<u>VALVE GROUP (a)</u>	<u>MAXIMUM ISOLATION TIME (Seconds)</u>
a. <u>Automatic Isolation Valves (Continued)</u>		
Reactor Core Isolation Cooling		
RCIC-V-8	8	26
RCIC-V-63	8	16
RCIC-V-76	8	22
Low Pressure Core Spray		
LPCS-V-12	10	180
High Pressure Core Spray		
HPCS-V-23	11	180
b. <u>Excess Flow Check Valves(e)</u>		
Containment Atmosphere		
PI-EFC-X29b		N.A.
PI-EFC-X29f		
PI-EFC-X30a		
PI-EFC-X30f		
PI-EFC-X42c		
PI-EFC-X42f		
PI-EFC-X61c		
PI-EFC-X62b		
PI-EFC-X69f		
PI-EFC-X78a		

