

CATEGORY 2

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9905070006 DOC.DATE: 99/04/29 NOTARIZED: NO DOCKET #
 FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe 05000397
 AUTH.NAME AUTHOR AFFILIATION
 SMITH, G.O. Washington Public Power Supply System
 RECIPIENT NAME RECIPIENT AFFILIATION
 Office of Nuclear Regulatory Research (Post 941217)

SUBJECT: Forwards rept of individual monitoring for 1998 CY, as required by 10CFR20.2206(b).

DISTRIBUTION CODE: IE56D COPIES RECEIVED: LTR 1 ENCL 8 SIZE: 2
 TITLE: Annual Personnel Monitoring Rpt/Annual Rad Exposure Rpt by Functions

NOTES:

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL
	LPD4-2 PD		1	0		CUSHING, J		1	1
INTERNAL:	ACNW		1	1	<u>FILE CENTER</u>		1	1	
	NMSS/IMSB	T8F5	1	1	NRR/DIPM/IOLB		2	2	
	RGN4	01	1	1					
EXTERNAL:	EMITCO MARSHALL		1	1	NOAC		1	1	
	NRC PDR		1	1					


Rec'd at DCD. w/o diskette

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTR 11 ENCL 18

C
A
T
E
G
O
R
Y
2
D
O
C
U
M
E
N
T

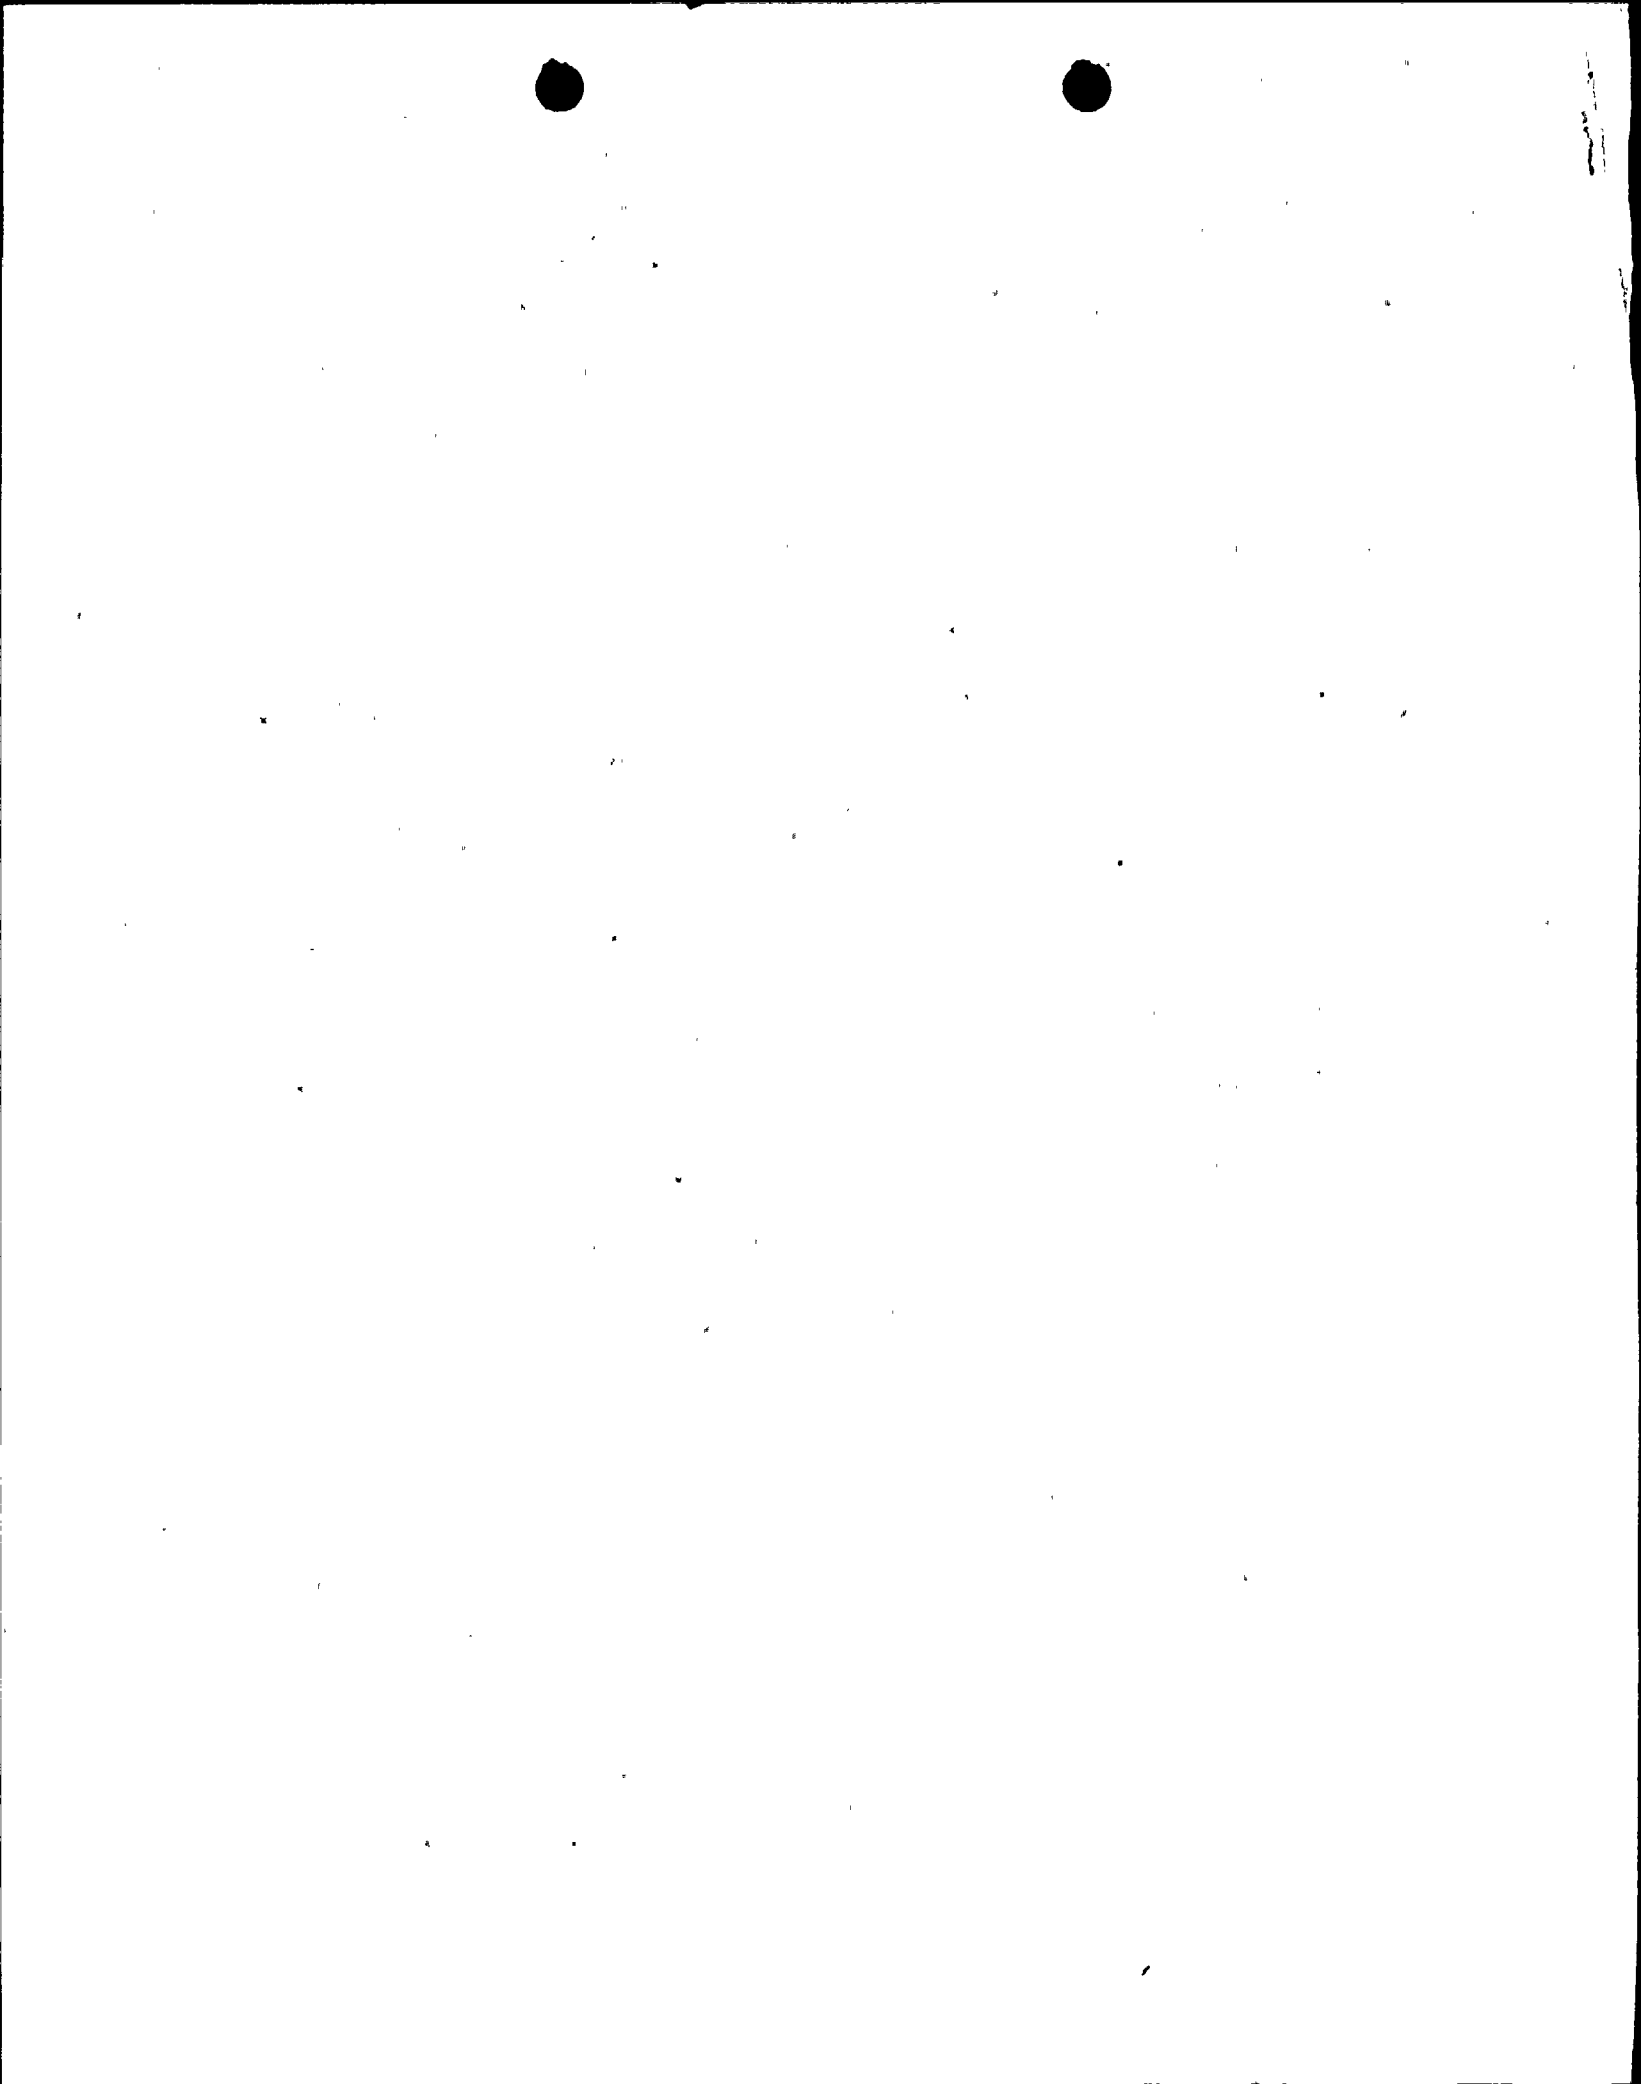

WASHINGTON PUBLIC POWER SUPPLY SYSTEM

P.O. Box-968 • Richland, Washington 99352-0968

April 29, 1999
GO2-99-084

Docket No. 50-397

REIRS Project Manager
Office of Nuclear Regulatory Research
U. S. Nuclear Regulatory Commission
Washington, DC 20555

Gentlemen:

Subject: **WNP-2 OPERATING LICENSE NPF-21
ANNUAL REPORT OF INDIVIDUAL MONITORING**

Enclosed, as required by 10 CFR Part 20.2206(b), is the Supply System's Nuclear Plant No. 2 Report of Individual Monitoring for the 1998 calendar year. This report is being submitted in electronic format. The report includes data for individuals for whom monitoring was required and those whom monitoring was provided, but not required.

Regulatory Guide 8.7, Revision 1, recommends using the following format on NRC Forms 4 and 5:

- "NR" (Not Required) in the blocks to indicate the areas for which monitoring was not required.
- "ND" (Not Detectable) in the blocks where monitoring was provided but not measurable, and
- "NC" (Not Calculated) in the blocks if the Committed Effective Dose Equivalent (CEDE) does not exceed 1 rem and there are no over-exposures in any dose category within the monitoring year.

The Supply System's current computer software is unable to provide information using NR, ND, and NC. Our software initially contains zeros in the following fields; Deep Dose Equivalent (DDE); Eye Dose Equivalent to the Lens of the Eye (LDE); Shallow Dose Equivalent/Whole Body (SDE/WB); Shallow Dose Equivalent/Max Extremity (SDE/ME); Committed Effective Dose Equivalent (CEDE); Committed Dose Equivalent, Maximally Exposed Organ (CDE); Total Effective Dose Equivalent (TEDE); and Total Organ Dose Equivalent, Max Organ (TODE). When actual dose data is input, these zeros are replaced with actual values. If no value is entered, the zeros remain. There are no provisions for entering letters.

TEST

9905070006 990429
PDR ADDCK 05000397
P PDR

*Delete - - -
Limits Marshall
NOAC
NRC PDR.*

*Rec'd at DED
w/0 diskette 1/2*

ANNUAL REPORT OF INDIVIDUAL MONITORING

Page 2

Additional requested information:

Licensee Information

Licensee: Washington Public Power Supply System
NRC License No: NPF-21
Licensee Contact: DR Hebert, Technical Support Specialist
Contact Phone: (509) 377-8036

Electronic Format Information

Format: 3 1/2" diskette
Directory: WPPSS
File Name(s): HEADER.TXT DETAIL.DAT INTAKE.DAT
Date Created: April 27, 1999
Operating System: PC

In addition to the data provided above, we are providing corrected Social Security number (SSN) information for the following individual whose exposure data was previously reported:

<u>Name</u>	<u>Corrected SSN</u>	<u>Incorrect SSN</u>
Stewart, James C.	367701894	367701984

Should you have any questions or desire additional information, please contact DR Hebert at (509) 377-8036.

Respectfully,



GO Smith
Vice President, Generation
Mail Drop 927M

Enclosure

cc: JS Cushing, NRR NRC (w/o)
EW Merschhoff, NRC RIV (w/o)
PD Robinson, Winston & Strawn (w/o)
DL Williams, BPA (MD 1399) (w/o)
NRC Sr. Resident Inspector (927N) (w/o)
NRC Document Control Desk (w/o)

