




Central File

Docket Nos. 50-528, 529, 530

July 27, 1979
ANPP-13558 - JMA/TFQ

Mr. R. H. Engelken, Director
U. S. Nuclear Regulatory Commission
Region V
202 Walnut Creek Plaza
1990 North California Boulevard
Walnut Creek, California 94596

Subject: NRC IE Bulletin No. 79-11
dated May 22, 1979
File: D.4.01.1; 79-005-026

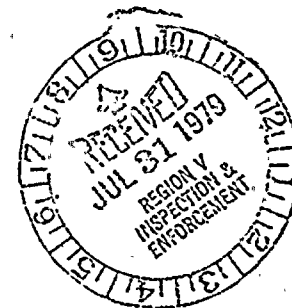

Dear Mr. Engelken:

In reference to your IE Bulletin No. 79-11, which discussed potential failure of Westinghouse type DB-50 and DB-75 circuit breakers in engineered safety systems, we have completed a review of the Palo Verde Nuclear Generating Station design.

No Westinghouse type DB-50 or DB-75 circuit breakers are being purchased for use at PVNGS. Therefore, the questions in the Bulletin do not apply.

If you have any questions, please advise.

Very truly yours,

E. E. Van Brunt

E. E. Van Brunt, Jr.
APS Vice President,
Nuclear Projects
ANPP Project Director

EEVBJr/TFQ/av

cc: R. L. Robb
J. M. Allen
D. B. Karner
J. A. Roedel
F. W. Hartley
W. H. Wilson
C. E. Ferguson
A. C. Rogers
L. W. Price

NRC Office of Inspection & Enforcement
Division of Reactor Inspection Programs
Washington, D.C. 20555

7909040 312
aol
RB
P

79-61

