

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8102250251 DOC. DATE: 81/02/10 NOTARIZED: YES
 FACIL: 50-528 Palo Verde Nuclear Station, Unit 1, Arizona Public
 50-529 Palo Verde Nuclear Station, Unit 2, Arizona Public
 50-530 Palo Verde Nuclear Station, Unit #, Arizona Public
 AUTH. NAME AUTHOR AFFILIATION
 VAN BRUNT, E. E. Arizona Public Service Co.
 RECIP. NAME RECIPIENT AFFILIATION
 Office of Nuclear Reactor Regulation, Director

DOCKET #
05000528
 05000529
 05000530

M/A

*Reports
 Jacket*

SUBJECT: Forwards "Auxiliary Feedwater Sys Reliability Analysis," in response to requirements of NUREG-0737. Analysis will be incorporated in FSAR.

DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 60 SIZE: 2+175
 TITLE: PSAR/FSAR AMDTS and Related Correspondence


NOTES: Standardized Plant. 05000528
 Standardized Plant. 05000529
 Standardized Plant. 05000530

ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTR	ENCL		ID CODE/NAME	LTR
ACTION:	A/D LICENSNG	1	0	MIRAGLIA, F.	1	0
	LEE, J.	1	0	KERRIGAN, J. 04	1	1
INTERNAL:	ACCID EVAL BR26	1	1	AUX SYS BR 07	1	1
	CHEM ENG BR 08	1	1	CONT SYS BR 09	1	1
	CORE PERF BR 10	1	1	EFF TR SYS BR12	1	1
	EMERG PREP 22	1	0	EQUIP QUAL BR13	3	3
	GEOSCIENCES 14	1	1	HUM FACT ENG BR	1	1
	HYD/GEO BR 15	2	2	I&C SYS BR 16	1	1
	I&E 06	3	3	LIC GUID BR	1	1
	LIC QUAL BR	1	1	MATL ENG BR 17	1	1
	MECH ENG BR 18	1	1	MPA	1	0
	NRC PDR 02	1	1	OELD	1	0
	OP LIC BR	1	1	POWER SYS BR 19	1	1
	PROC/TST REV 20	1	1	QA BR 21	1	1
	RAD ASSESS BR22	1	1	REAC SYS BR 23	1	1
	<u>REG FILE</u> 01	1	1	SIT ANAL BR 24	1	1
	STRUCT ENG BR25	1	1	SYS INTERAC BR	1	1
EXTERNAL:	ACRS' 27	16	16	LPDR 03	1	1
	NSIC 05	1	1			

26 1981

TOTAL NUMBER OF COPIES REQUIRED: LTR 57 ENCL 51

FH

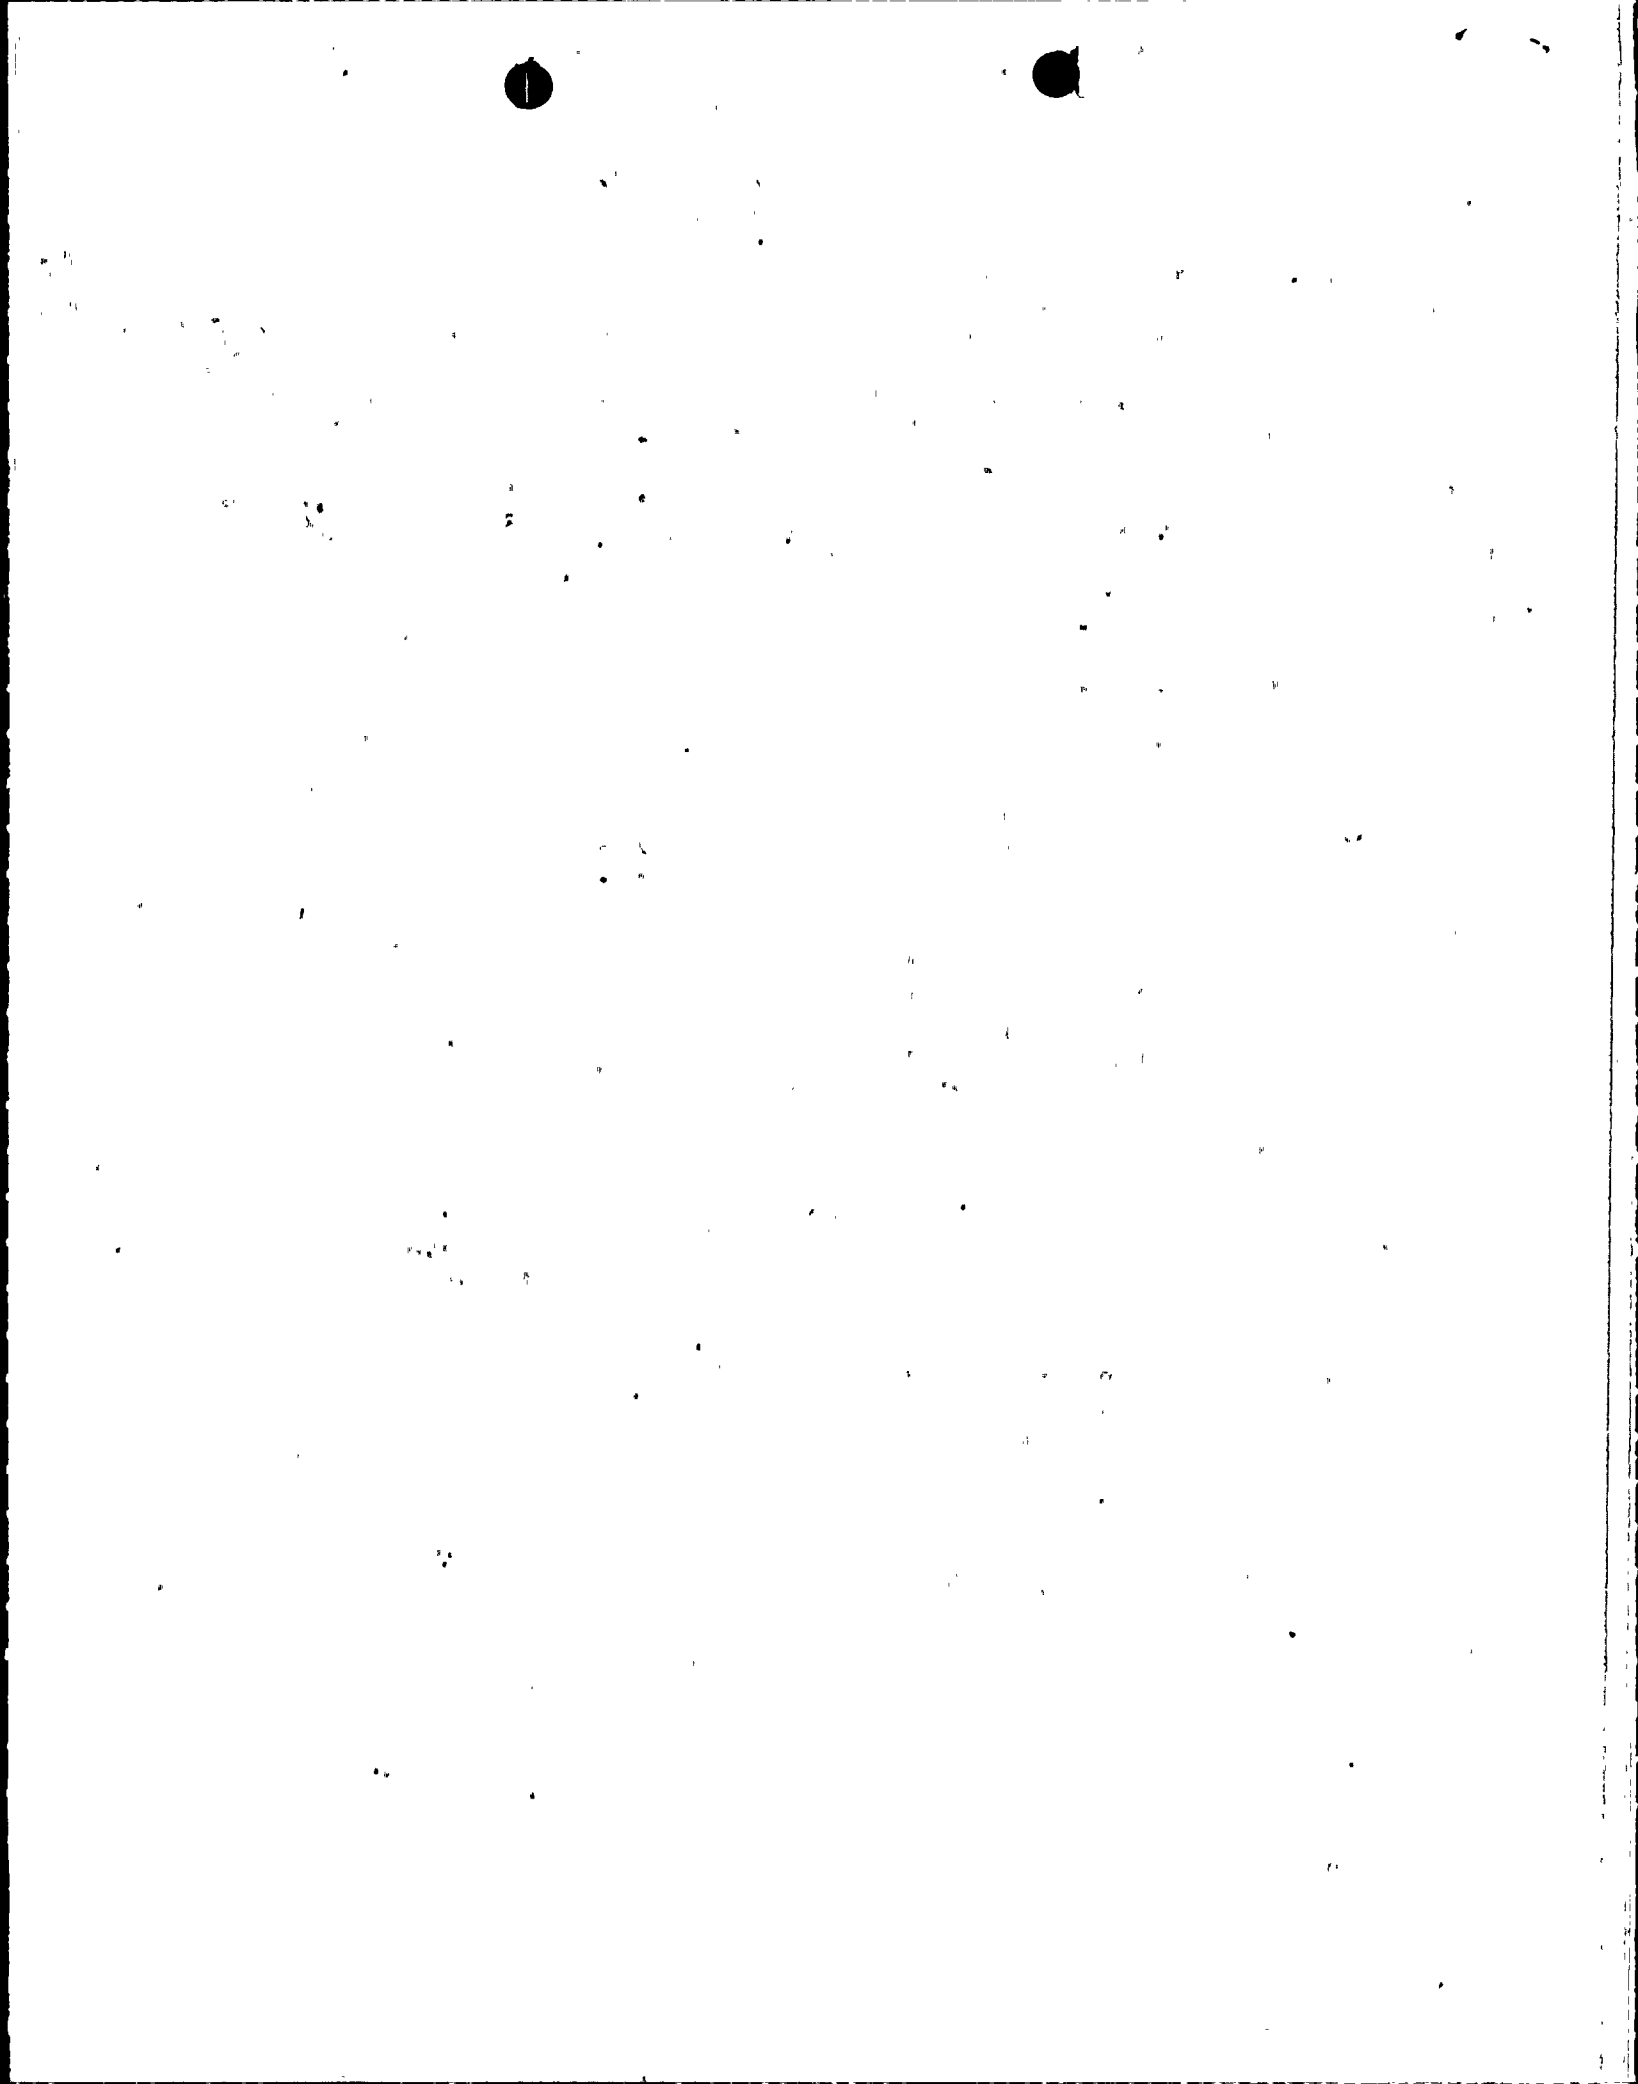

ARIZONA



PUBLIC SERVICE COMPANY

P. O. BOX 21666 • PHOENIX, ARIZONA 85036

February 10, 1981
ANPP-17268 - JMA/TFQ

Director of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Subject: Palo Verde Nuclear Generating Station
(PVNGS) Units 1, 2 and 3
Docket Nos. STN-50-528/529/530

Dear Sir:

Arizona Public Service Company (APS), as Project Manager and Operating Agent for Palo Verde Nuclear Generating Station (PVNGS) Units 1, 2 and 3 is submitting herewith Sixty (60) copies of the PVNGS Auxiliary Feedwater System Reliability Analysis.

This Reliability Analysis was performed in response to the requirements of NUREG-0737, Section II.E.1.1, and the letter from D. F. Ross, Jr. to all pending Operating License applicants of Nuclear Steam Supply Systems designed by Westinghouse and Combustion Engineering, dated March 10, 1980.

This analysis will be incorporated into the PVNGS FSAR in a future amendment.

Very truly yours,

E. E. Van Brunt, Jr.
APS Vice President,
Nuclear Projects
ANPP Project Director

EEVBJr/TFQ/av
Attachment
cc: J. Kerrigan

RECEIVED DISTRIBUTION SERVICES UNIT


1981 FEB 25 PM 12 46

U.S. NRC
DISTRIBUTION SERVICES
BRANCH

3001
5
1/60

A


8102250251

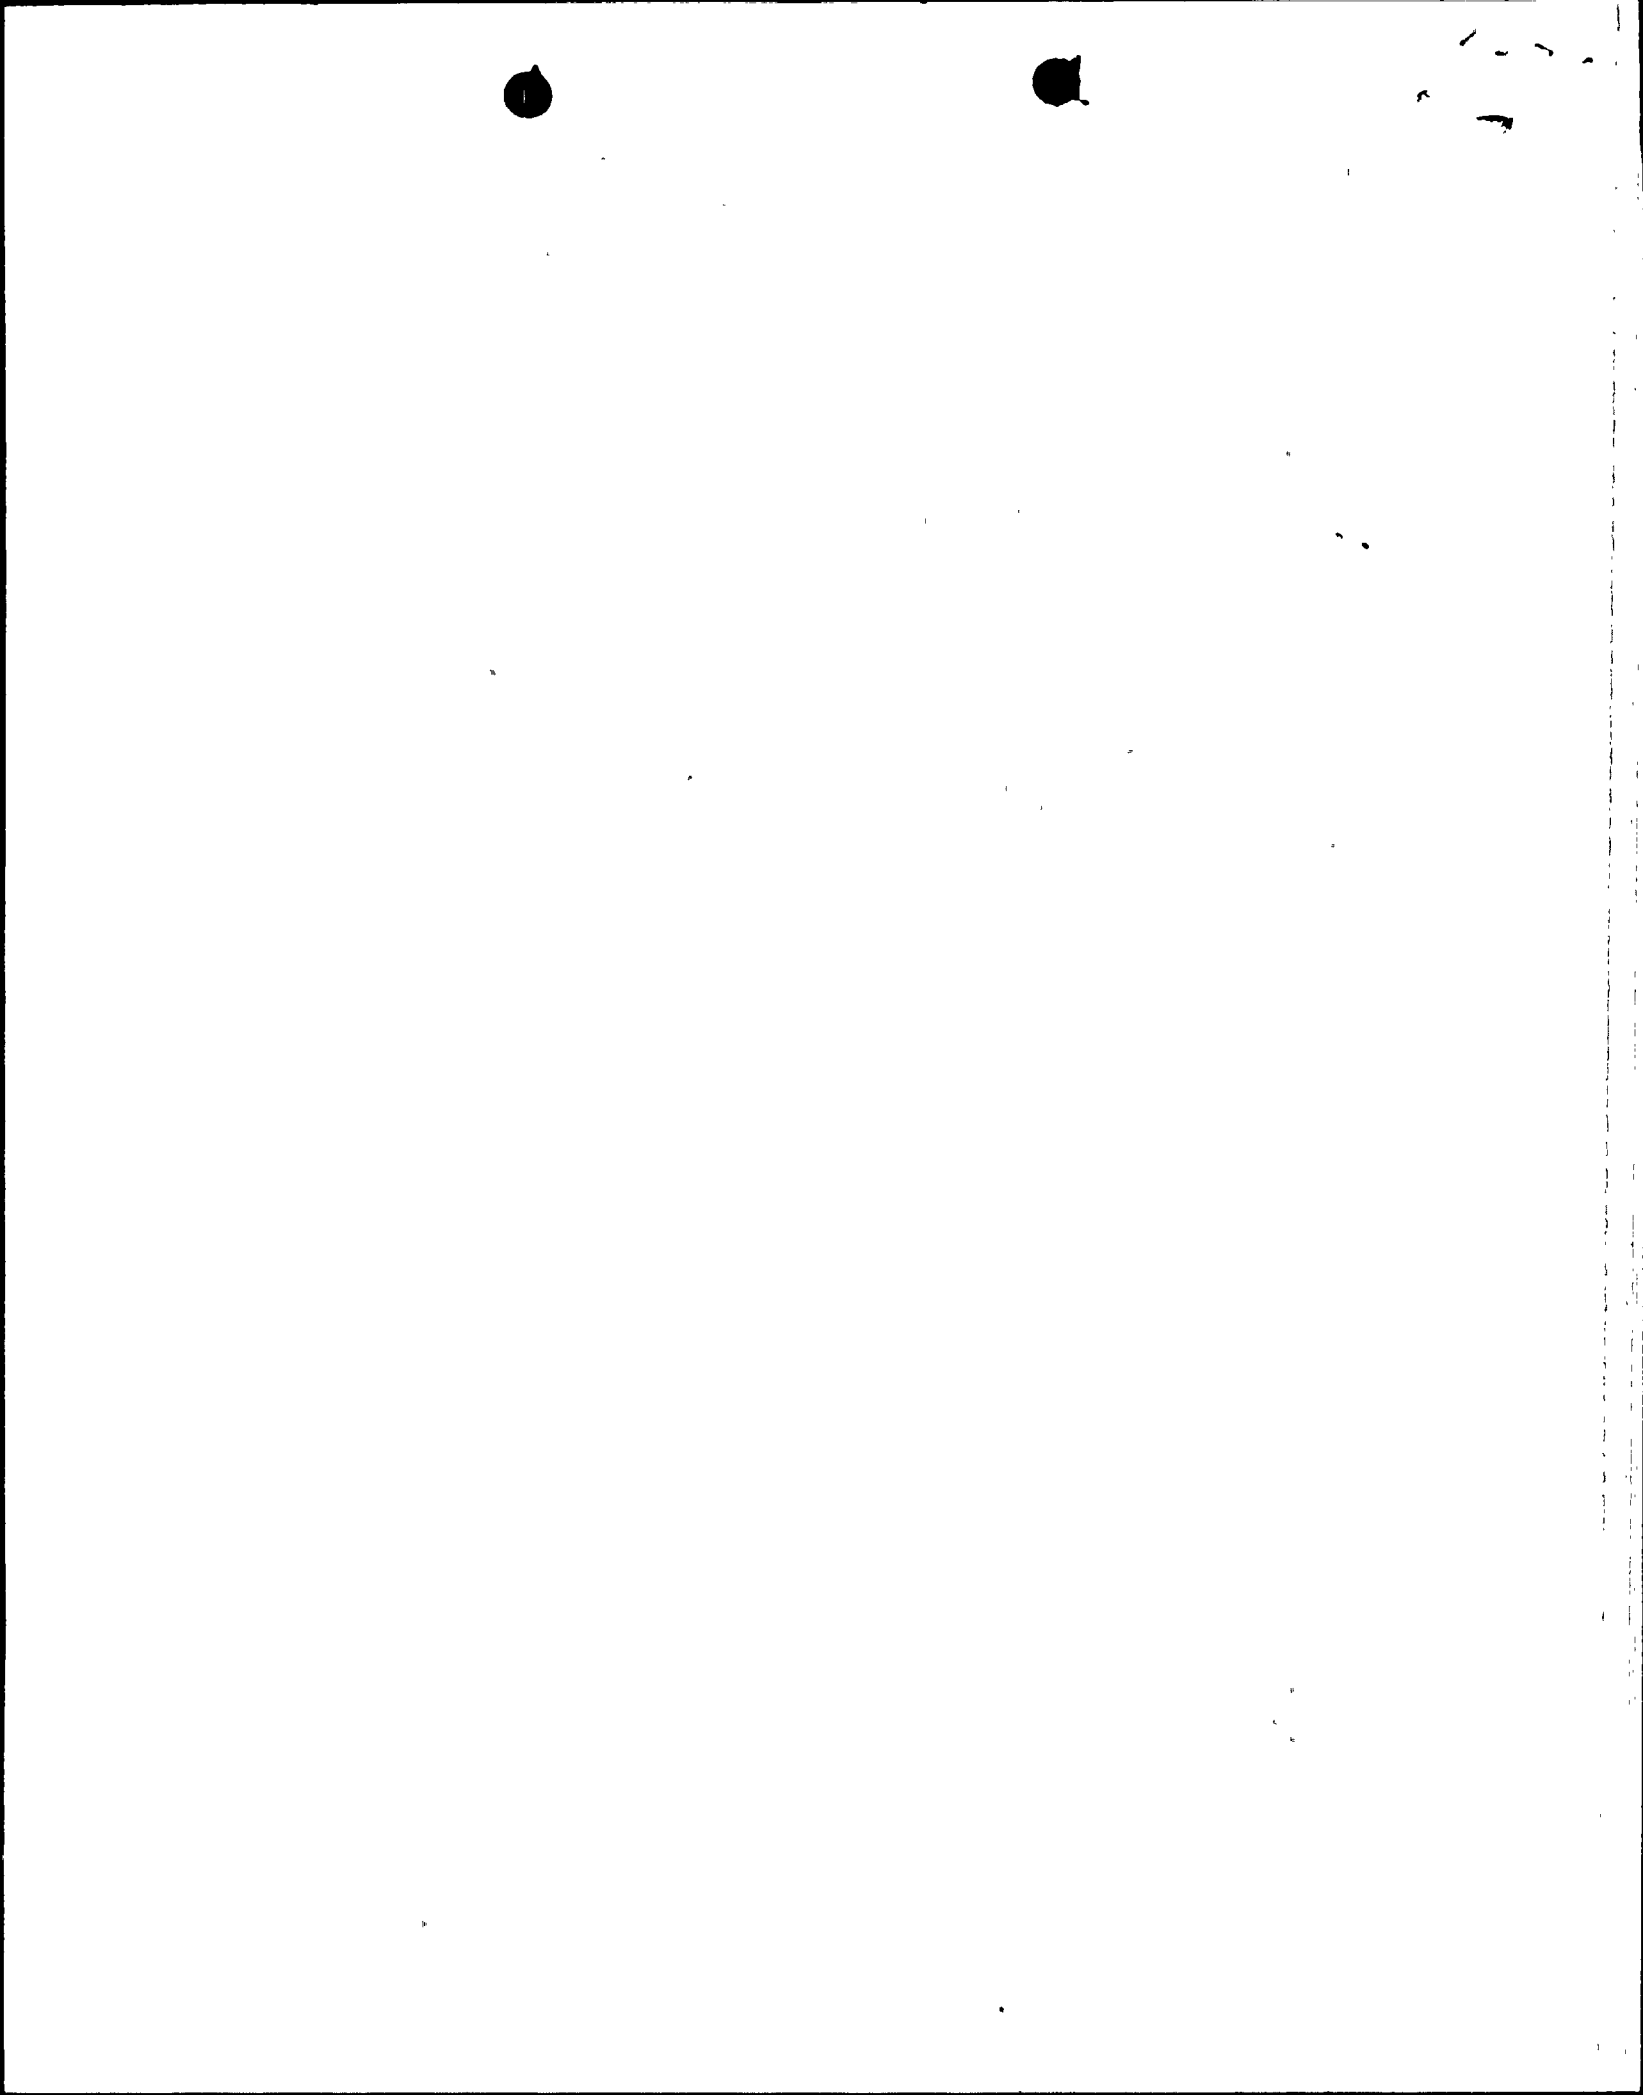


Director of Nuclear Reactor Regulation
February 10, 1981
ANPP-17268 - JMA/TFQ
Page 2

STATE OF ARIZONA)
) ss.
COUNTY OF MARICOPA)

I, Edwin E. Van Brunt, Jr., represent that I am Vice President Nuclear Projects of Arizona Public Service Company, that the foregoing document has been signed by me on behalf of Arizona Public Service Company with full authority so to do, that I have read such document and know its contents; and that to the best of my knowledge and belief, the statements made therein are true.

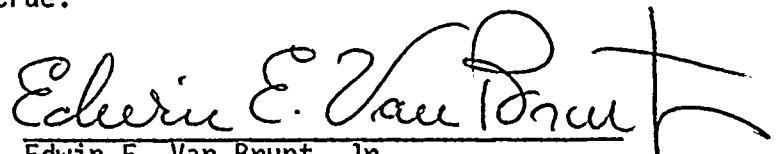
Edwin E. Van Brunt, Jr.

Sworn to before me this 13 day of FEBRUARY, 1981.


Notary Public

My Commission expires:

JAN 23, 1983

11-11-11
11-11-11

00

