

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8407100240 DOC. DATE: 84/07/03 NOTARIZED: YES DOCKET #
 FACIL: STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Public 05000528
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Public 05000529
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Public 05000530

AUTH. NAME AUTHOR AFFILIATION
 VAN BRUNT, E.E. Arizona Public Service Co.
 RECIPIENT NAME RECIPIENT AFFILIATION
 KNIGHTON, G. Licensing Branch 3

SUBJECT: Forwards response to NRC 840420 request for addl info re initial test program. Revised sections of FSAR Chapter 14 included in response. Proposed revs will be incorporated in upcoming FSAR amend.


DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 63
 TITLE: Licensing Submittal: PSAR/FSAR Amdts & Related Correspondence

NOTES: Standardized plant. 05000528
 Standardized plant. 05000529
 Standardized plant. 05000530

RECIPIENT ID CODE/NAME	COPIES LTR	ENCL	RECIPIENT ID CODE/NAME	COPIES LTR	ENCL
NRR/DL/ADL	1	0	NRR LB3 BC	1	0
NRR LB3 LA	1	0	LICITRA, E 01	1	1
INTERNAL: ELD/HDS3	1	0	IE FILE	1	1
IE/DEPER/EPB 36	3	3	IE/DEPER/IRB 35	1	1
IE/DQASIP/QAB21	1	1	NRR/DE/AEAB	1	0
NRR/DE/CEB 11	1	1	NRR/DE/EHEB	1	1
NRR/DE/EQB 13	2	2	NRR/DE/GB 28	2	2
NRR/DE/MEB 18	1	1	NRR/DE/MTEB 17	1	1
NRR/DE/SAB 24	1	1	NRR/DE/SGEB 25	1	1
NRR/DHFS/HFEB40	1	1	NRR/DHFS/LQB 32	1	1
NRR/DHFS/PSRB	1	1	NRR/DL/SSPB	1	0
NRR/DSI/AEB 26	1	1	NRR/DSI/ASB	1	1
NRR/DSI/CPB 10	1	1	NRR/DSI/CSB 09	1	1
NRR/DSI/ICSB 16	1	1	NRR/DSI/METB 12	1	1
NRR/DSI/PSB 19	1	1	NRR/DSI/RAB 22	1	1
NRR/DSI/RSB 23	1	1	REG FILE 04	1	1
RGNS	3	3	RM/DDAMI/MIB	1	0

EXTERNAL: ACRS 41	6	6	BNL (AMDTs ONLY)	1	1
DMB/DSS (AMDTs)	1	1	FEMA-REP DIV 39	1	1
LPDR 03	1	1	NRC PDR 02	1	1
NSIC 05	1	1	NTIS	1	1

TOTAL NUMBER OF COPIES REQUIRED: LTR 53 ENCL 46

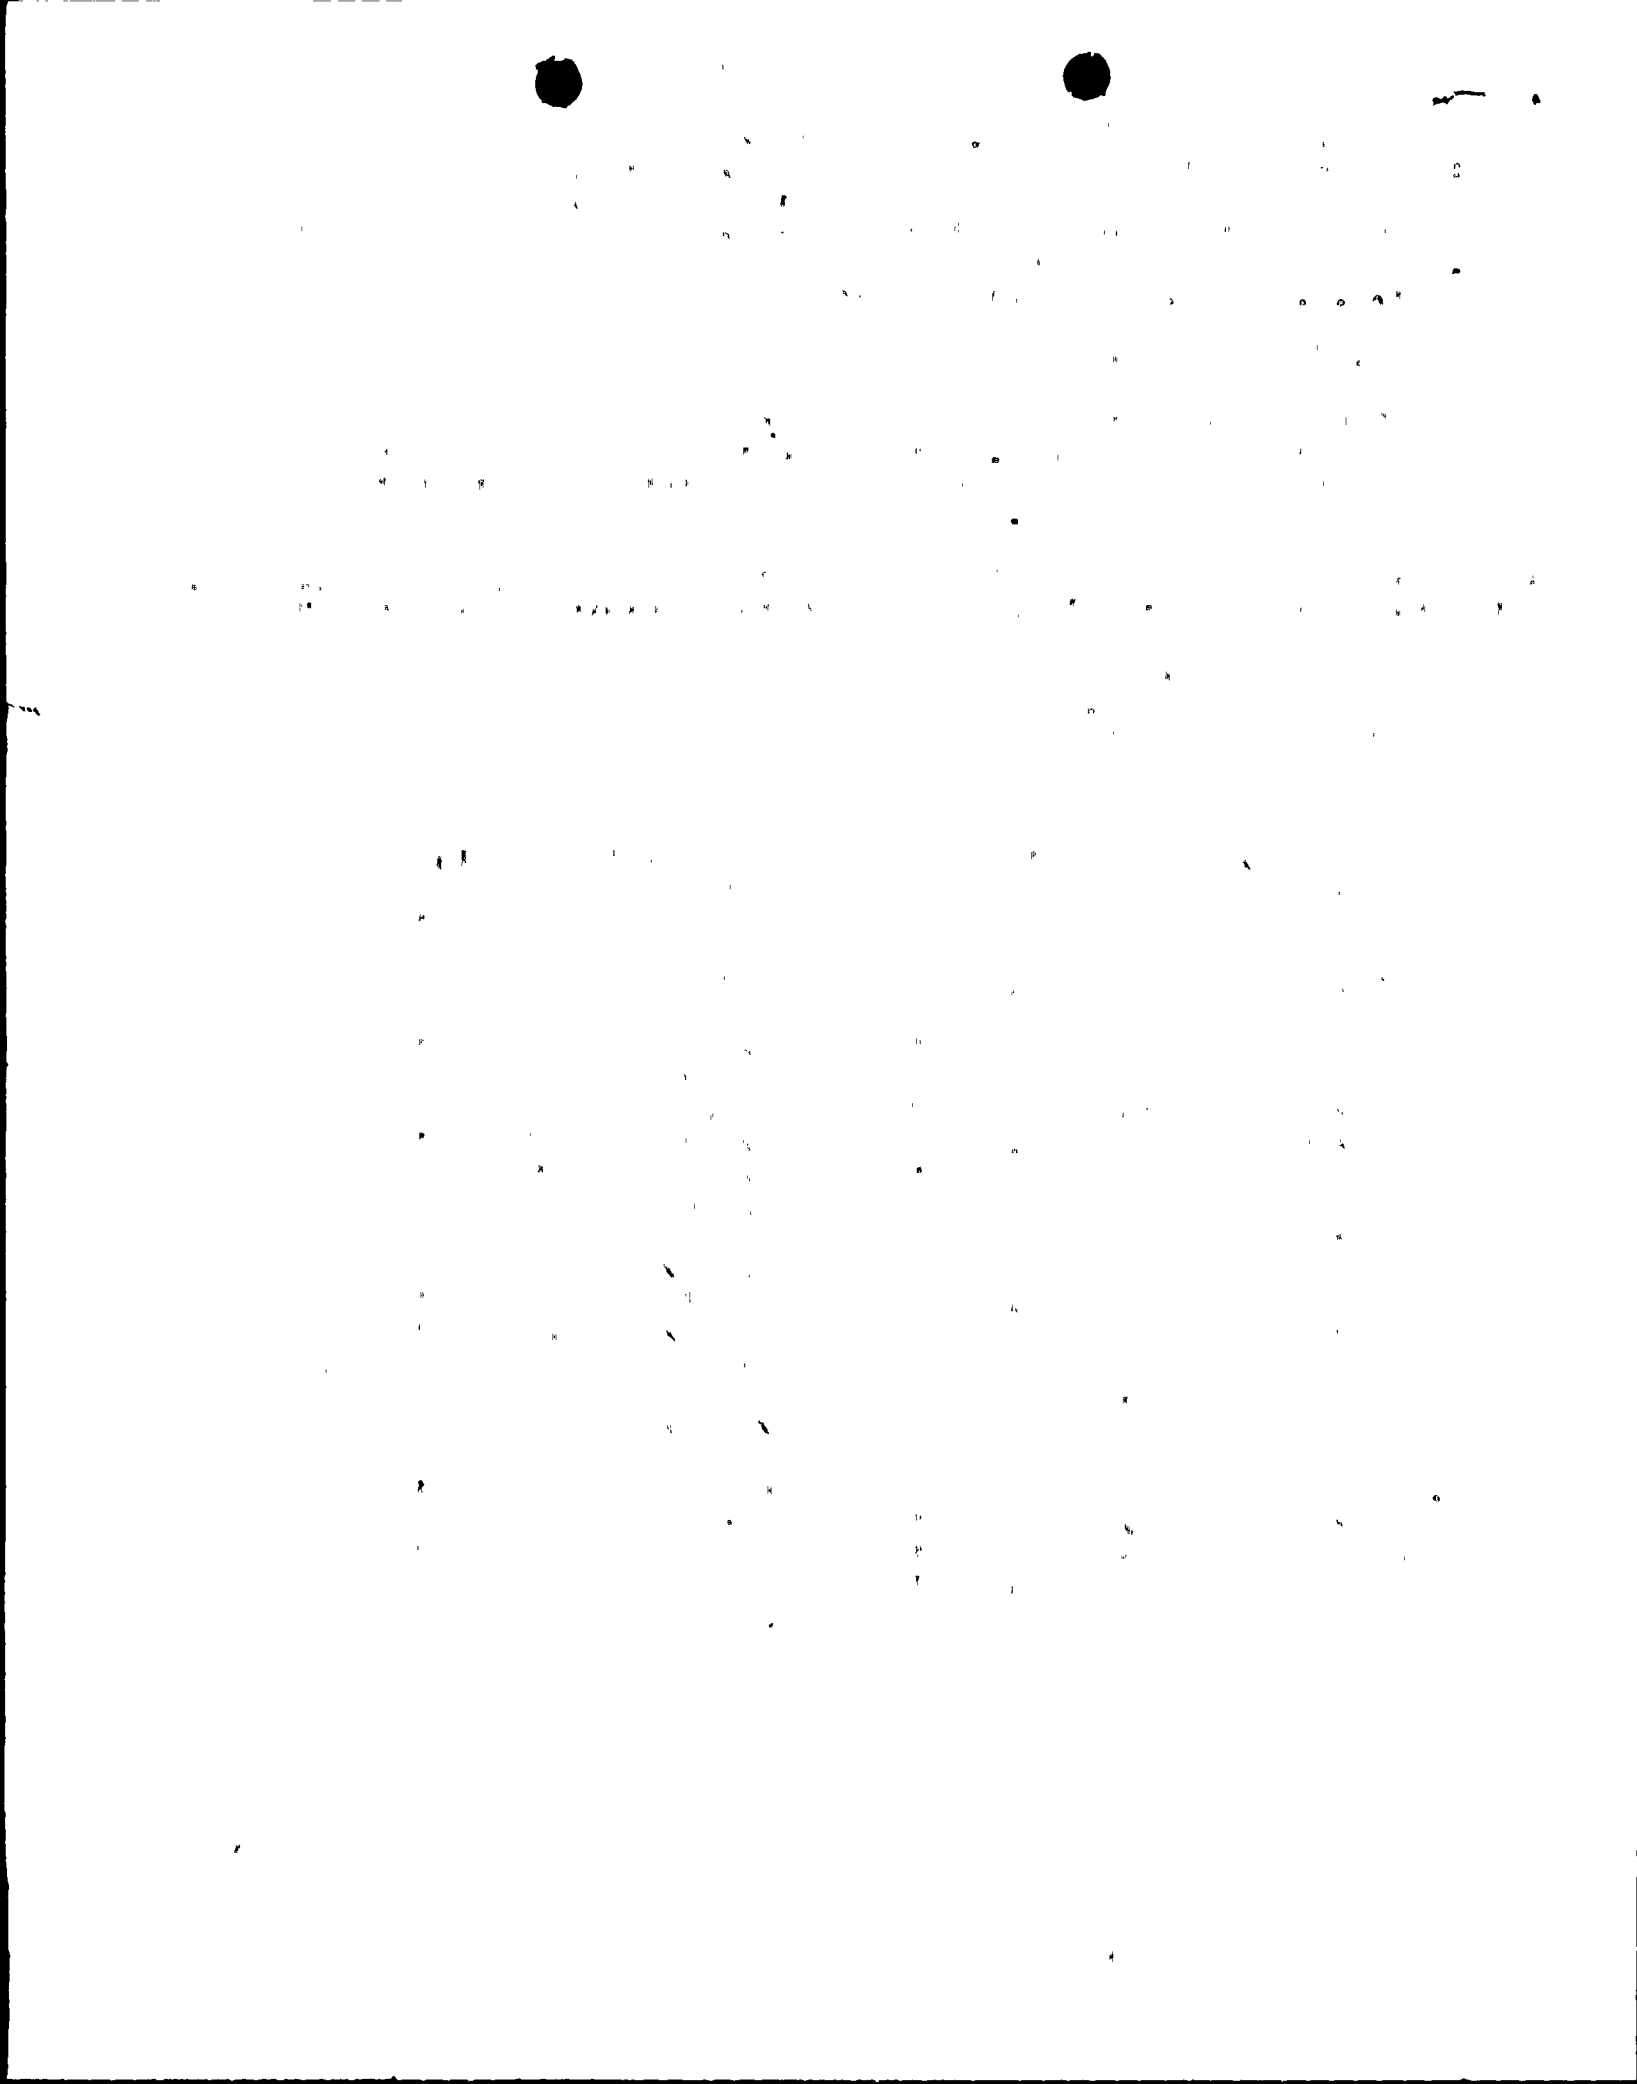

Arizona Public Service Company

P.O. BOX 21666 • PHOENIX, ARIZONA 85036

ANPP-29875-EEVBJr/WFQ/KEJ
July 3, 1984

Director of Nuclear Reactor Regulation
Attention: Mr. George Knighton, Chief
Licensing Branch No. 3
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Subject: Palo Verde Nuclear Generating Station (PVNGS)
Units 1, 2, and 3
Docket Nos. STN 50-528/529/530
File: 84-056-026; G.1.01.10

Reference: Letter from G. W. Knighton, NRC, to E. E. Van Brunt, Jr.,
APS, dated April 20, 1984. Subject: Request for Additional
Information - Initial Test Program for Palo Verde.

Dear Mr. Knighton:

Please find attached responses to the above referenced request for
additional information concerning the Initial Test Program for Palo
Verde.

Included in the responses to these questions are revised sections of
FSAR Chapter 14. These proposed revisions will be included in an
upcoming amendment to the FSAR.

If you have any further questions concerning this matter, please
contact me.

Very truly yours,

EE Van Brunt/ask

E. E. Van Brunt, Jr.
APS Vice President
Nuclear Production
ANPP Project Director

EEVBJr/KEJ/mb
Attachment

8407100240 840703
PDR ADOCK 05000528
A PDR

Boo!
rk

STATE OF ARIZONA)
) ss.
COUNTY OF MARICOPA)

I, Donald Karner, represent that I am Assistant Vice President, Nuclear Production of Arizona Public Service Company, that the foregoing document has been signed by me on behalf of Arizona Public Service Company with full authority to do so, that I have read such document and know its contents, and that to the best of my knowledge and belief, the statements made therein are true.

Donald Karner
Donald Karner


Sworn to before me this 6th day of July, 1984.

Dora E. Meador
Notary Public

My Commission Expires:

My Commission Expires April 6, 1987

100

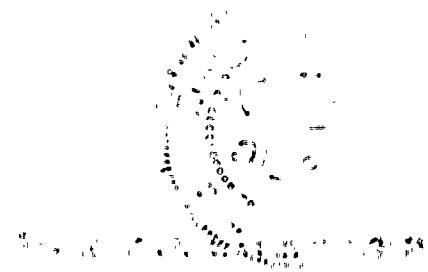

Mr. George Knighton
Initial Test Program
Page 2

cc: E. E. Van Brunt, Jr. (4060) (w/a)
D. B. Karner (4060) (w/a)
A. C. Rogers (4056) (w/a)
W. E. Ide (4074) (w/a)
W. F. Quinn (4057) (w/a)
T. F. Quan (4057) (w/a)
J. Y. Morita (4057) (w/a)
M. A. Jones (4057) (w/a)
M. J. Winsor (6254) (w/a)
T. G. Woods (1910) (w/a)
K. W. Gross (6088) (w/a)
S. R. Frost (4080) (w/a)
J. E. Kirby (6249) (w/a)
J. R. Bynum (6125) (w/a)
D. R. Canady (1390) (w/a)
O. J. Zeringue (6130) (w/a)
J. D. Houchen (6130) (w/a)
R. A. Ferguson (6225) (w/a)
A. C. Gehr (4141) (w/a)
E. A. Licitra (NRC) (w/a)
W. H. Wilson (Bldg 43) (w/a)
S. Shepherd (Bldg 43) (w/a)



1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65
66
67
68
69
70
71
72
73
74
75
76
77
78
79
80
81
82
83
84
85
86
87
88
89
90
91
92
93
94
95
96
97
98
99
100

NRC Question:

640.15 In response to Item 640.2 (Question 14A.3), you stated that response will be provided on the CESSAR docket. Provide a specific reference for that response.

APS Response:

Combustion Engineering submitted the Comprehensive Vibration Assessment Program (CVAP) report from the prototype System, 80 plant (ie. Palo Verde) for NRC review in a letter from A. E. Scherer, CE, to Darrell G. Eisenhut, NRC, dated February 16, 1984 (LD-84-008). A copy of the cover letter is attached.



er 2

.

.

.

.

.