

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR: 8712090029 DOC. DATE: 87/12/02 NOTARIZED: NO DOCKET #
 FACIL: STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529
 AUTH. NAME AUTHOR AFFILIATION
 VAN BRUNT, E. E. Arizona Nuclear Power Project (formerly Arizona Public Serv
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Application for amend to License NPF-41, changing Tech Specs ⁵⁸⁶
 to ensure that adequate shutdown margin maintained in _{7.5}
 reactor at all times.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3 + 109
 TITLE: OR Submittal: General Distribution

NOTES: Standardized plant. 05000529

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PDS LA	1 0	PDS PD	5 5
	LICITRA, E	1 1	DAVIS, M.	1 1
INTERNAL:	ACRS	6 6	ARM/DAF/LFMB	1 0
	NRR/DEST/ADS	1 1	NRR/DEST/CEB	1 1
	NRR/DEST/MTB	1 1	NRR/DEST/RSB	1 1
	NRR/DOEA/TSB	1 1	NRR/PMAS/ILRB	1 1
	OGC/HDS1	1 0	<u>REG FILE</u> 01	1 1
	RES/DE/EIB	1 1		
EXTERNAL:	LPDR	1 1	NRC PDR	1 1
	NSIC	1 1		
NOTES:		1 1		

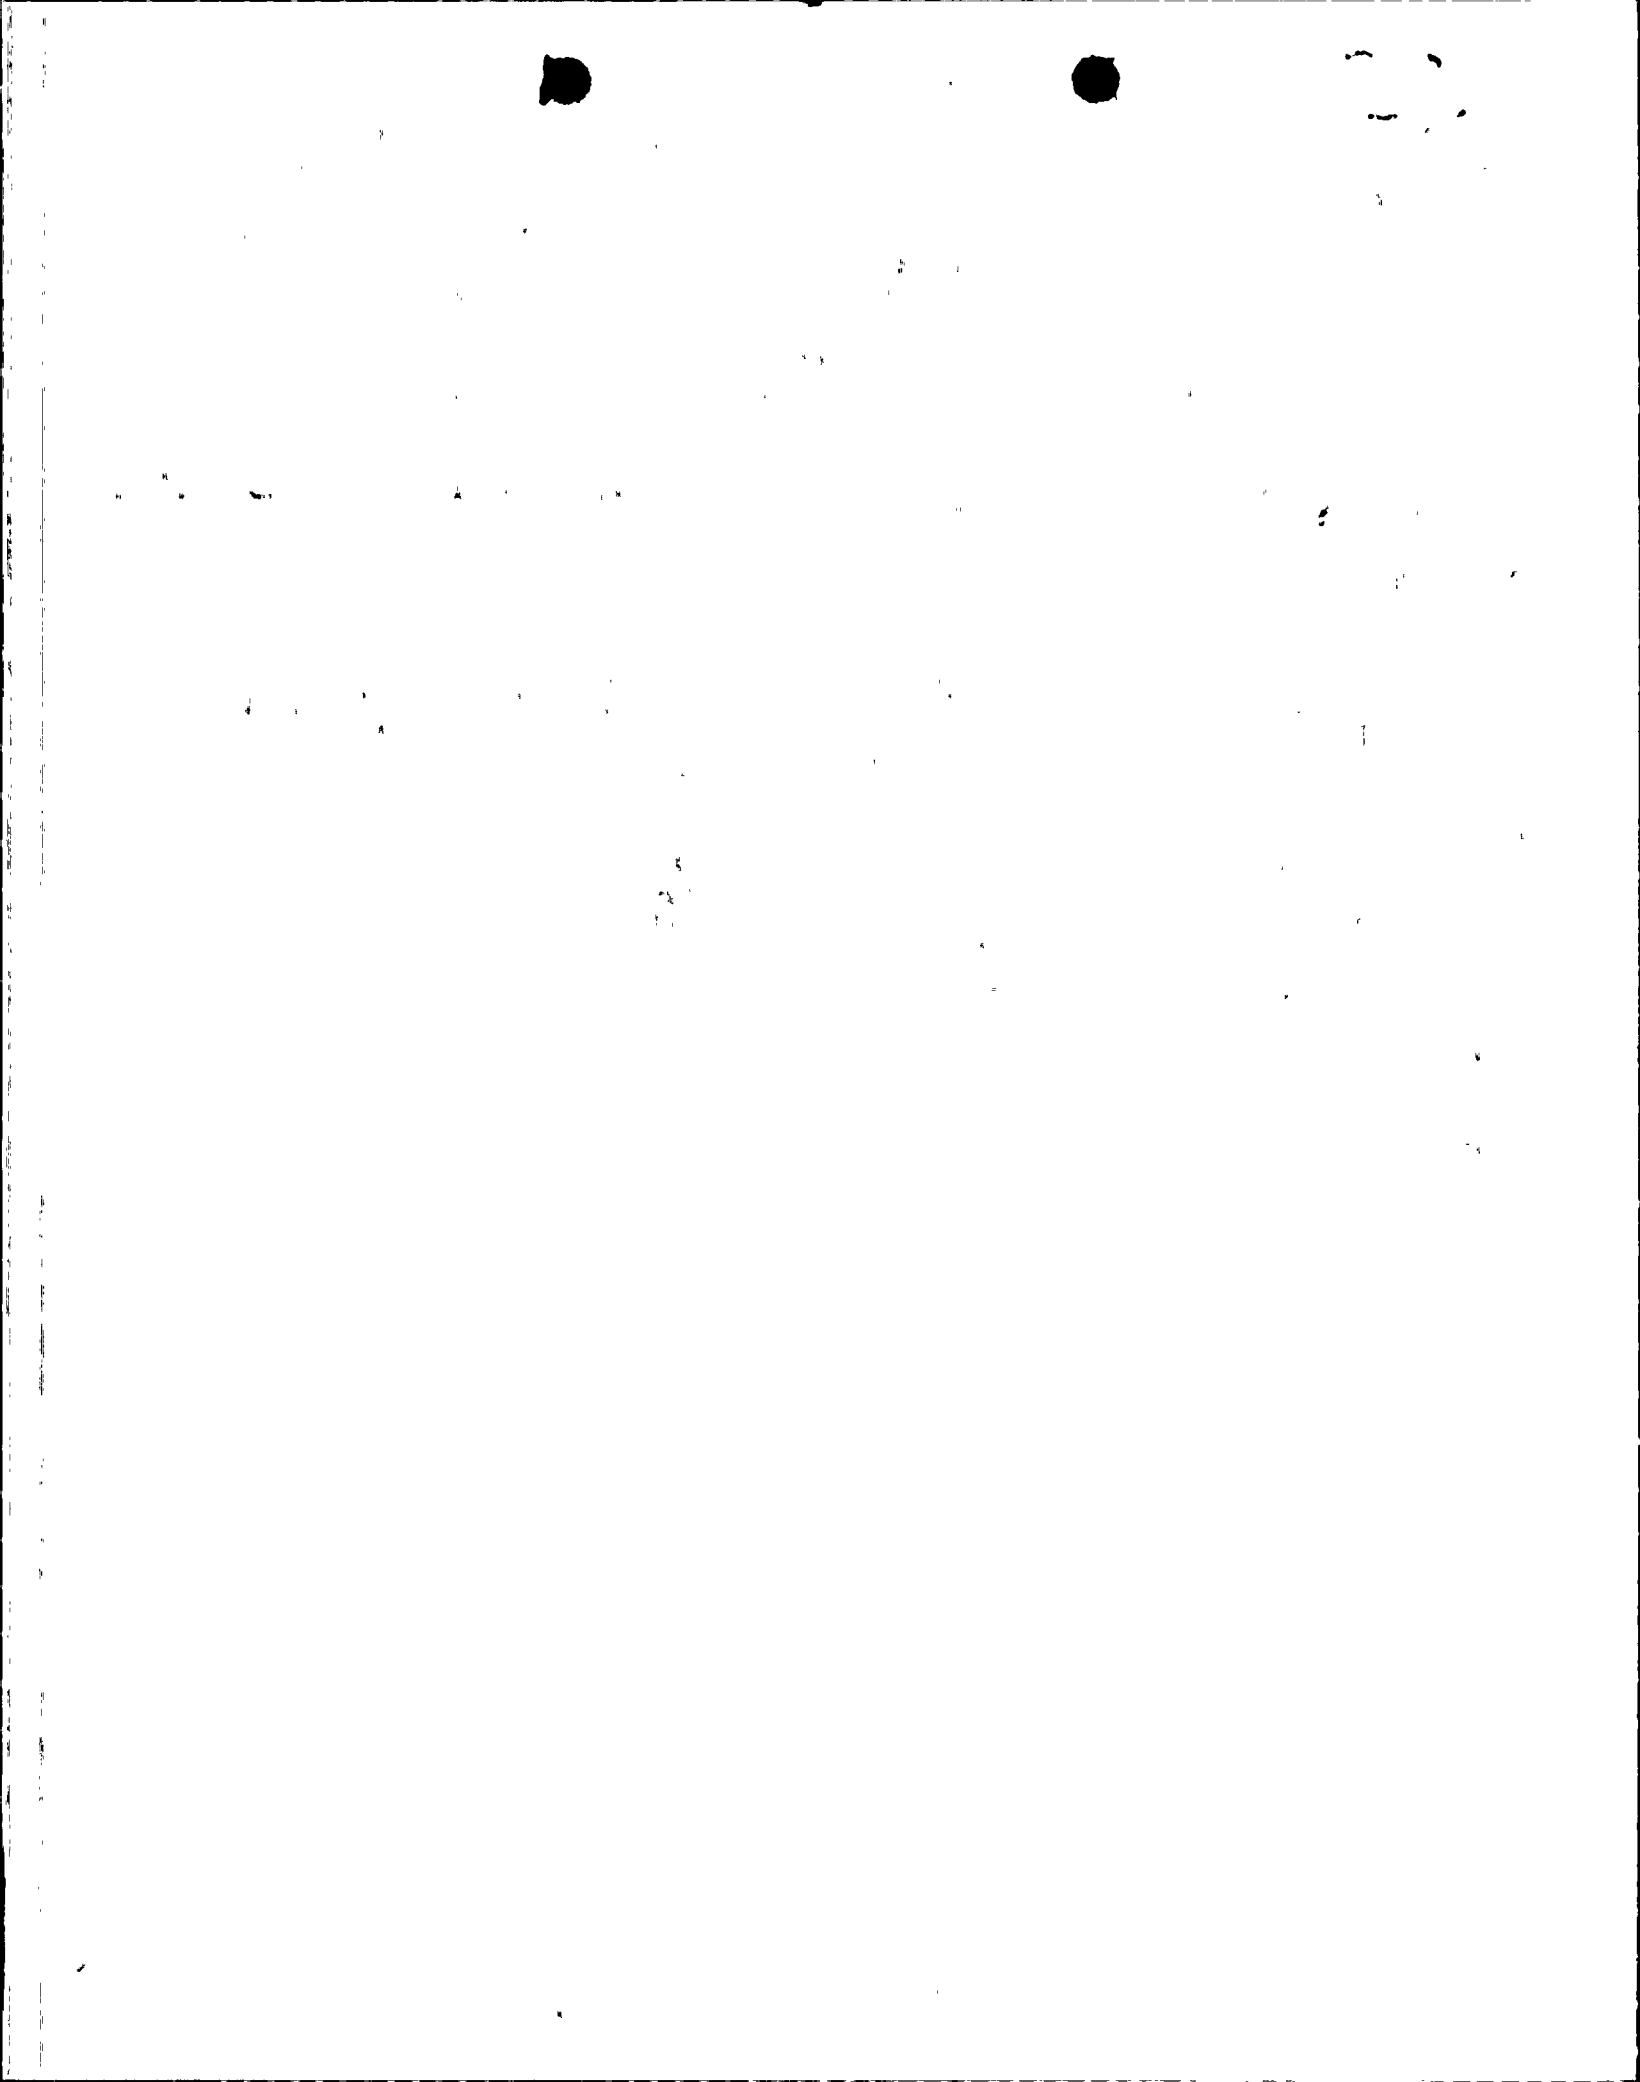



Arizona Nuclear Power Project

P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

December 2, 1987
161-00680-EEVB/LJM

Docket No. STN 50-529

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, D.C. 20555

Dear Sir:

Subject: Palo Verde Nuclear Generating Station (PVNGS)
Unit 2
Reload Technical Specification Amendment -
File: 87-F-005-419.05; 87-C-056-026; 87-E-056-026

Attached please find proposed changes to the PVNGS Unit 2 Technical Specifications. These changes are a result of the upcoming reload. To facilitate the review, an index of the changes has been included. The attachments have been ranked in the order that a review and approval is needed. The due dates are based on the current outage schedule and reflect the date when the Unit will enter the first applicable mode for that attachment. To facilitate the review process, the index identifies, by double asterisks, those attachments which are new or contain different changes than those changes made in the Unit 1 Cycle 2 amendment submittal. Also, those attachments which are not needed for starting the Unit have been identified by an asterisk.

Enclosed, with this amendment request package, are the following:


- A. Description of the Technical Specification Amendment Request.
- B. Purpose of the Technical Specification.
- C. Need for the Technical Specification Amendment.
- D. Basis for Proposed No Significant Hazards Consideration Determination.
- E. Safety Analysis for the Amendment Request.
- F. Environmental Impact Consideration Determination.
- G. Marked-up Technical Specification Change Pages.

By copy of this letter, we are also forwarding the proposed changes to the appropriate state agency.

In accordance with the requirements of 10 CFR 170.12(c), the license amendment application fee of \$150.00 has been forwarded to the U.S. NRC License Fee Management Coordinator.

8712090029 871202
PDR ADDCK 05000529
P PDR


Aool
1/1

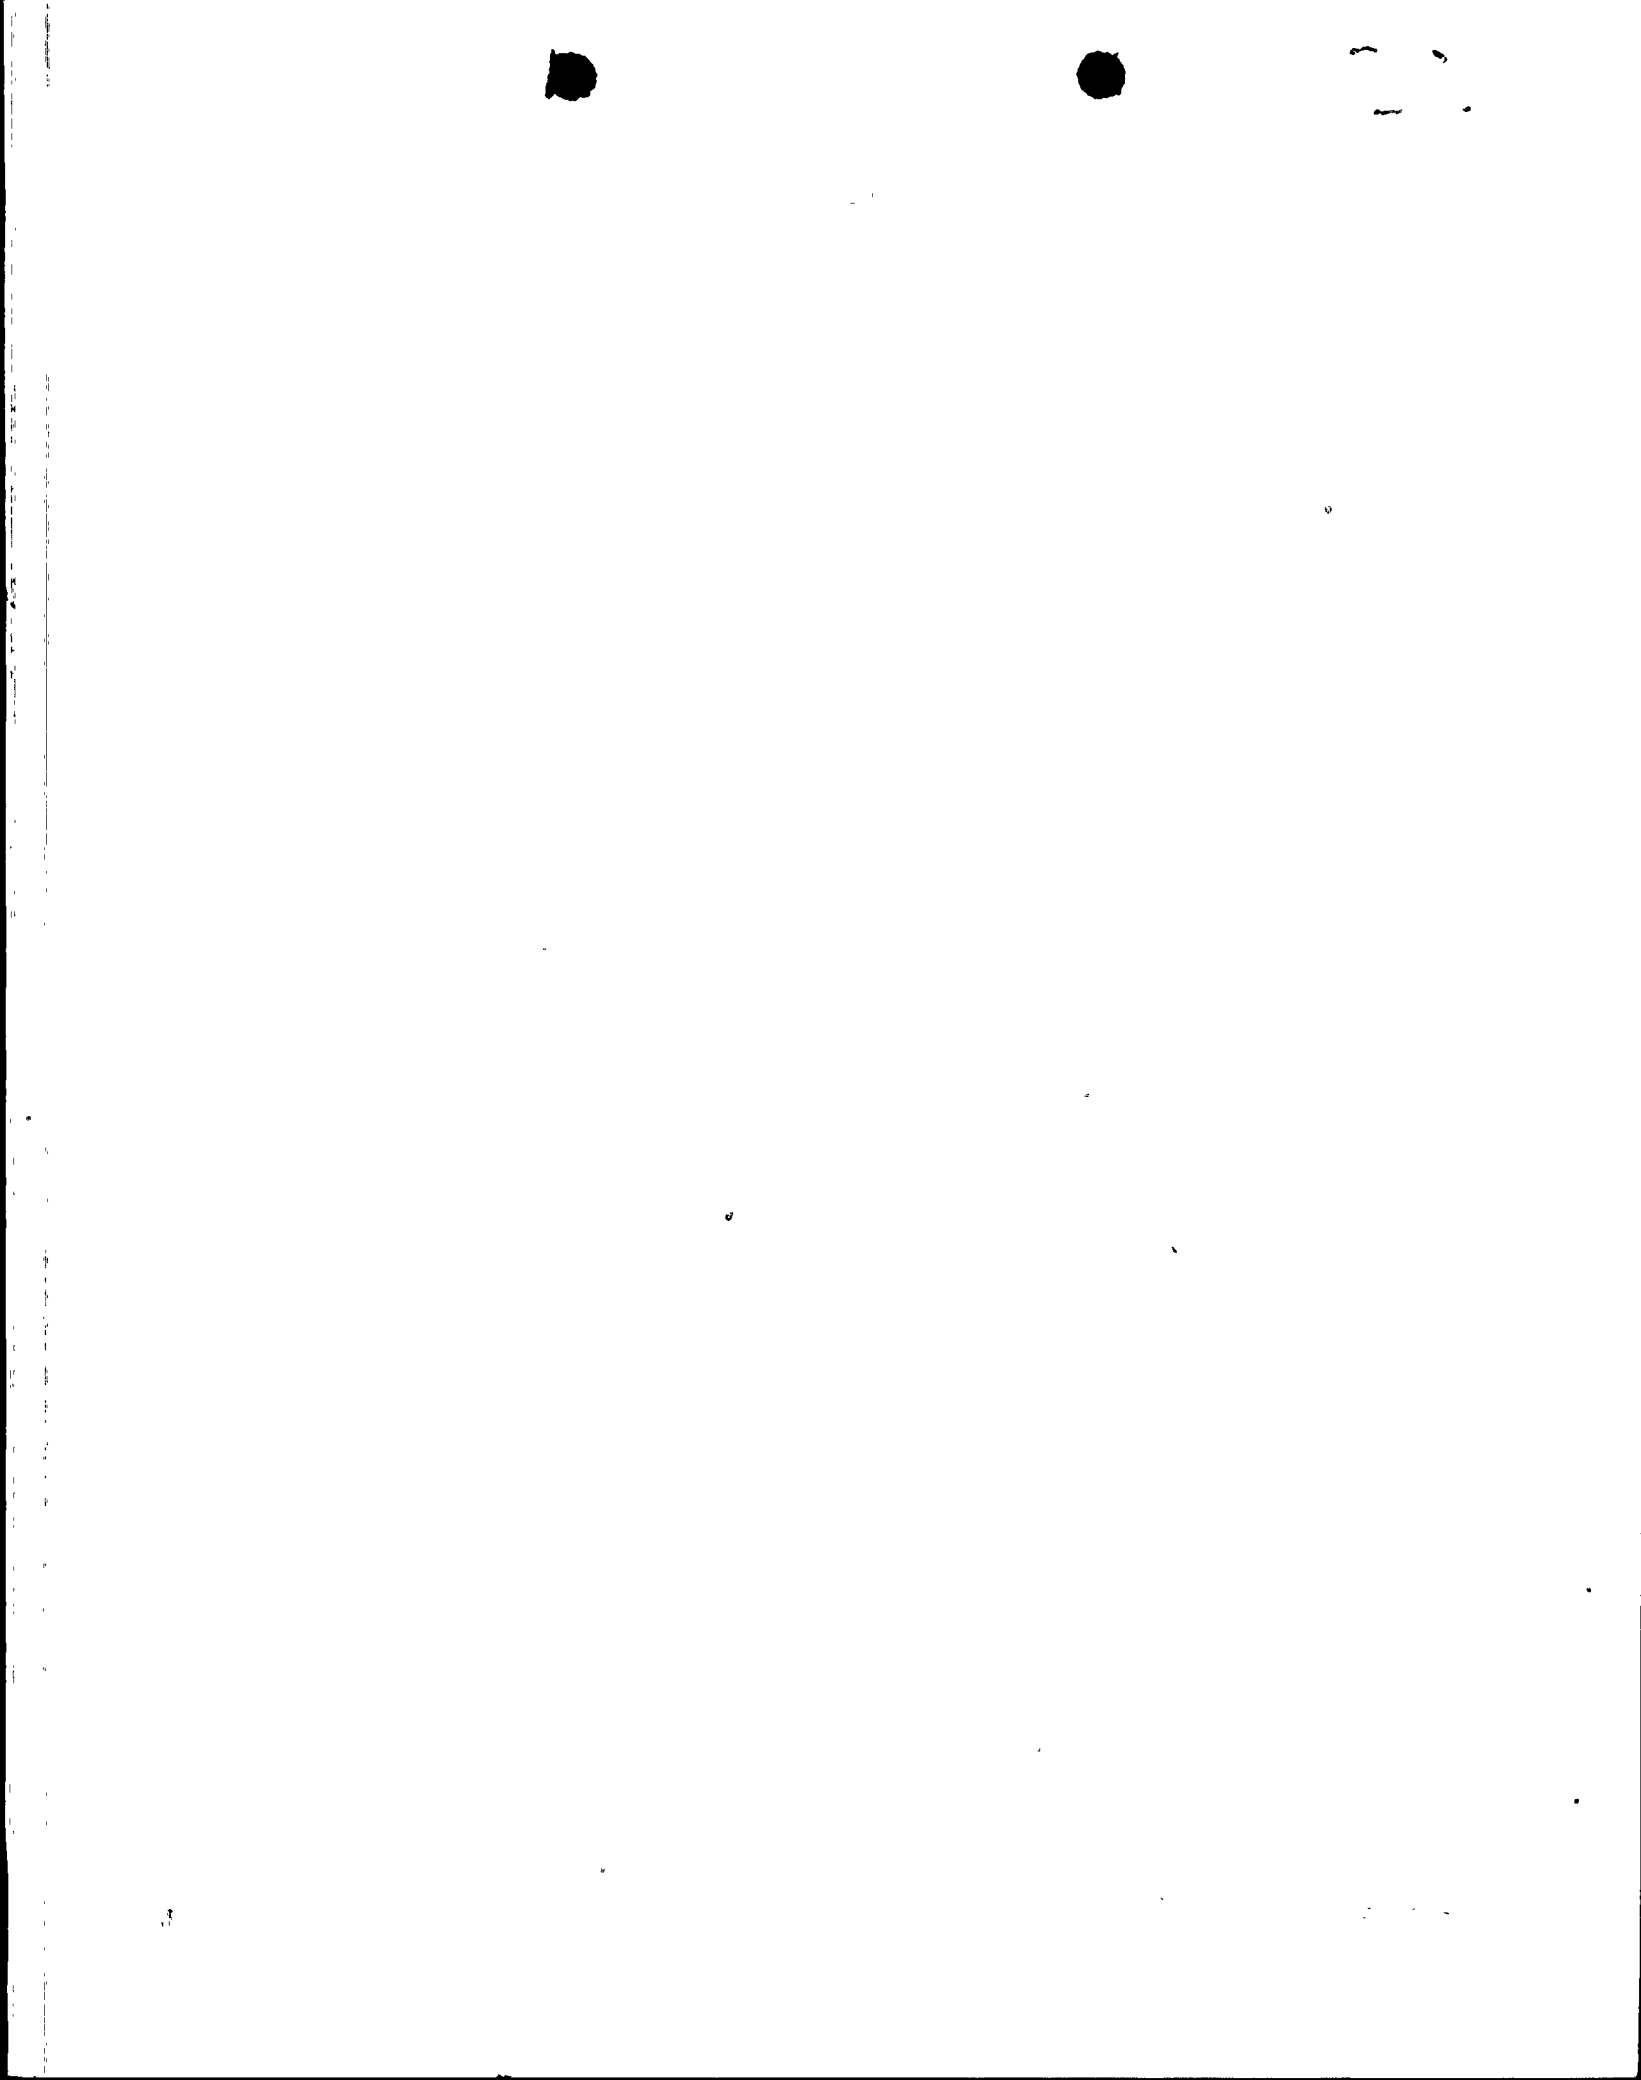

December 2, 1987
161-00680-EEVB/LJM

If you have any questions, please call A. C. Rogers at (602) 371-4087.

Very truly yours,

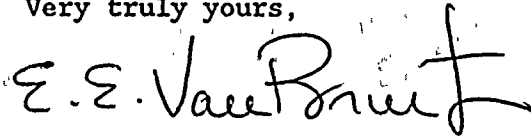

E. E. Van Brunt, Jr.
Executive Vice President
Project Director

EEVB/LJM/l
Attachments

cc: O. M. De Michele
G. W. Knighton
J. R. Ball
J. B. Martin
E. A. Licitra
A. C. Gehr
C. E. Tedford



11-11-68

1. The first part of the report is a general description of the project and its objectives. It also includes a brief history of the project and a list of the people who have been involved in it.

2. The second part of the report is a detailed description of the methods used in the project. This includes a description of the equipment used, the procedures followed, and the data collected.

3. The third part of the report is a discussion of the results of the project. This includes a comparison of the results with those of other projects, a discussion of the strengths and weaknesses of the methods used, and a conclusion about the overall success of the project.

INDEX

TITLE	DESCRIPTION	TECHNICAL SPECIFICATION	NEED DATE
Attachment 1	Shutdown Margin	3/4.1.1.2	3/23/88
Attachment 2	MTC	3/4.3.1.1.3	4/28/88
Attachment 3	Pressurizer Pressure	3/4.2.8	4/28/88
Attachment 4	Part-length GEA	3/4.1.3.1	4/28/88
Attachment 5	Reactor Protection Instrumentation	3/4.3.1	4/28/88
Attachment 6	Power Dependent Insertion Limit	3/4.1.3.6	4/28/88
Attachment 7	RTD	3/4.3.1	4/28/88
Attachment 8	DNBR	2.1.1.1	4/28/88
Attachment 9	RCS Flow Rate	3/4.2.5	4/28/88
Attachment 10	Linear Heat Rate	3/4.2.1	4/28/88
Attachment 11	DNBR Margin Monitoring	3/4.2.4	4/28/88
** Attachment 12	Azimuthal Tilt	3/4.2.3	4/28/88
* Attachment 13	ESFAS Instrumentation	3/4.3.2	4/28/88
**,* Attachment 14	Administration	Various	

* These proposed changes are not required for starting up the Unit.

** Attachment 12 was not requested in the Unit 1 Cycle 2 reload package. Attachment 14 is not the same as the Unit 1 Cycle 2 submittal. Unit 2 Tech Specs do not contain the paragraph which makes reference to a CE topical. The topical had been revised and was so noted in the Unit 1 Cycle 2 reload package.

