
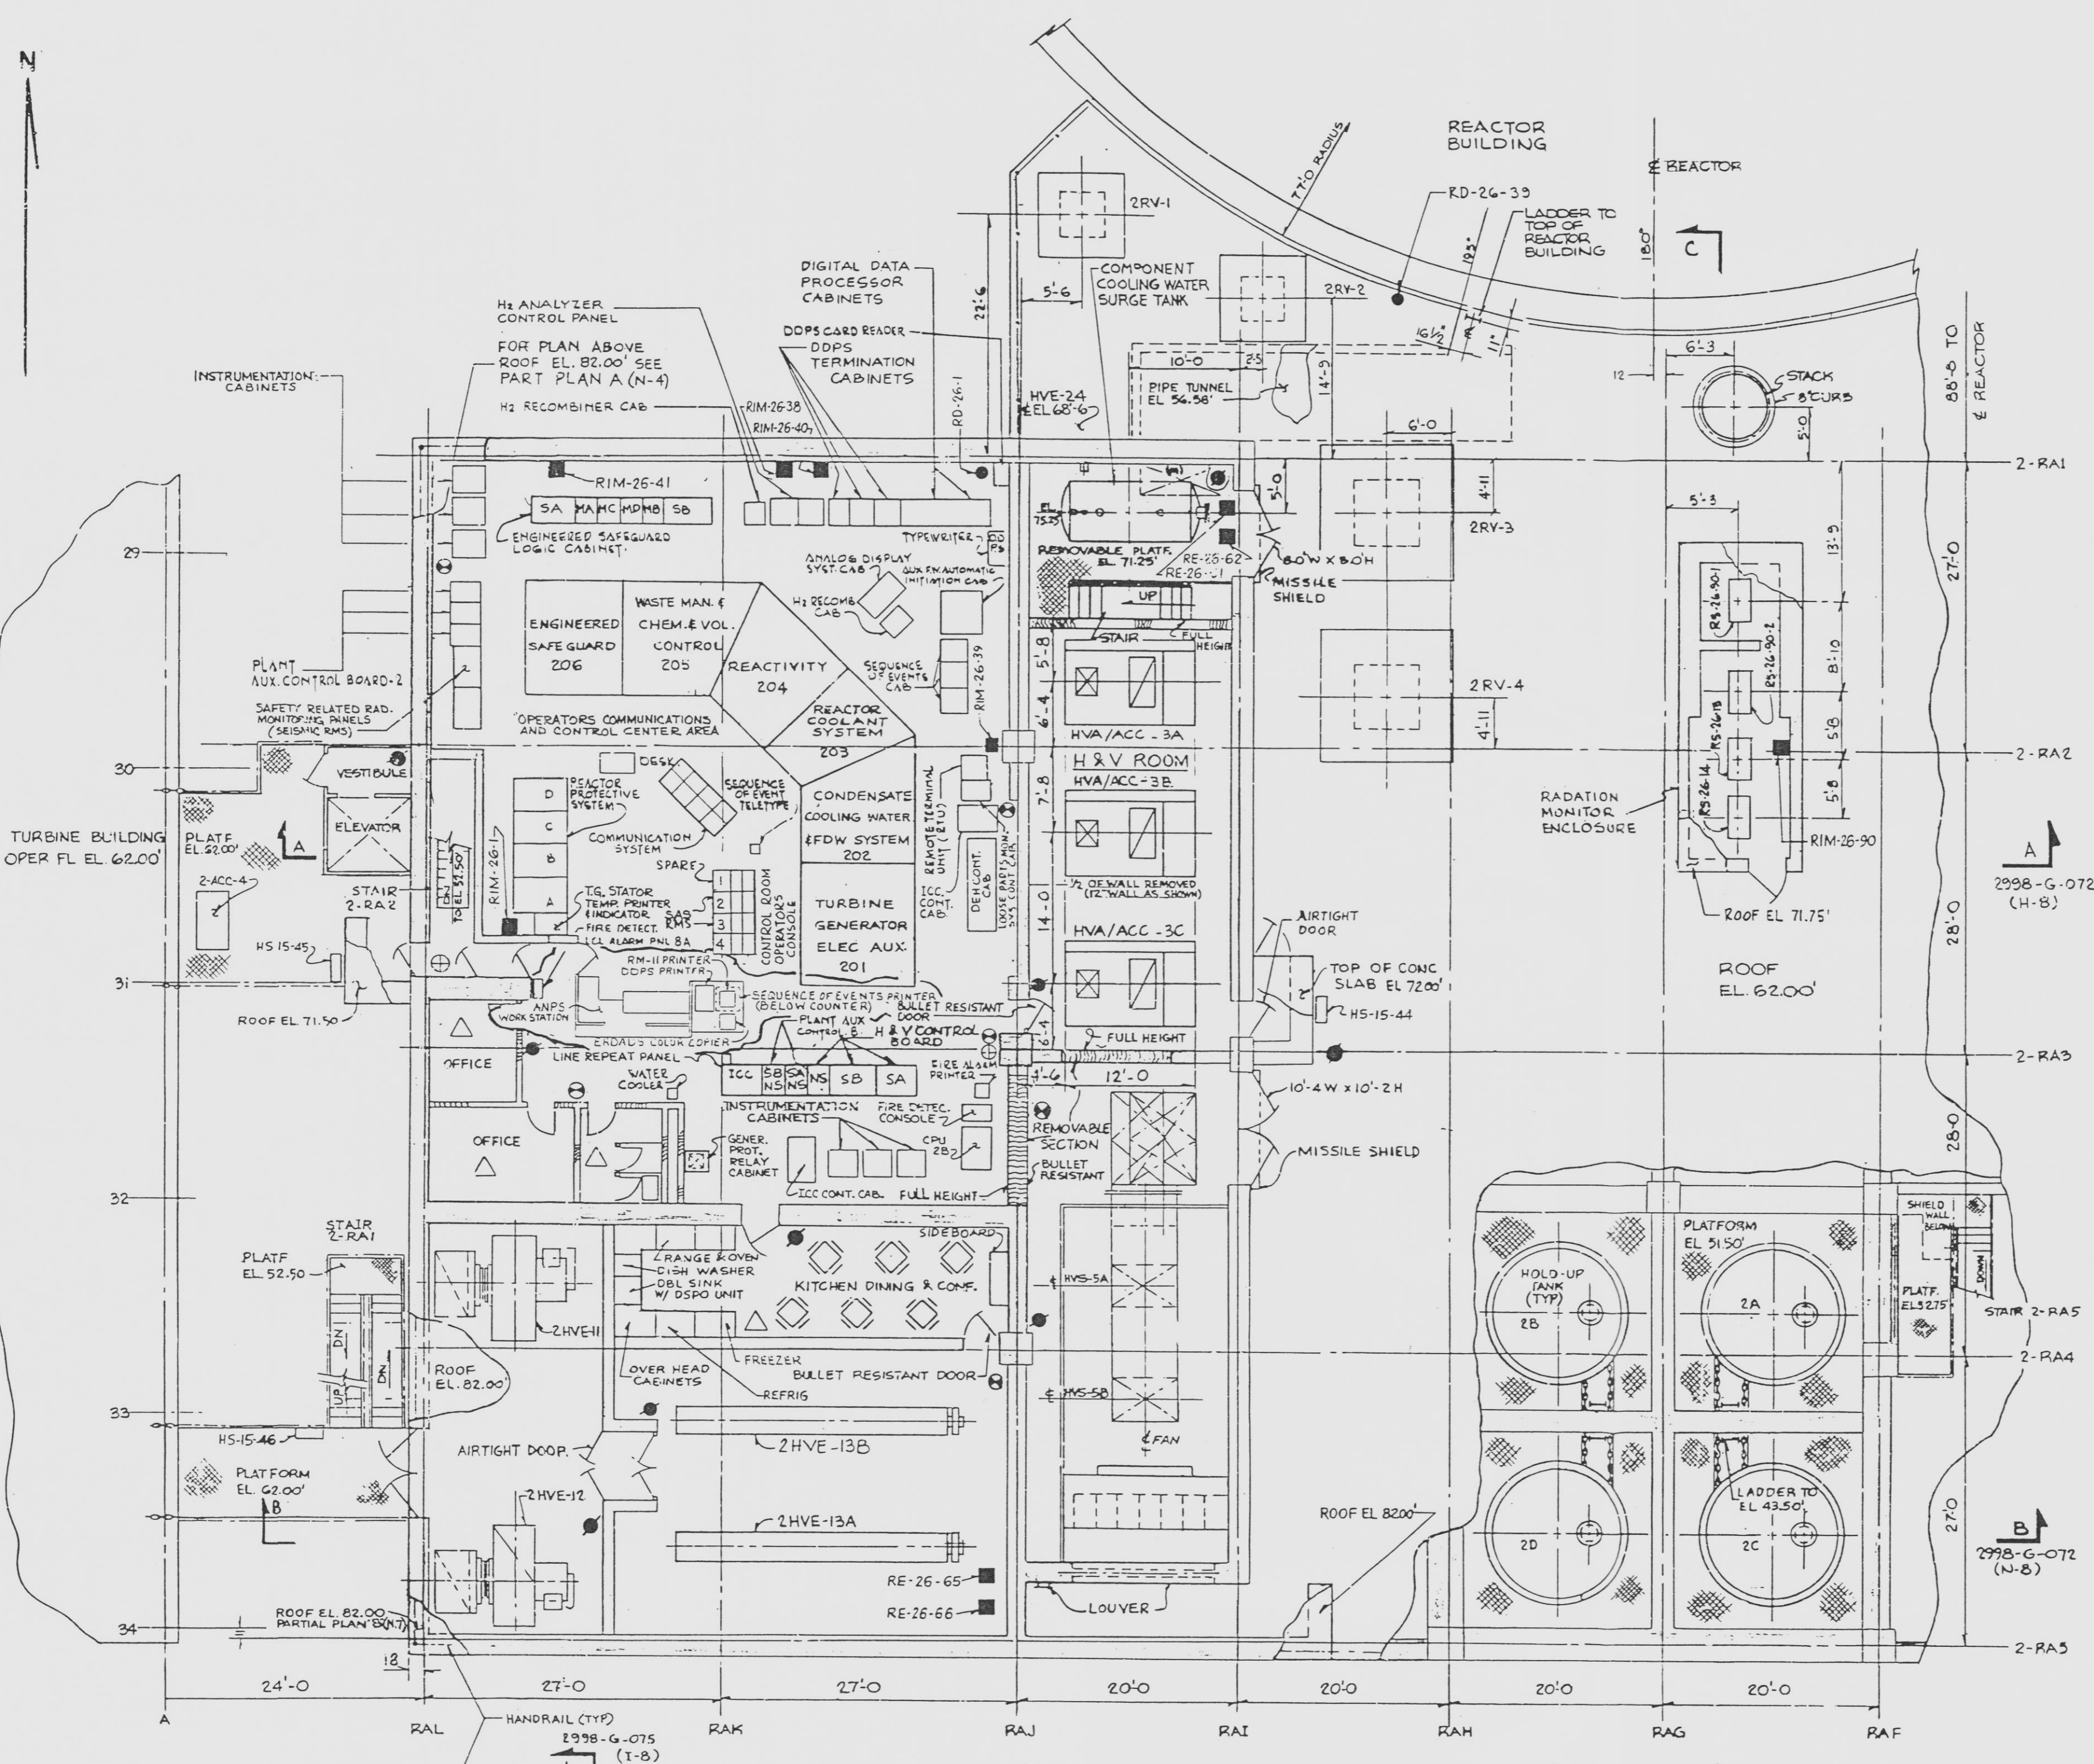


REVISIONS				
NO	DATE	DESCRIPTION	BY	APPROVED
13	10-14-94	THIS DOCUMENT HAS BEEN PHOTOGRAPHICALLY REPRODUCED FOR PREVIOUS REV BLOCKS SEE RECORD MALAR 2998-G-076 REV 13		
14	3/22/95	ADVERT (11) SURGE TANK. GENERAL DELETED; (B15) KEY PLAN.	J.F.T.	
15	3/29/95	PC/M 077-287: REV: (F4,G3) GAS EQUIPMENT	RC	
16	10-25-96	PC/M 081-933 REVISED: COMMUNICATION CONSOLE (G-1)		
	20M 931-91	REV: (G4-G6) ANPS WORK STATION		

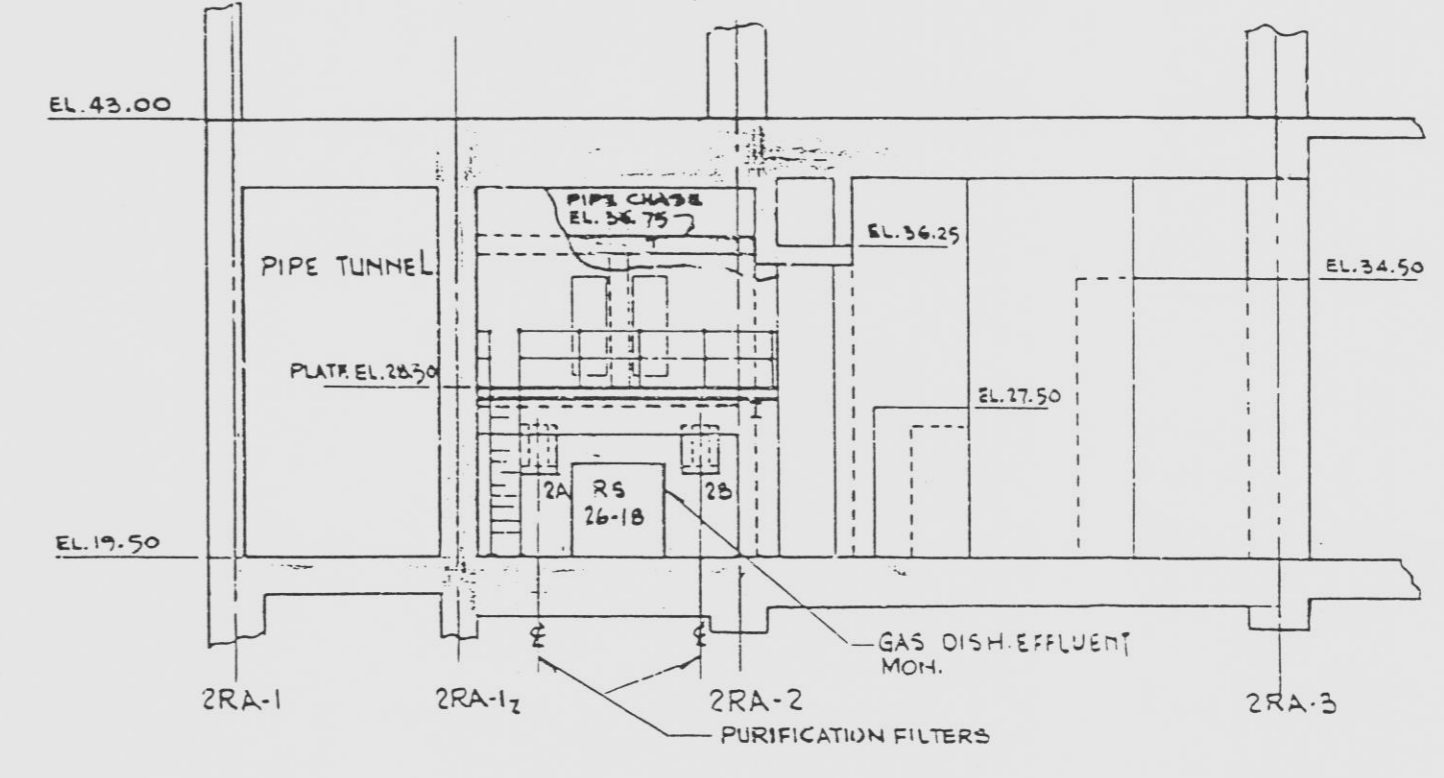

DRAWING NUMBER
2998-G-076
REV. 16


DRAWING NUMBER
2998-G-076
REV. 16

DRAWING NUMBER
2998-G-076
REV. 16

DRAWING NUMBER
2998-G-076
REV. 16

DRAWING NUMBER
2998-G-076
REV. 16

NOTE
1. FOR GENERAL NOTES, REFERENCE DRAWINGS & LEGEND SEE 2998-G-069

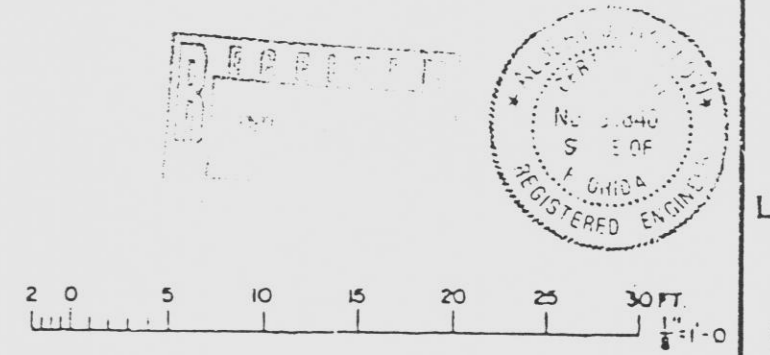

ANSTEC APERTURE CARD

INFORMATION ONLY
VERIFY WITH A CONTROL COPY BEFORE USE.

97180400 15-98

THE DESIGN INFORMATION FOR THE CHANGES SHOWN IN THIS REVISION HAS BEEN ENGINEERED BY FLORIDA POWER & LIGHT COMPANY.

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF SEPTEMBER 1, 1975 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983-800 MW STENSION UNIT # 2

GENERAL ARRANGEMENT
REACTOR AUXILIARY BUILDING
MISCELLANEOUS PLANS & SECTIONS

EBASCO SERVICES INCORPORATED

SCALE 1/8"=1'-0"
DATE OCT 27, 1996
2998-G-076

