


2998-G-878

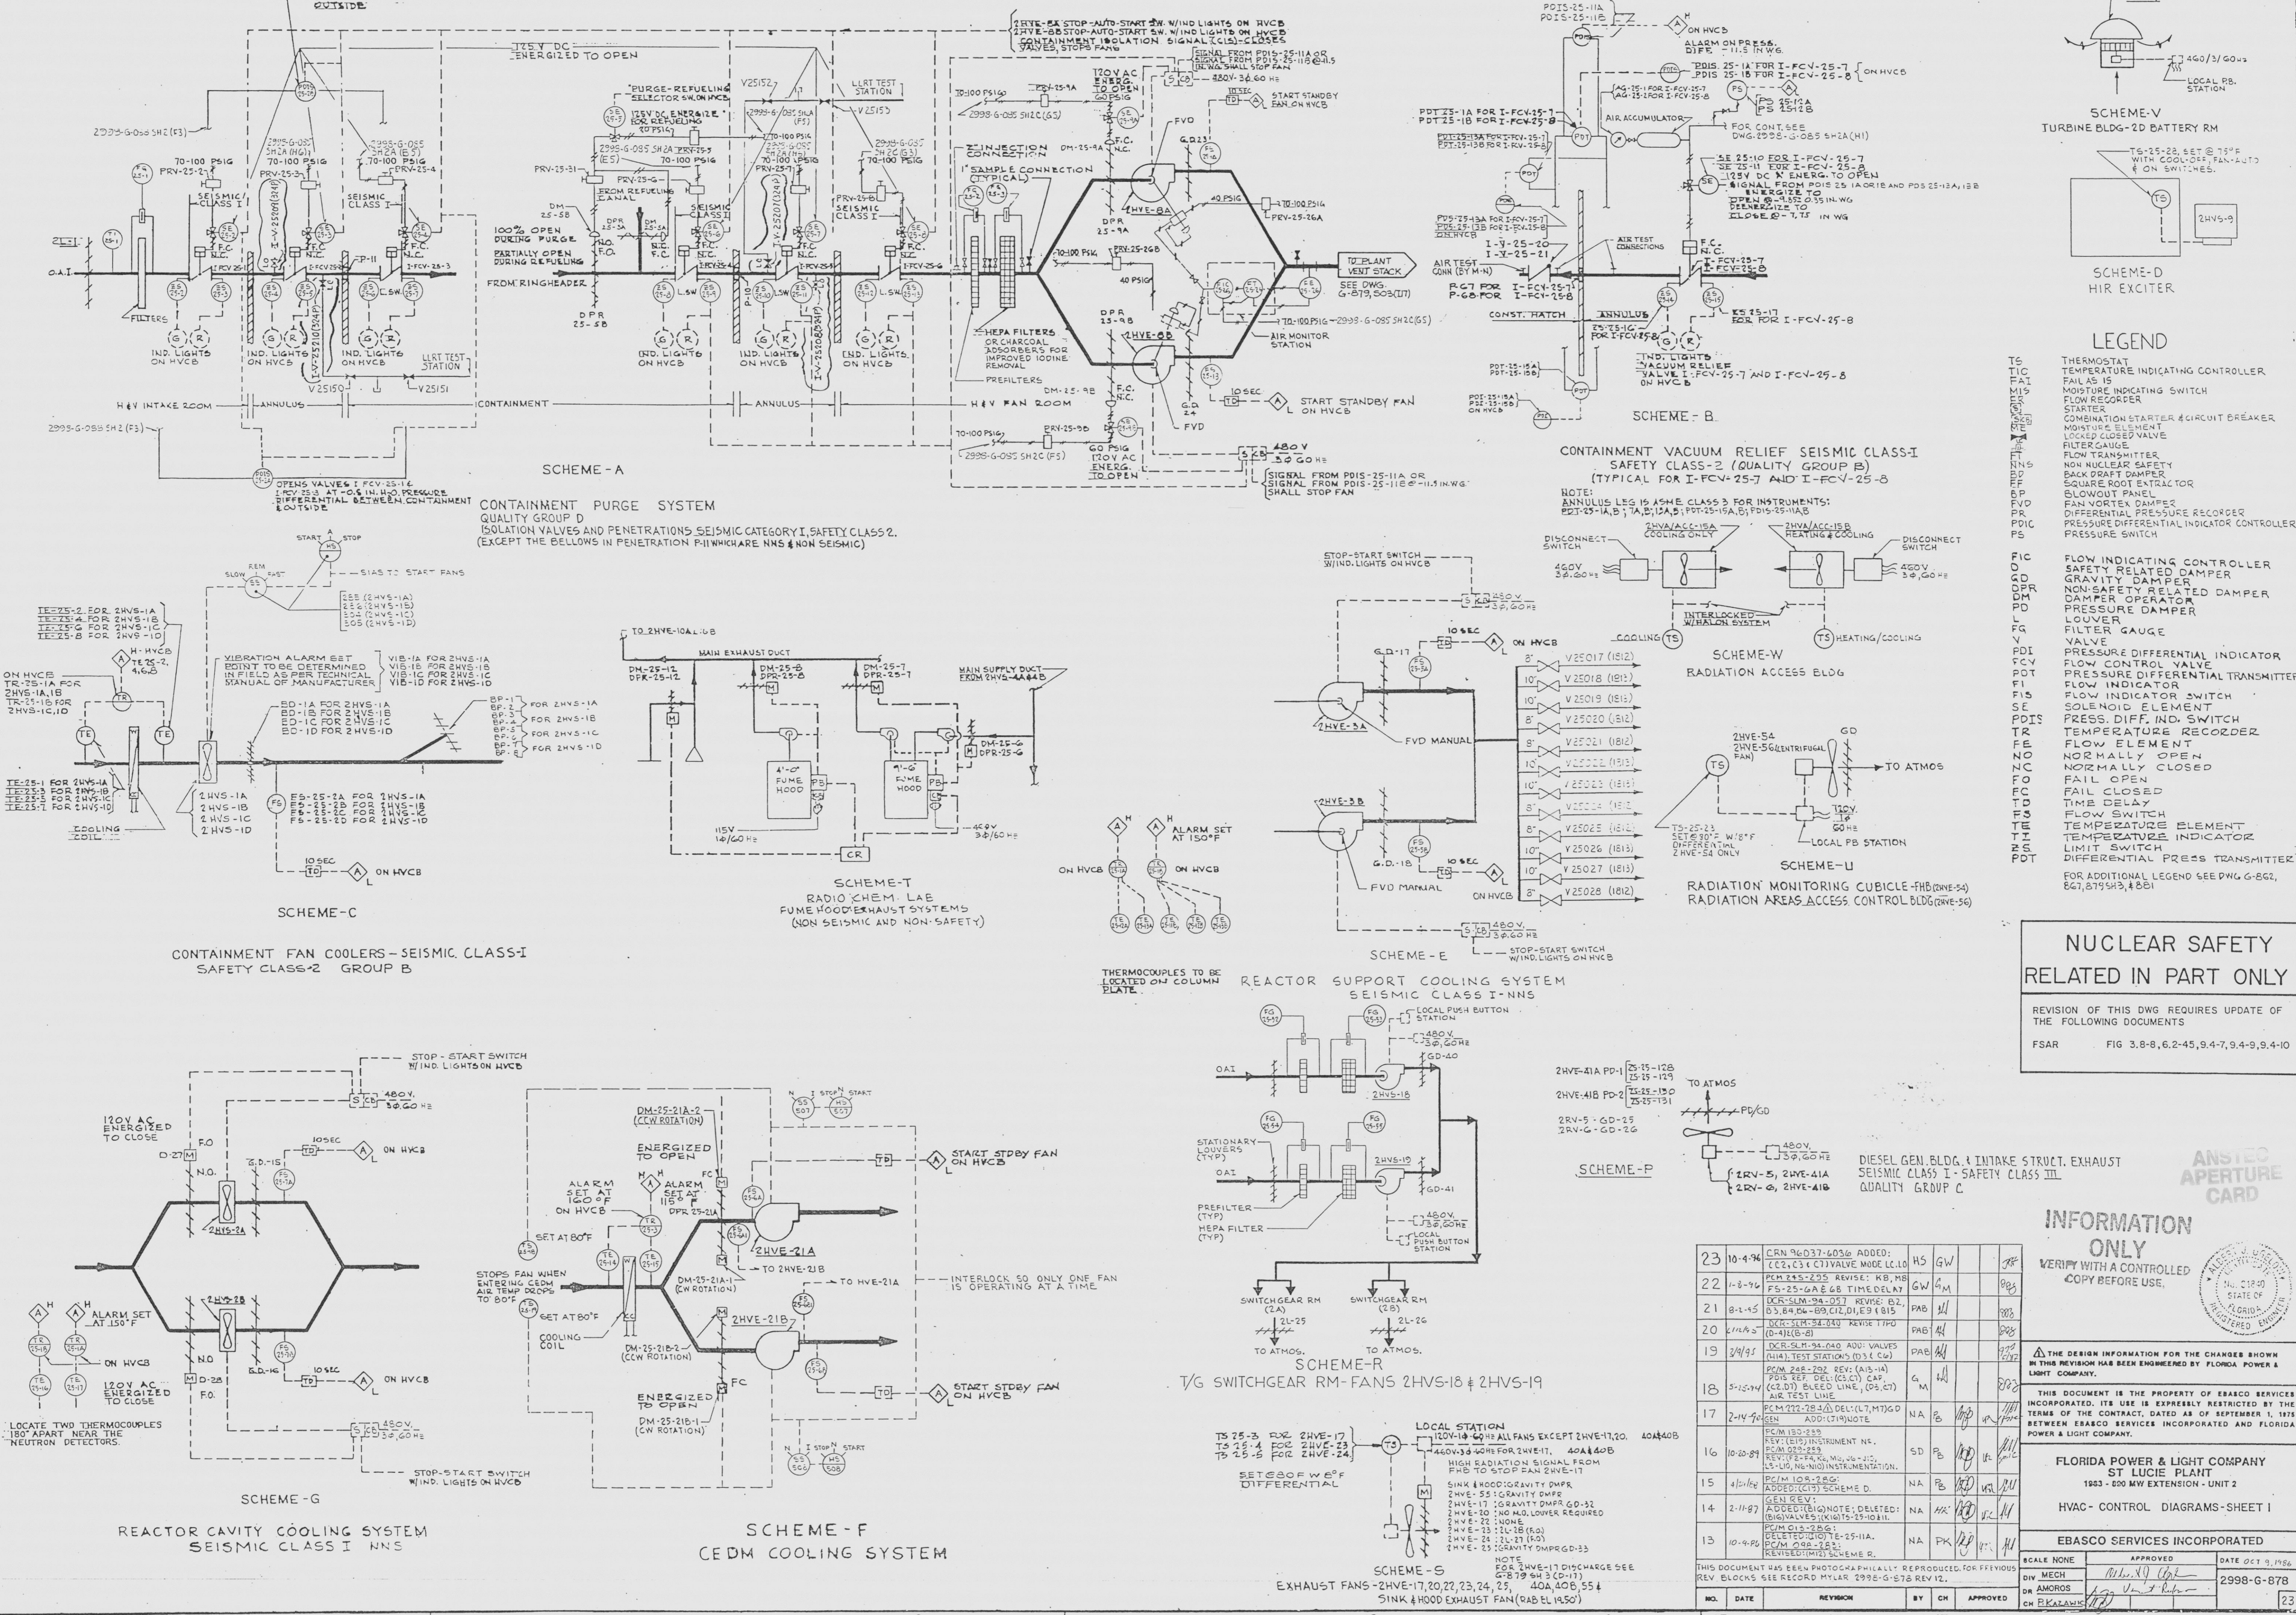

**LEGEND**

TS	THERMOSTAT
TI	TEMPERATURE INDICATING CONTROLLER
FAI	FAN AS IS
FMIS	MOISTURE INDICATING SWITCH
FR	FLOW RECORDER
ST	STARTER
CS	COMBINATION STARTER & CIRCUIT BREAKER
MS	MONTHLY SERVICE
LCV	LOCKED CLOSED VALVE
FG	FILTER GAUGE
FT	FLOW TRANSMITTER
NNS	NON NUCLEAR SAFETY
SD	SACK DRAFT DAMPER
SR	SQUARE ROOT EXTRACTOR
SP	SLOUGOUT PANEL
FVD	FAN VORTER DAMPER
PK	DIFFERENTIAL PRESSURE RECORDER
PI	PRESSURE DIFFERENTIAL INDICATOR CONTROLLER
PS	PRESSURE SWITCH
FC	FLOW INDICATING CONTROLLER
GD	GRAVITY RELATED DAMPER
DPR	DAMPER OPERATOR
DM	DAMPER
FD	FILTER GAUGE
L	LOWER
FG	FILTER GAUGE
V	VALVE
PDI	PRESSURE DIFFERENTIAL INDICATOR
FCV	FLOW CONTROL VALVE
PDI	PRESSURE DIFFERENTIAL TRANSMITTER
FI	FLOW INDICATOR
FS	FLOW INDICATOR SWITCH
SE	SOLE NO. ELEMENT
PS	PRESS. DIFF. IND. SWITCH
TR	TEMPERATURE RECORDER
FE	TEMP. ELEMENT
NO	NORMALLY OPEN
NC	NORMALLY CLOSED
FO	FAIL OPEN
FC	FAIL CLOSED
TD	TIME DELAY
TS	TEMP. SWITCH
TE	TEMPERATURE ELEMENT
TI	TEMPERATURE INDICATOR
PS	PRESS. DIFF. SWITCH
PDI	PRESS. DIFF. TRANSMITTER

FOR ADDITIONAL LEGEND SEE DWG G-862, 867, 879, 913, 881

**NUCLEAR SAFETY RELATED IN PART ONLY**

REVISION OF THIS DWG REQUIRES UPDATE OF THE FOLLOWING DOCUMENTS

FSAR FIG 3.8-8, 6.2-45, 9.4-7, 9.4-9, 9.4-10

**ANSI APTURE CARD**

**INFORMATION ONLY**

VERIFY WITH A CONTROLLED COPY BEFORE USE.

NO.	DATE	REVISION	BY	CHK	APPROVED
23	10-4-94	CRN 96037-003 ADD: (C2, C3) CT VALVE MODE LL 1R	HS	GW	JPB
22	1-8-94	REV. 25-235 REVISE: KB, MB	GW	GM	JPB
21	8-1-93	PS-25-2A E G 6 TIME DELAY	PAW	HL	JPB
20	11-16-93	D3, B4, C4, D3, E3, F3, G3, H3, I3, J3, K3, L3, M3, N3, O3, P3, Q3, R3, S3, T3, U3, V3, W3, X3, Y3, Z3	PAW	HL	JPB
19	3-11-93	REVISE: (C2, C3) CT VALVE MODE LL 1R	PAW	HL	JPB
18	3-12-92	FROM 248-021 REV. (A3, H3) (C2, D2) BLEED LINE, (C5, C7) AIR TEST LINE	GM	HL	JPB
17	2-14-92	REVISE: (C2, C3) CT VALVE MODE LL 1R	NA	PK	JPB
16	10-20-91	REVISE: INSTRUMENT N.S. FROM 248-021 REV. (A3, H3) (C2, D2) BLEED LINE, (C5, C7) AIR TEST LINE	SD	PK	JPB
15	11-16-91	REVISE: (C2, C3) CT VALVE MODE LL 1R	NA	PK	JPB
14	2-11-91	GEN. REV. (C2, C3) CT VALVE MODE LL 1R	NA	PK	JPB
13	10-4-90	REVISE: (C2, C3) CT VALVE MODE LL 1R	NA	PK	JPB

THE DESIGN INFORMATION FOR THE CHANGES SHOWN IN THIS REVISION HAS BEEN ENGINEERED BY FLORIDA POWER & LIGHT COMPANY.

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED 18 OF SEPTEMBER, 1, 1978 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

**FLORIDA POWER & LIGHT COMPANY**  
ST LUCIE PLANT  
1983 - 600 MW EXTENSION - UNIT 2  
HVAC - CONTROL DIAGRAMS - SHEET 1

**EBASCO SERVICES INCORPORATED**

SCALE NONE APPROVED DATE OCT 9, 1994  
DW: MECH  
CH: AMOROS  
CH: KALAMAKI

THIS DOCUMENT HAS BEEN PHOTOGRAPHICALLY REPRODUCED FOR PREVIOUS REV. BLOCKS SEE RECORD MYLAR 2998-G-878 REV 12.

NO. DATE REVISION BY CHK APPROVED

E 9712040015-102