

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8707100199      DDC. DATE: 87/06/29      NOTARIZED: NO      DOCKET #  
 FACIL: STN-50-52B Palo Verde Nuclear Station, Unit 1, Arizona Public      05000528  
 AUTH. NAME      AUTHOR AFFILIATION  
 HAYNES, J. G.      Arizona Nuclear Power Project (formerly Arizona Public Serv  
 RECIP. NAME      RECIPIENT AFFILIATION  
                                  Document Control Branch (Document Control Desk)


SUBJECT: Forwards special rept prepared & submitted per Tech Specs  
 3.4.4 & 6.9.2 re steam generator tubes plugged as result of  
 inservice insp & satisfies requirements of Tech Spec  
 4.4.4.5 b.

DISTRIBUTION CODE: A047D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 1717  
 TITLE: OR Submittal: Inservice Inspection/Testing

NOTES: Standardized plant. M. Davis, NRR: 1Cy.      05000528

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD5 LA	1 0	PD5 PD	5 5
	LICITRA, E	1 1	DAVIS, M	1 1
INTERNAL:	ACRS	10 10	AEOD/DOA	1 1
	AEOD/DSP/TPAB	1 1	ARM/DAF/LFMB	1 0
	NRR/DEST/ADE	1 0	NRR/DEST/MEB	1 1
	NRR/DEST/MTB	1 1	NRR/PMAS/ILRB	1 1
	OGC/HDS1	1 0	<u>REG FILE</u> 01	1 1
	RES/DE/EIB	1 1		
EXTERNAL:	LPDR	1 1	NRC PDR	1 1
	NSIC	1 1		
NOTES:		1 1		

TOTAL NUMBER OF COPIES REQUIRED: LTTR 32 ENCL 28

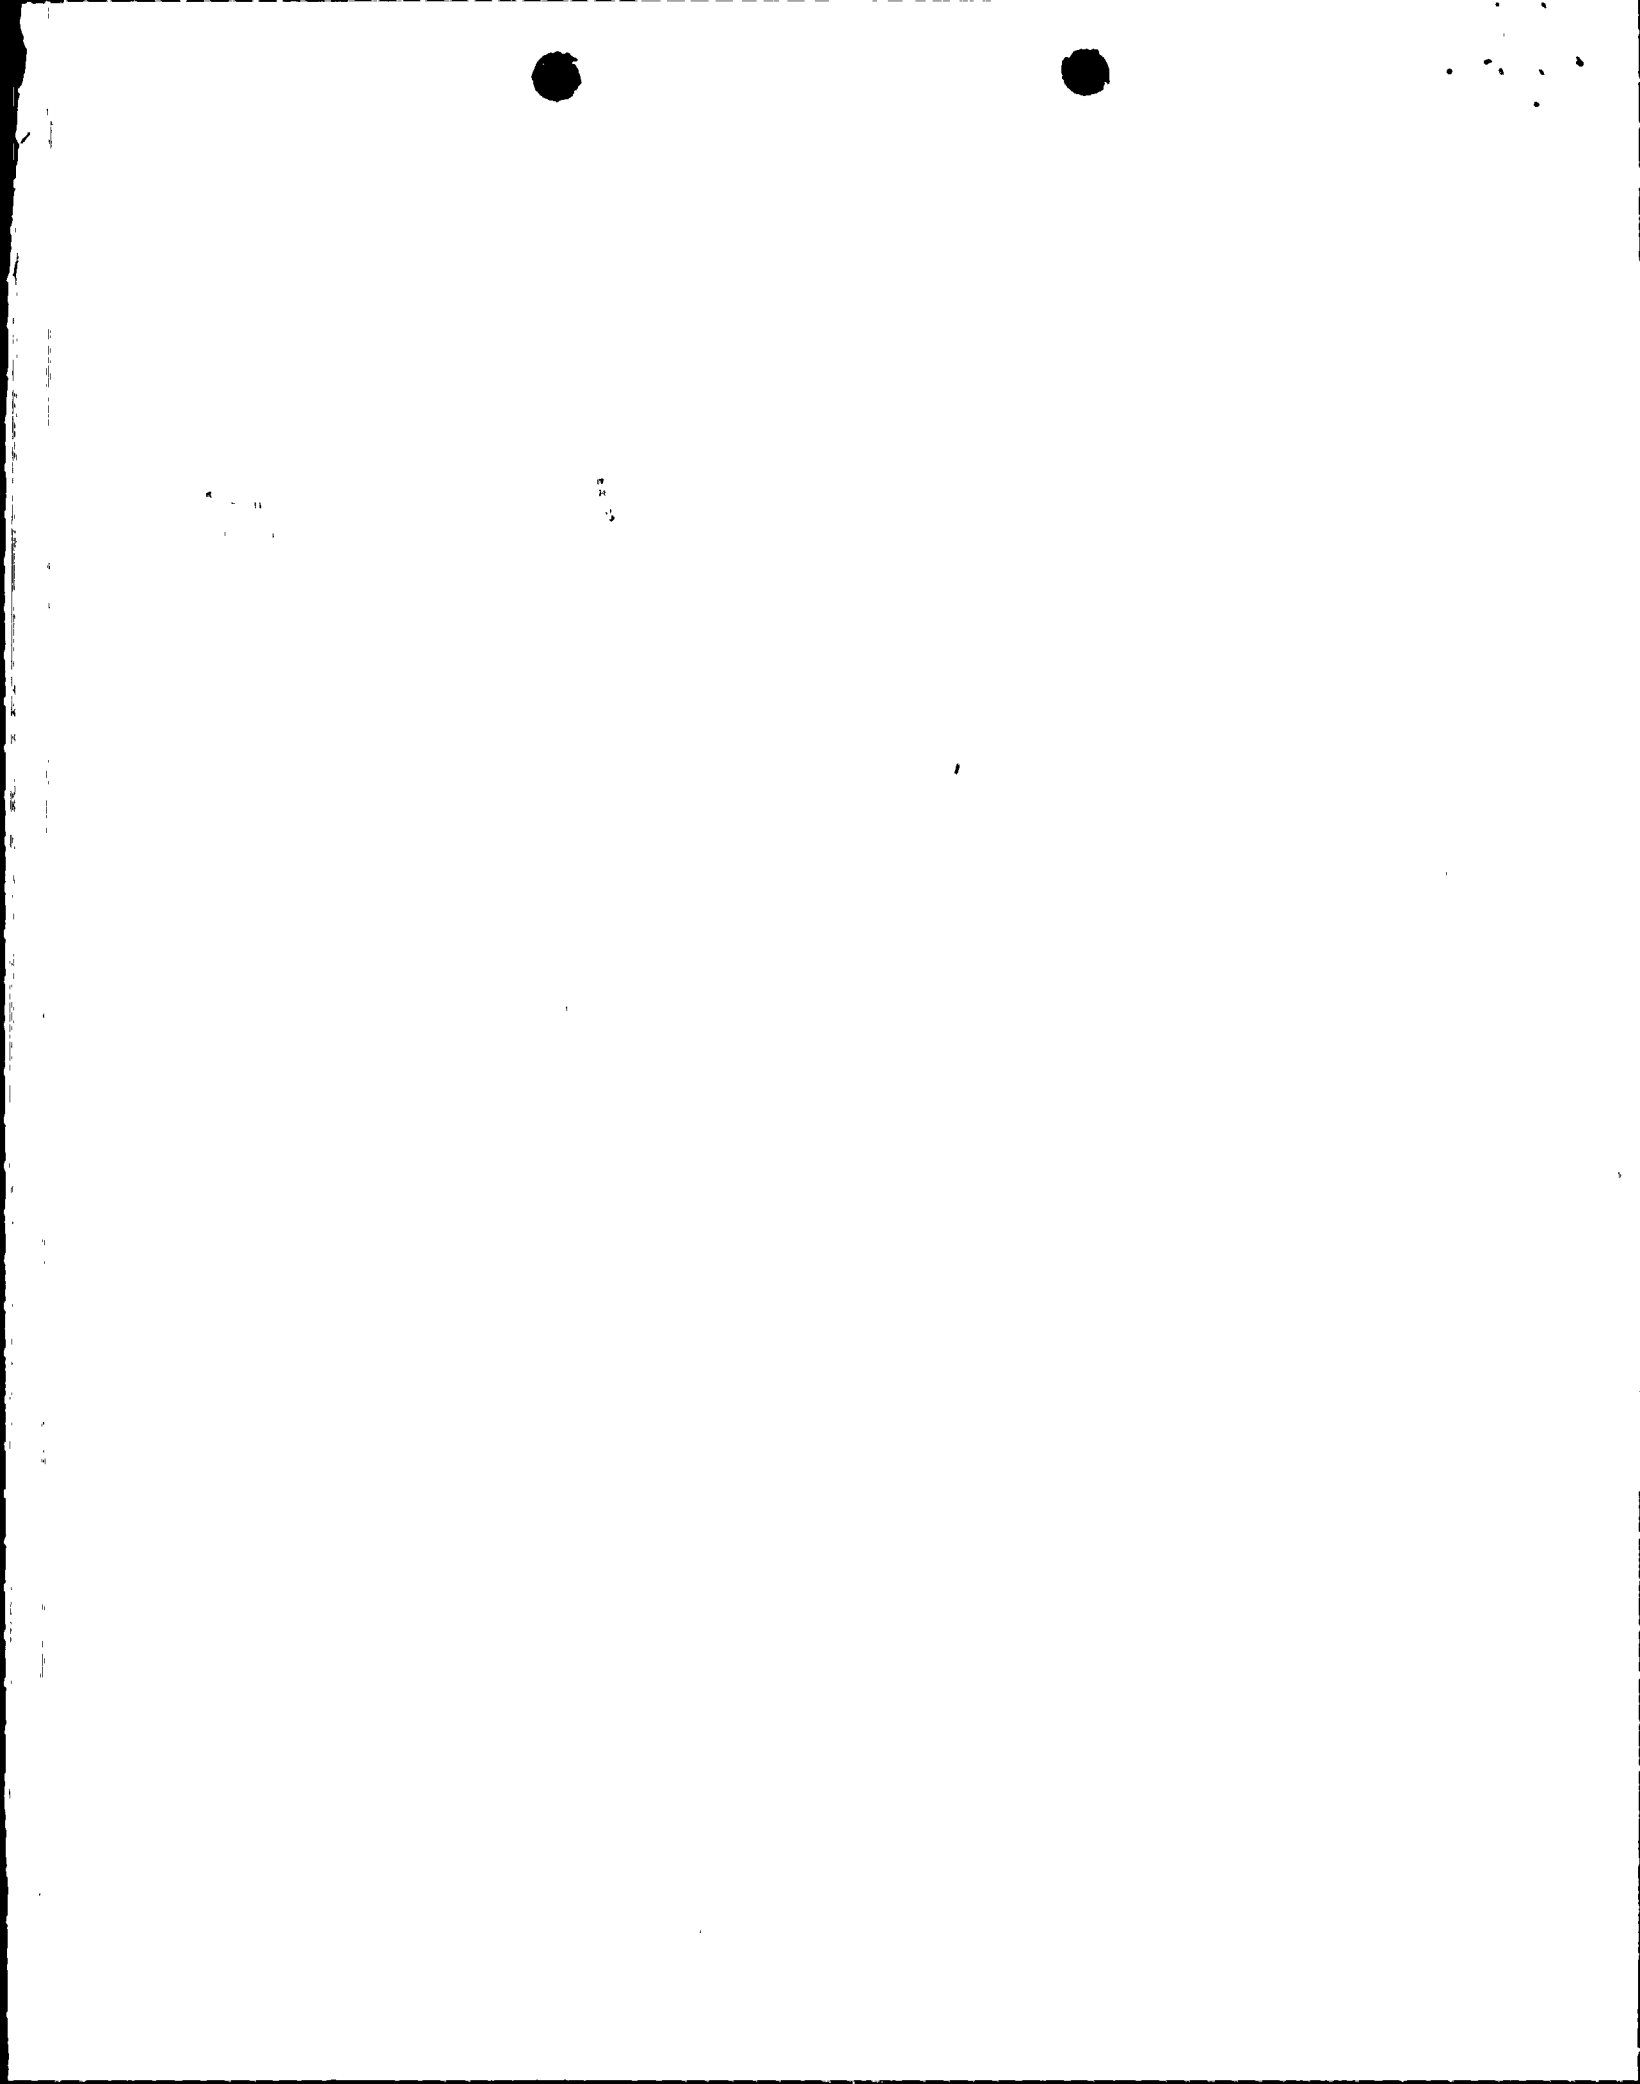



## Arizona Nuclear Power Project

P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

192-00213-JGH-TRB/JEM

June 29, 1987

U.S. Nuclear Regulatory Commission  
NRC Document Control Desk  
Washington, D.C. 20555

Subject: Palo Verde Nuclear Generating Station (PVNGS)  
Unit 1  
Docket No. STN 50-528 (License NPF-41)  
Special Report Steam Generator Inservice Inspection  
File: 87-020-404

Dear Sirs:

Attached please find a Special Report prepared and submitted pursuant to Technical Specifications 3.4.4 and 6.9.2. This report discusses Steam Generator tubes plugged as a result of an Inservice Inspection and satisfies the requirements of Specification 4.4.4.5 b. By copy of this letter we are also forwarding a copy of this report to the Regional Administrator of the Region V Office.

If you have any questions, please contact T. R. Bradish, Compliance Supervisor at (602) 932-5300, Ext. 6936.

Very truly yours,

J. G. Haynes  
Vice President  
Nuclear Production

JGH/TRB/JEM/cld

Attachment

cc: O. M. DeMichele (all w/a)  
E. E. Van Brunt, Jr.  
J. B. Martin  
R. P. Zimmerman  
R. C. Sorenson  
E. A. Licitra  
A. C. Gehr  
INPO Records Center

8707100199 870629  
PDR ADOCK 05000528  
PDR

A047  
lll



Faint, illegible text at the top of the page, possibly a header or title.

Second block of faint, illegible text in the upper middle section.

Third block of faint, illegible text in the middle section.

Small block of faint, illegible text in the lower middle section.

Block of faint, illegible text in the lower right section.

Final block of faint, illegible text at the bottom of the page.