

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8906300140 DOC. DATE: 89/06/27 NOTARIZED: NO DOCKET #  
 FACIL: STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528  
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529  
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530  
 AUTH. NAME AUTHOR AFFILIATION  
 CONWAY, W.F. Arizona Public Service Co. (formerly Arizona Nuclear Power  
 RECIP. NAME RECIPIENT AFFILIATION  
 Document Control Branch (Document Control Desk)

SUBJECT: Requests extension of time to respond to Generic Ltr 89-06,  
 Task Action Plan Item I.D.2, "Safety Parameter Display...."

DISTRIBUTION CODE: A004D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2  
 TITLE: Safety Parameter Display System (Item I.D.2) Generic Ltr 89-06 Respon

NOTES: Standardized plant. 05000528  
 Standardized plant. 05000529  
 Standardized plant. 05000530

	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTTR	ENCL		ID CODE/NAME		LTTR	ENCL
	PD5 LA		1	0		PD5 PD		7	7
	CHAN, T		1	1		DAVIS, M		1	1
	DAVIS, M.		1	1					
INTERNAL:	NRR/DLPQ/HFB 10		2	2		NRR/DRSP/PD-3-3		1	1
	NUDOCS-ABSTRACT		1	1		OC/LFMB		1	0
	<u>REG FILE</u> 01		1	1		RES/DSIR/EIB		1	1
EXTERNAL:	LPDR		1	1		NRC PDR		1	1
	NSIC		1	1					
NOTES:			1	1					


DA 4

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 22 ENCL 20

R  
I  
D  
S  
/  
A  
D  
D  
S

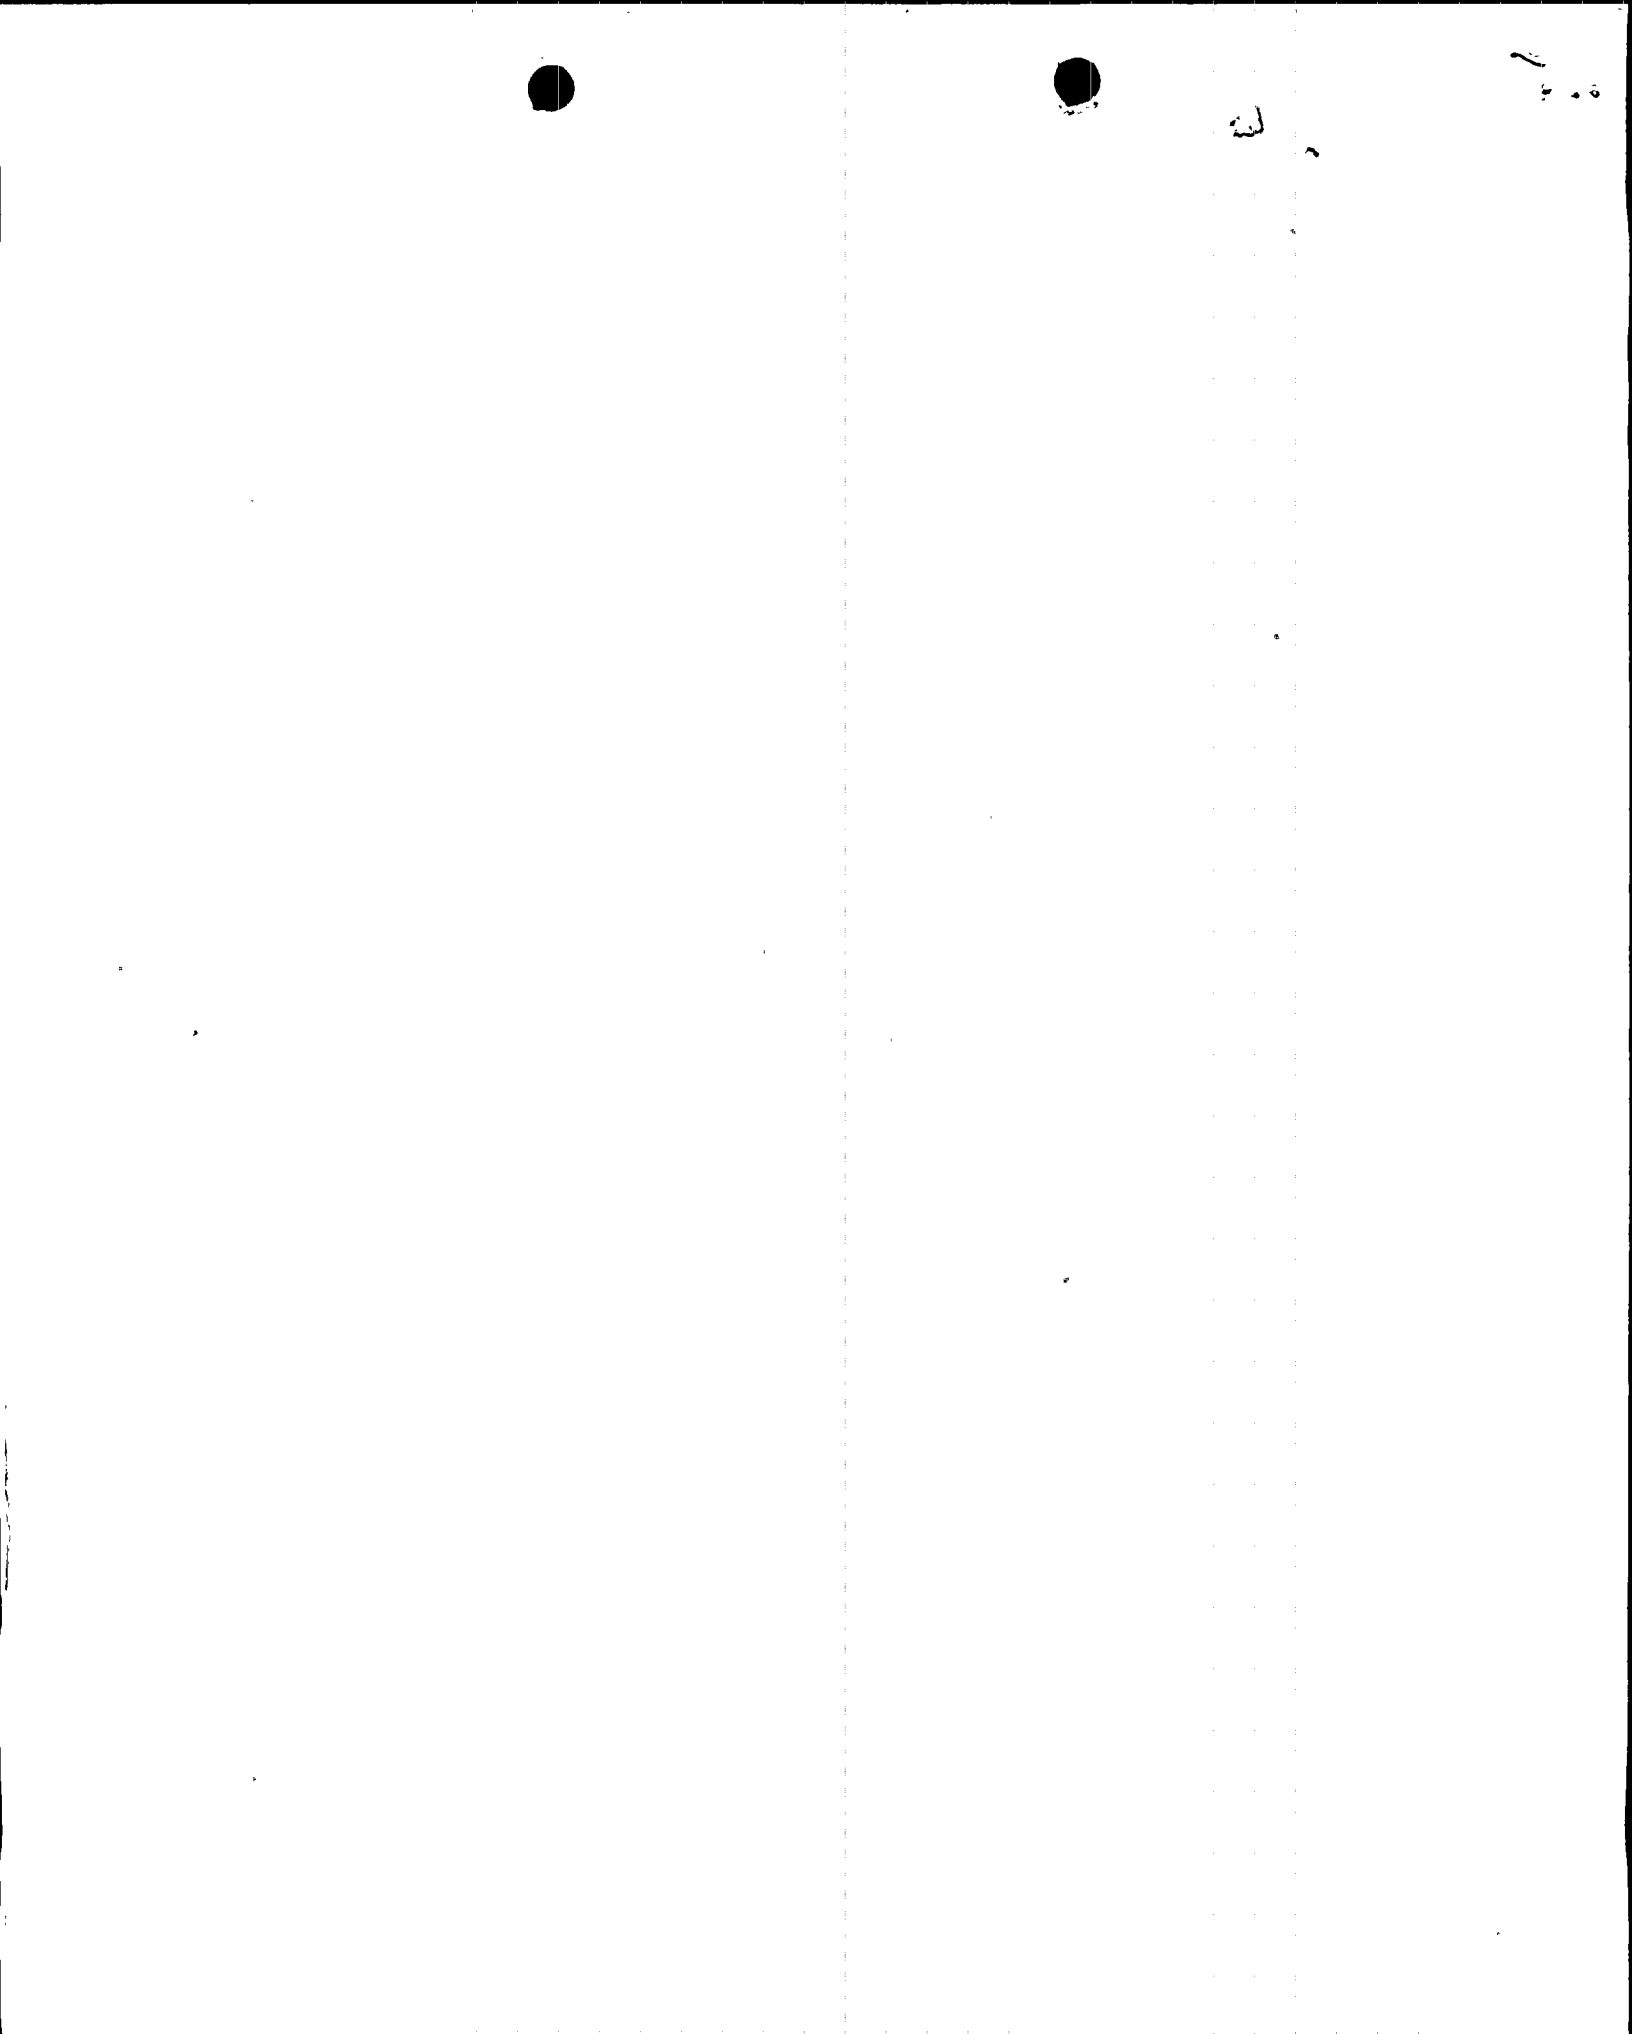

**Arizona Public Service Company**

P.O. BOX 53999 • PHOENIX, ARIZONA 85072-3999

WILLIAM F. CONWAY  
EXECUTIVE VICE PRESIDENT  
NUCLEAR

161-02062-WFC/RAB  
June 27, 1989

Docket Nos. STN 50-528/529/530

Document Control Desk  
U. S. Nuclear Regulatory Commission  
Mail Station P1-137  
Washington, D. C. 20555

Reference: Task Action Plan Item I.D.2 - Safety Parameter  
Display System - 10 CFR 50.54(f) -  
(Generic Letter No. 89-06)

Dear Sirs:

Subject: Palo Verde Nuclear Generating Station (PVNGS)  
Units 1, 2 and 3  
Request for Extension of Time to Respond to  
Generic Letter No. 89-06  
File: 89-010-026

Arizona Public Service Co. (APS) is requesting an extension of time to respond to the referenced letter until August 31, 1989. We are making this request for the following reasons.

- (1) APS received the Generic Letter on May 16, 1989, more than one month after it was dated by NRC.
- (2) APS intends to verify that all requirements of NUREG-0737, Supplement 1, for SPDS, have been considered in design and implementation. This is beyond the requirements of the Generic Letter, however, we believe that it would be appropriate to do prior to certifying the status of the SPDS at Palo Verde.
- (3) APS must verify installation in all three Palo Verde Units.

We consider this request to be reasonable when the above three factors are taken into consideration. If you have any questions, please call Carter Rogers at (602) 371-4041.


Sincerely,



WFC/RAB/jle

*1004*  
*1/0*

8906300140 890627  
PDR ADDCK 05000528  
P PNU

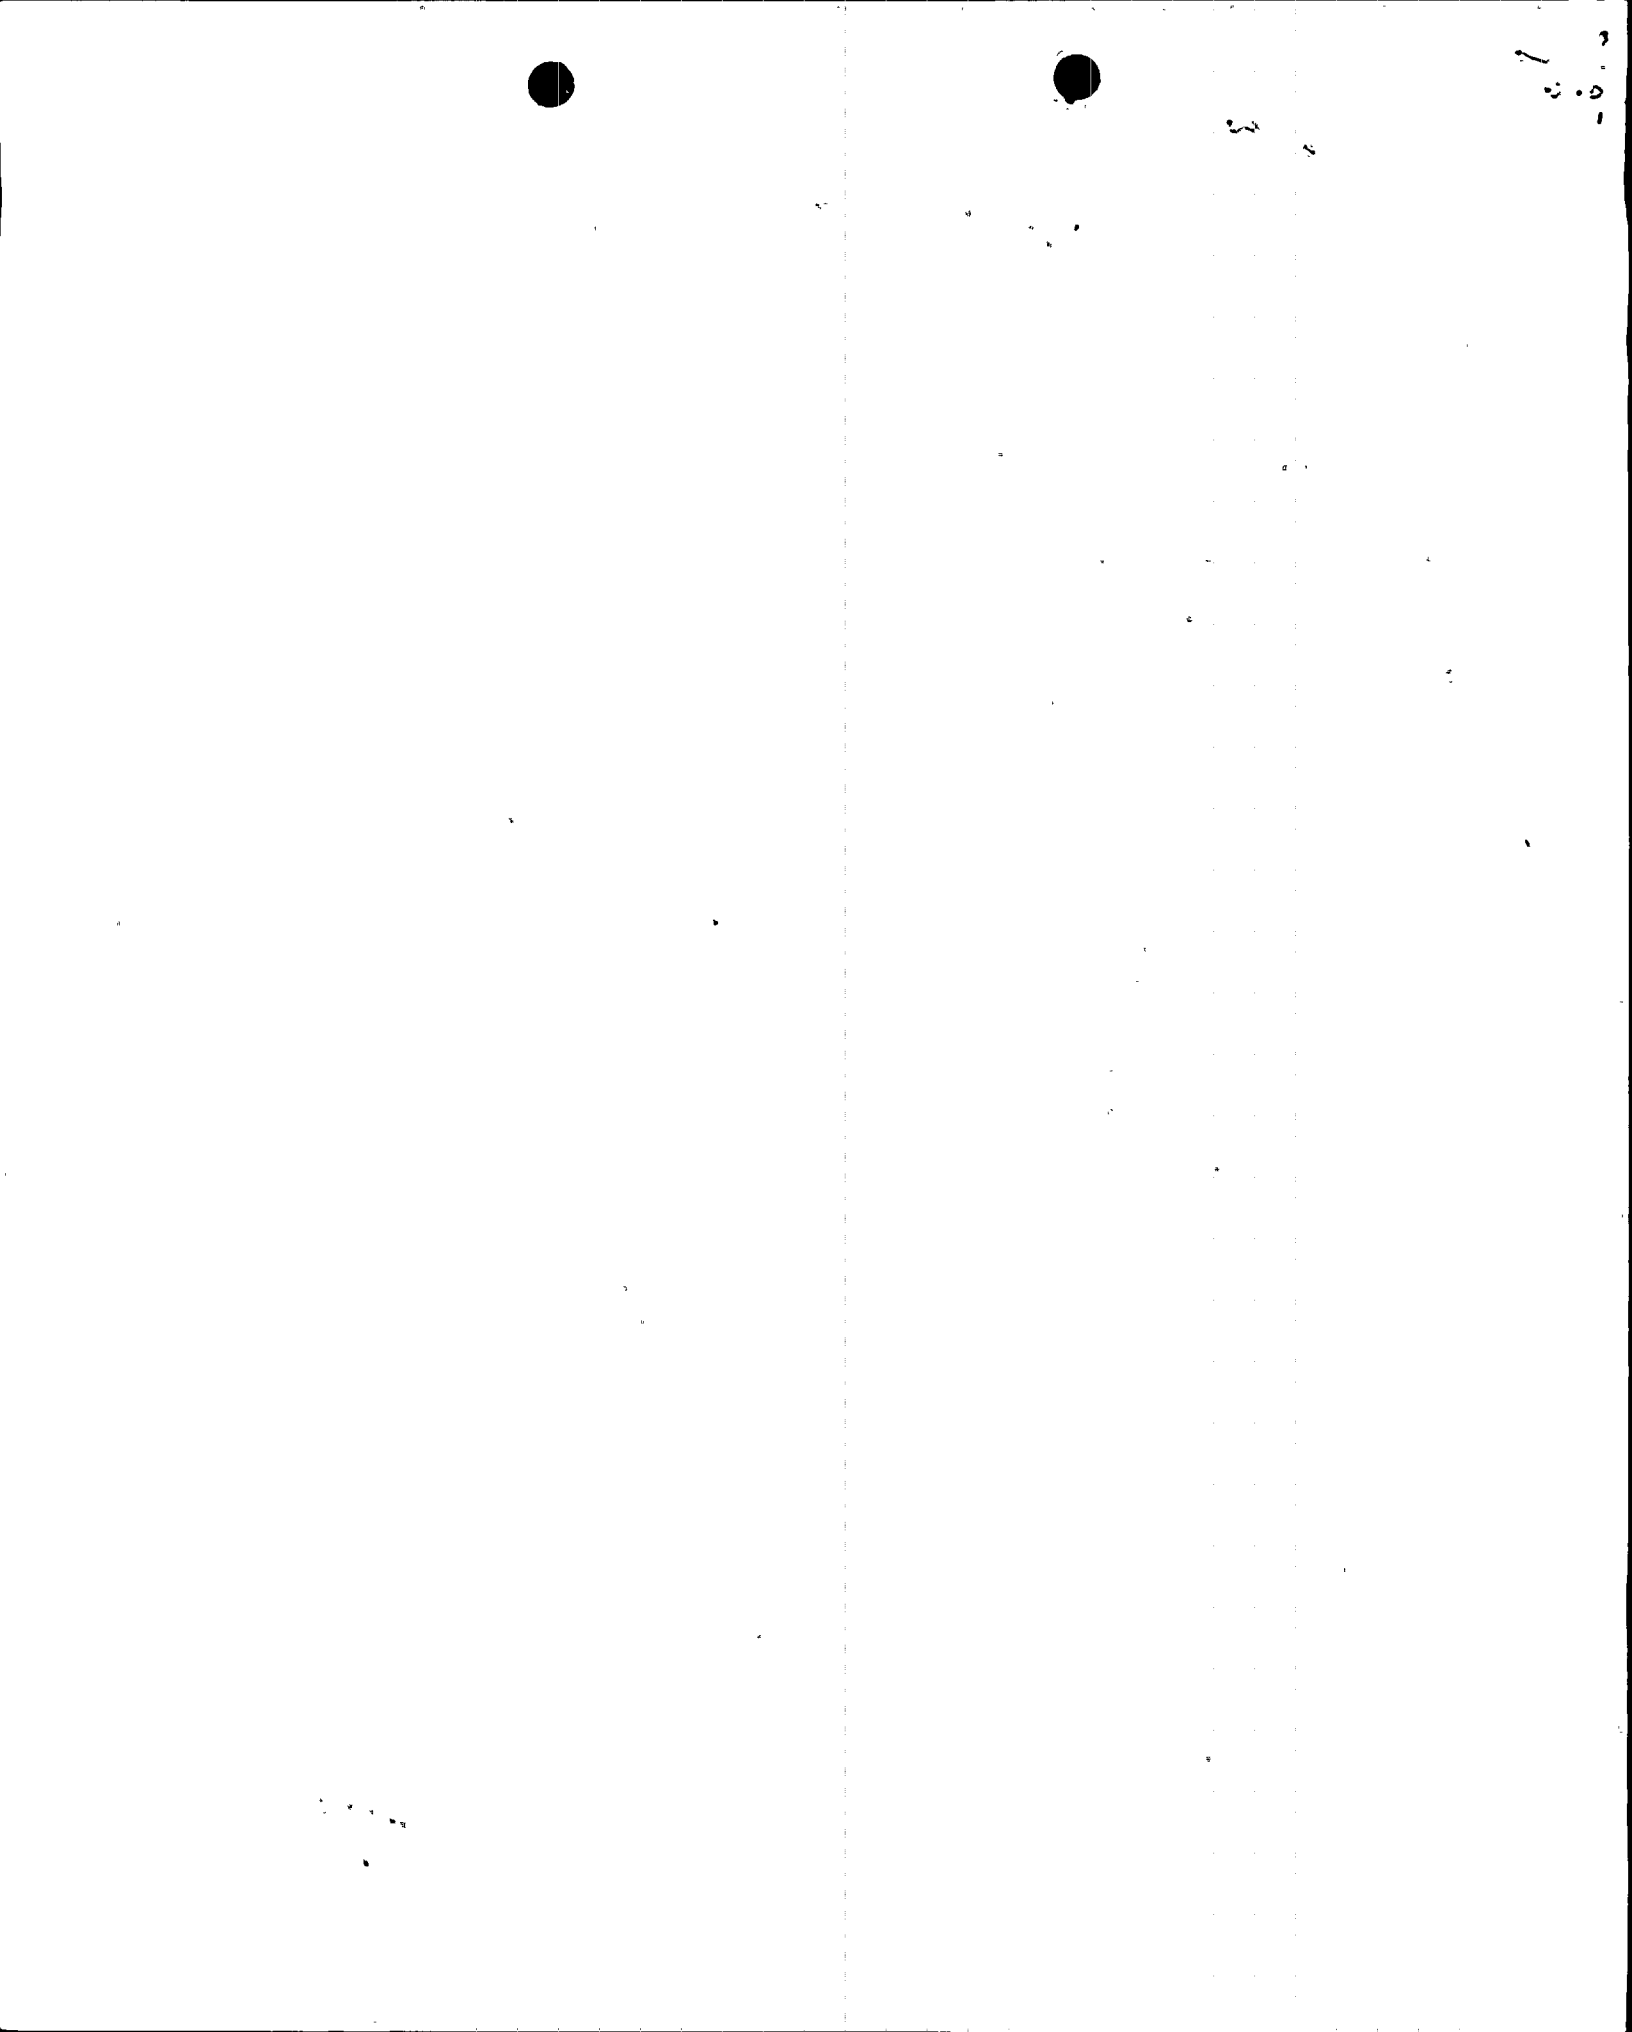

Document Control Desk  
U. S. Nuclear Regulatory Commission  
Page 2

161-02062-WFC/RAB  
June 27, 1989

cc: J. B. Martin  
T. L. Chan  
M. J. Davis  
T. J. Polich  
A. C. Gehr

