



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

9210130247 921001
PDR ADDCK 05000528
P PDR

ARIZONA PUBLIC SERVICE COMPANY, ET AL.

DOCKET NO. STN 50-528

PALO VERDE NUCLEAR GENERATING STATION, UNIT NO. 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 65
License No. NPF-41

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by the Arizona Public Service Company (APS or the licensee) on behalf of itself and the Salt River Project Agricultural Improvement and Power District, El Paso Electric Company, Southern California Edison Company, Public Service Company of New Mexico, Los Angeles Department of Water and Power, and Southern California Public Power Authority dated April 27, 1992, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C(2) of Facility Operating License No. NPF-41 is hereby amended to read as follows:



1952

(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No. 65, and the Environmental Protection Plan contained in Appendix B, are hereby incorporated into this license. APS shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan, except where otherwise stated in specific license conditions.

3. This license amendment is effective as of the date of issuance and must be fully implemented no later than 45 days from the date of issuance.

FOR THE NUCLEAR REGULATORY COMMISSION



Theodore R. Quay, Director
Project Directorate V
Division of Reactor Projects III/IV/V
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: October 1, 1992



ATTACHMENT TO LICENSE AMENDMENT

AMENDMENT NO. 65 TO FACILITY OPERATING LICENSE NO. NPF-41

DOCKET NO. STN 50-528

Replace the following pages of the Appendix A Technical Specifications with the enclosed pages. The revised pages are identified by amendment number and contain vertical lines indicating the areas of change.

Remove

3/4 7-15
B 3/4 7-4

Insert

3/4 7-15
B 3/4 7-4



Vertical text or markings, possibly bleed-through from the reverse side of the page, running down the center-right area.

PLANT SYSTEMS

3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.6. At least two independent essential chilled water loops shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With only one essential chilled water loop OPERABLE, restore at least two loops to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With only one essential chilled water system OPERABLE:
 1. Within 1 hour verify that the normal HVAC system is providing space cooling to the vital power distribution rooms that depend on the inoperable essential chilled water system for space cooling, and
 2. Within 8 hours establish OPERABILITY of the safe shutdown systems which do not depend on the inoperable essential chilled water system (one train each of boration, pressurizer heaters and auxiliary feedwater), and
 3. Within 24 hours establish OPERABILITY of all required systems, subsystems, trains, components, and devices that depend on the remaining OPERABLE essential chilled water system for space cooling.

If these conditions are not satisfied within the specified time, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.7.6.1 At least two essential chilled water loops shall be demonstrated OPERABLE at least once per 31 days by verifying that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is not locked, sealed, or otherwise secured in position, is in its correct position.

4.7.6.2 Once per 18 months during shutdown, verify that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is locked, sealed, or otherwise secured in position, is in its correct position.

PLANT SYSTEMS

3/4.7.7 CONTROL ROOM ESSENTIAL FILTRATION SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.7 Two independent control room essential filtration systems shall be OPERABLE.

APPLICABILITY: ALL MODES.

ACTION:

MODES 1, 2, 3, and 4:

With one control room essential filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

MODES 5 and 6:

- a. With one control room essential filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or initiate and maintain operation of the remaining OPERABLE control room essential filtration system.
- b. With both control room essential filtration systems inoperable, or with the OPERABLE control room essential filtration system, required to be OPERABLE by ACTION a., not capable of being powered by an OPERABLE emergency power source, suspend all operations involving CORE ALTERATIONS or positive reactivity changes.

SURVEILLANCE REQUIREMENTS

4.7.7 Each control room essential filtration system shall be demonstrated OPERABLE:

- a. At least once per 31 days on a STAGGERED TEST BASIS by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 15 minutes.
- b. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire, or chemical release in any ventilation zone communicating with the system by:

PLANT SYSTEMS

BASES

3/4.7.1.4 ACTIVITY

The limitations on secondary system specific activity ensure that the resultant offsite radiation dose will be limited to a small fraction of 10 CFR Part 100 limits in the event of a steam line rupture. This dose also includes the effects of a coincident 1 gpm primary-to-secondary tube leak in the steam generator of the affected steam line and a concurrent loss-of-offsite electrical power. These values are consistent with the assumptions used in the safety analyses.

3/4.7.1.5 MAIN STEAM LINE ISOLATION VALVES

The OPERABILITY of the main steam line isolation valves ensures that no more than one steam generator will blow down in the event of a steam line rupture. This restriction is required to (1) minimize the positive reactivity effects of the Reactor Coolant System cooldown associated with the blowdown, and (2) limit the pressure rise within containment in the event the steam line rupture occurs within containment. The OPERABILITY of the main steam isolation valves within the closure times of the surveillance requirements are consistent with the assumptions used in the safety analyses.

3/4.7.1.6 ATMOSPHERIC DUMP VALVES

The limitation on maintaining the nitrogen accumulator at a pressure ≥ 400 psig is to ensure that a sufficient volume of nitrogen is in the accumulator to operate the associated ADV which holds the plant at hot standby while dissipating core decay heat or which allows a flow of sufficient steam to maintain a controlled reactor cooldown rate. A pressure of 400 psig retains sufficient nitrogen volume for 4 hours of operation at hot standby plus 6.5 hours of operation to reach cold shutdown under natural circulation conditions in the event of failure of the normal control air system.

3/4.7.2 STEAM GENERATOR PRESSURE/TEMPERATURE LIMITATION

The limitation on steam generator pressure and temperature ensures that the pressure induced stresses in the steam generators do not exceed the maximum allowable fracture toughness stress limits. The limitations to 120°F and 230 psig are based on a steam generator RT_{NDT} of 40°F and are sufficient to prevent brittle fracture.

3/4.7.3 ESSENTIAL COOLING WATER SYSTEM

The OPERABILITY of the essential cooling water system ensures that sufficient cooling capacity is available for continued operation of safety-related equipment during normal and accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

PLANT SYSTEMS

BASES

3/4.7.4 ESSENTIAL SPRAY POND SYSTEM

The OPERABILITY of the essential spray pond system ensures that sufficient cooling capacity is available for continued operation of equipment during normal and accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

3/4.7.5 ULTIMATE HEAT SINK

The limitations on the ultimate heat sink level and temperature ensure that sufficient cooling capacity is available to either (1) provide normal cooldown of the facility, or (2) to mitigate the effects of accident conditions within acceptable limits.

The limitations on minimum water level and maximum temperature are based on providing a 27-day cooling water supply to safety-related equipment without exceeding their design basis temperature and is consistent with the intent of the recommendations of Regulatory Guide 1.27, "Ultimate Heat Sink for Nuclear Plants," March 1974.

3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM

The OPERABILITY of the essential chilled water system ensures that sufficient cooling capacity is available for continued operation of equipment and control room habitability during accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

The Essential Chilled Water System (ECWS), in conjunction with respective emergency HVAC units, is required in accordance with Specification Definition 1.18 to provide heat removal in maintaining the various Engineered Safety Features (ESFs) room space design temperatures below the associated equipment qualification limits for the range of Design Basis Accident conditions. The 72 hour ACTION requirement for a single ECWS train out-of-service is consistent with the operability requirements of the Emergency Core Cooling System, Essential Cooling Water System, Auxiliary Feedwater System, and Containment Spray System Limiting Conditions for Operation. The normal HVAC system is used in maintaining the space design conditions of required safety systems during normal operating conditions. The normal HVAC system is also used in maintaining the space design conditions in the vital power distribution rooms during normal operating conditions. Action requirements are provided to ensure operability of the vital bus inverters and emergency battery chargers, by verifying within one hour that the normal HVAC system is providing space cooling to the vital power distribution rooms. The Action requirement is provided to establish within 8 hours operability of the safe shutdown systems which do not depend on the inoperable ECWS. The 8 hour period provides a reasonable time in which to establish operability of this complement of key safety systems. This requirement ensures that a functional train of safe shutdown equipment is available to put the plant in a safe, stable condition for the most probable abnormal operational occurrences. An Action requirement of 24 hours is provided to establish operability of the remaining required safety systems which do not depend on the inoperable ECWS.



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

ARIZONA PUBLIC SERVICE COMPANY, ET AL.

DOCKET NO. STN 50-529

PALO VERDE NUCLEAR GENERATING STATION, UNIT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 51
License No. NPF-51

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by the Arizona Public Service Company (APS or the licensee) on behalf of itself and the Salt River Project Agricultural Improvement and Power District, El Paso Electric Company, Southern California Edison Company, Public Service Company of New Mexico, Los Angeles Department of Water and Power, and Southern California Public Power Authority dated April 27, 1992, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's regulations set forth in 10 CFR Part 1;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C(2) of Facility Operating License No. NPF-51 is hereby amended to read as follows:



(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No.51 , and the Environmental Protection Plan contained in Appendix B, are hereby incorporated into this license. APS shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan, except where otherwise stated in specific license conditions.

3. This license amendment is effective as of the date of issuance and must be fully implemented no later than 45 days from the date of issuance.


FOR THE NUCLEAR REGULATORY COMMISSION



Theodore R. Quay, Director
Project Directorate V
Division of Reactor Projects III/IV/V
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: October 1, 1992

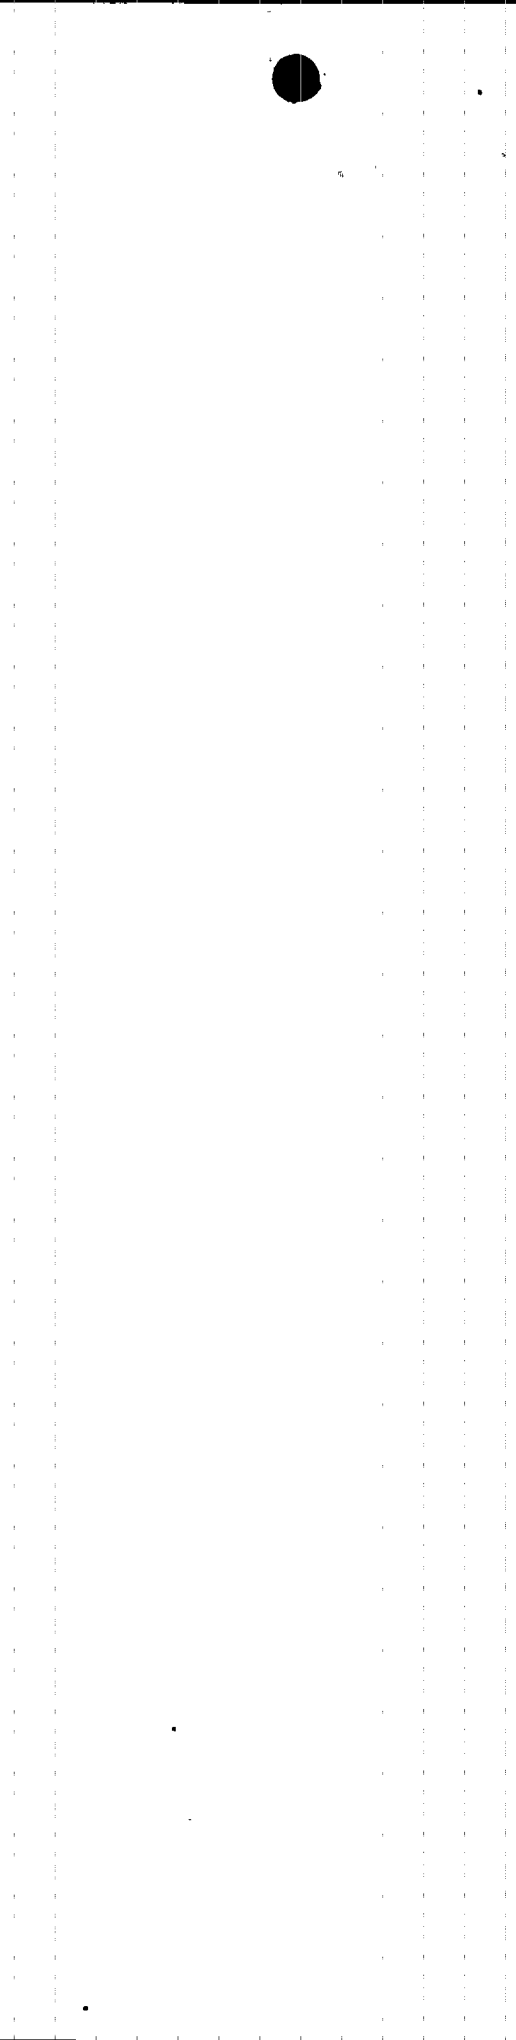

ATTACHMENT TO LICENSE AMENDMENT

AMENDMENT NO. 51 TO FACILITY OPERATING LICENSE NO. NPF-51

DOCKET NO. STN 50-529


Replace the following pages of the Appendix A Technical Specifications with the enclosed pages. The revised pages are identified by amendment number and contain vertical lines indicating the areas of change.

Remove

3/4 7-15
B 3/4 7-4

Insert

3/4 7-15
B 3/4 7-4

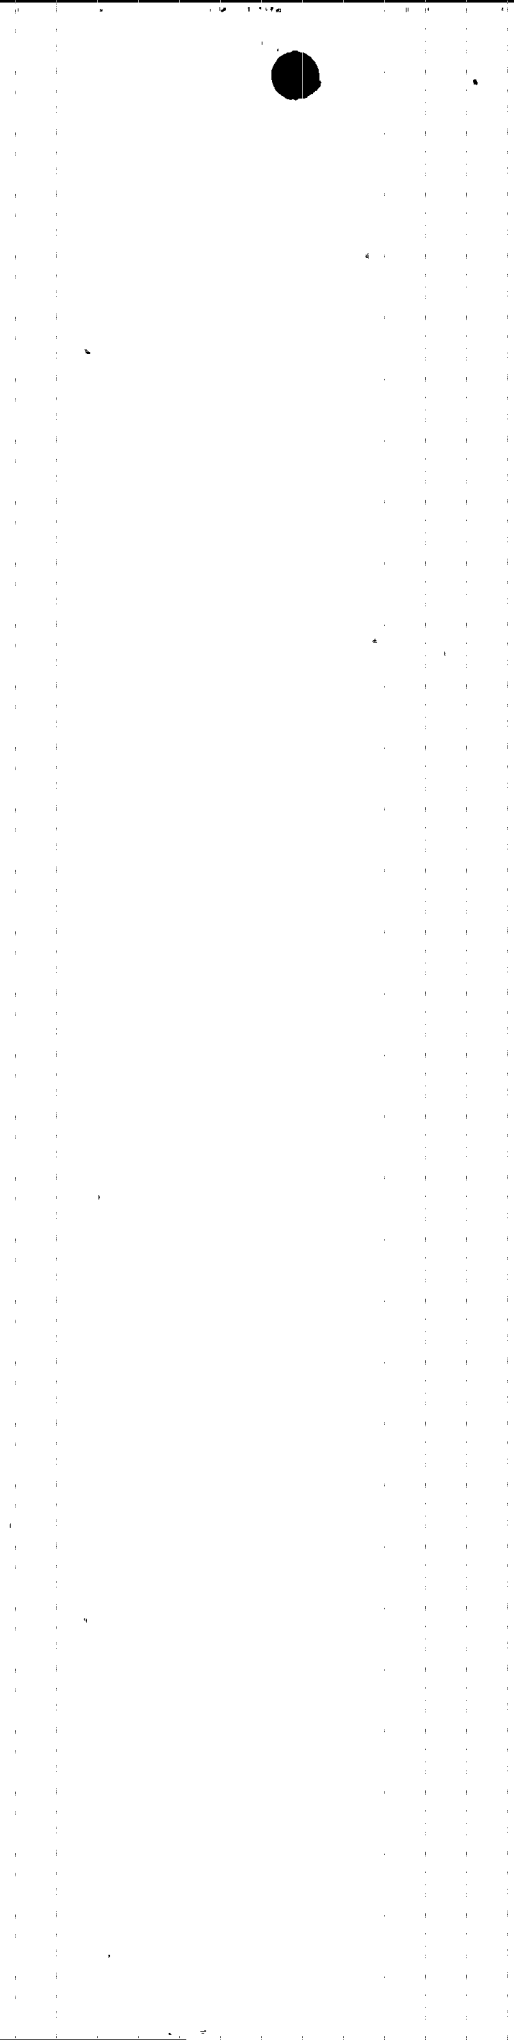

PLANT SYSTEMS

3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.6 At least two independent essential chilled water loops shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With only one essential chilled water loop OPERABLE, restore at least two loops to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With only one essential chilled water system OPERABLE:
 1. Within 1 hour verify that the normal HVAC system is providing space cooling to the vital power distribution rooms that depend on the inoperable essential chilled water system for space cooling, and
 2. Within 8 hours establish OPERABILITY of the safe shutdown systems which do not depend on the inoperable essential chilled water system (one train each of boration, pressurizer heaters and auxiliary feedwater), and
 3. Within 24 hours establish OPERABILITY of all required systems, subsystems, trains, components, and devices that depend on the remaining OPERABLE essential chilled water system for space cooling.

If these conditions are not satisfied within the specified time, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.7.6.1 At least two essential chilled water loops shall be demonstrated OPERABLE at least once per 31 days by verifying that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is not locked, sealed, or otherwise secured in position, is in its correct position.

4.7.6.2 Once per 18 months during shutdown, verify that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is locked, sealed, or otherwise secured in position, is in its correct position.

PLANT SYSTEMS

3/4.7.7 CONTROL ROOM ESSENTIAL FILTRATION SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.7 Two independent control room essential filtration systems shall be OPERABLE.

APPLICABILITY: ALL MODES.

ACTION:

MODES 1, 2, 3, and 4:

With one control room essential filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

MODES 5 and 6:

- a. With one control room essential filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or initiate and maintain operation of the remaining OPERABLE control room essential filtration system.
- b. With both control room essential filtration systems inoperable, or with the OPERABLE control room essential filtration system, required to be OPERABLE by ACTION a., not capable of being powered by an OPERABLE emergency power source, suspend all operations involving CORE ALTERATIONS or positive reactivity changes.

SURVEILLANCE REQUIREMENTS

4.7.7 Each control room essential filtration system shall be demonstrated OPERABLE:

- a. At least once per 31 days on a STAGGERED TEST BASIS by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 15 minutes.
- b. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire, or chemical release in any ventilation zone communicating with the system by:

PLANT SYSTEMS

BASES

3/4.7.1.4 ACTIVITY

The limitations on secondary system specific activity ensure that the resultant offsite radiation dose will be limited to a small fraction of 10 CFR Part 100 limits in the event of a steam line rupture. This dose also includes the effects of a coincident 1 gpm primary-to-secondary tube leak in the steam generator of the affected steam line and a concurrent loss-of-offsite electrical power. These values are consistent with the assumptions used in the safety analyses.

3/4.7.1.5 MAIN STEAM LINE ISOLATION VALVES

The OPERABILITY of the main steam line isolation valves ensures that no more than one steam generator will blow down in the event of a steam line rupture. This restriction is required to (1) minimize the positive reactivity effects of the Reactor Coolant System cooldown associated with the blowdown, and (2) limit the pressure rise within containment in the event the steam line rupture occurs within containment. The OPERABILITY of the main steam isolation valves within the closure times of the surveillance requirements are consistent with the assumptions used in the safety analyses.

3/4.7.1.6 ATMOSPHERIC DUMP VALVES

The limitation on maintaining the nitrogen accumulator at a pressure ≥ 400 psig is to ensure that a sufficient volume of nitrogen is in the accumulator to operate the associated ADV which holds the plant at hot standby while dissipating core decay heat or which allows a flow of sufficient steam to maintain a controlled reactor cooldown rate. A pressure of 400 psig retains sufficient nitrogen volume for 4 hours of operation at hot standby plus 6.5 hours of operation to reach cold shutdown under natural circulation conditions in the event of failure of the normal control air system.

3/4.7.2 STEAM GENERATOR PRESSURE/TEMPERATURE LIMITATION

The limitation on steam generator pressure and temperature ensures that the pressure induced stresses in the steam generators do not exceed the maximum allowable fracture toughness stress limits. The limitations to 120°F and 230 psig are based on a steam generator RT_{NDT} of 40°F and are sufficient to prevent brittle fracture.

3/4.7.3 ESSENTIAL COOLING WATER SYSTEM

The OPERABILITY of the essential cooling water system ensures that sufficient cooling capacity is available for continued operation of safety-related equipment during normal and accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

PLANT SYSTEMS

BASES

3/4.7.4 ESSENTIAL SPRAY POND SYSTEM

The OPERABILITY of the essential spray pond system ensures that sufficient cooling capacity is available for continued operation of equipment during normal and accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

3/4.7.5 ULTIMATE HEAT SINK

The limitations on the ultimate heat sink level and temperature ensure that sufficient cooling capacity is available to either (1) provide normal cooldown of the facility, or (2) to mitigate the effects of accident conditions within acceptable limits.

The limitations on minimum water level and maximum temperature are based on providing a 27-day cooling water supply to safety-related equipment without exceeding their design basis temperature and is consistent with the intent of the recommendations of Regulatory Guide 1.27, "Ultimate Heat Sink for Nuclear Plants," March 1974.

3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM

The OPERABILITY of the essential chilled water system ensures that sufficient cooling capacity is available for continued operation of equipment and control room habitability during accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

The Essential Chilled Water System (ECWS), in conjunction with respective emergency HVAC units, is required in accordance with Specification Definition 1.18 to provide heat removal in maintaining the various Engineered Safety Features (ESFs) room space design temperatures below the associated equipment qualification limits for the range of Design Basis Accident conditions. The 72 hour ACTION requirement for a single ECWS train out-of-service is consistent with the operability requirements of the Emergency Core Cooling System, Essential Cooling Water System, Auxiliary Feedwater System, and Containment Spray System Limiting Conditions for Operation. The normal HVAC system is used in maintaining the space design conditions of required safety systems during normal operating conditions. The normal HVAC system is also used in maintaining the space design conditions in the vital power distribution rooms during normal operating conditions. Action requirements are provided to ensure operability of the vital bus inverters and emergency battery chargers, by verifying within one hour that the normal HVAC system is providing space cooling to the vital power distribution rooms. The Action requirement is provided to establish within 8 hours operability of the safe shutdown systems which do not depend on the inoperable ECWS. The 8 hour period provides a reasonable time in which to establish operability of this complement of key safety systems. This requirement ensures that a functional train of safe shutdown equipment is available to put the plant in a safe, stable condition for the most probable abnormal operational occurrences. An Action requirement of 24 hours is provided to establish operability of the remaining required safety systems which do not depend on the inoperable ECWS.



UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D. C. 20555

ARIZONA PUBLIC SERVICE COMPANY, ET AL.


DOCKET NO. STN 50-530

PALO VERDE NUCLEAR GENERATING STATION, UNIT NO. 3

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 38
License No. NPF-74

1. The Nuclear Regulatory Commission (the Commission) has found that:
 - A. The application for amendment by the Arizona Public Service Company (APS or the licensee) on behalf of itself and the Salt River Project Agricultural Improvement and Power District, El Paso Electric Company, Southern California Edison Company, Public Service Company of New Mexico, Los Angeles Department of Water and Power, and Southern California Public Power Authority dated April 27, 1992, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's regulations set forth in 10 CFR Chapter I;
 - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
 - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
 - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
 - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.
2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C(2) of Facility Operating License No. NPF-74 is hereby amended to read as follows:

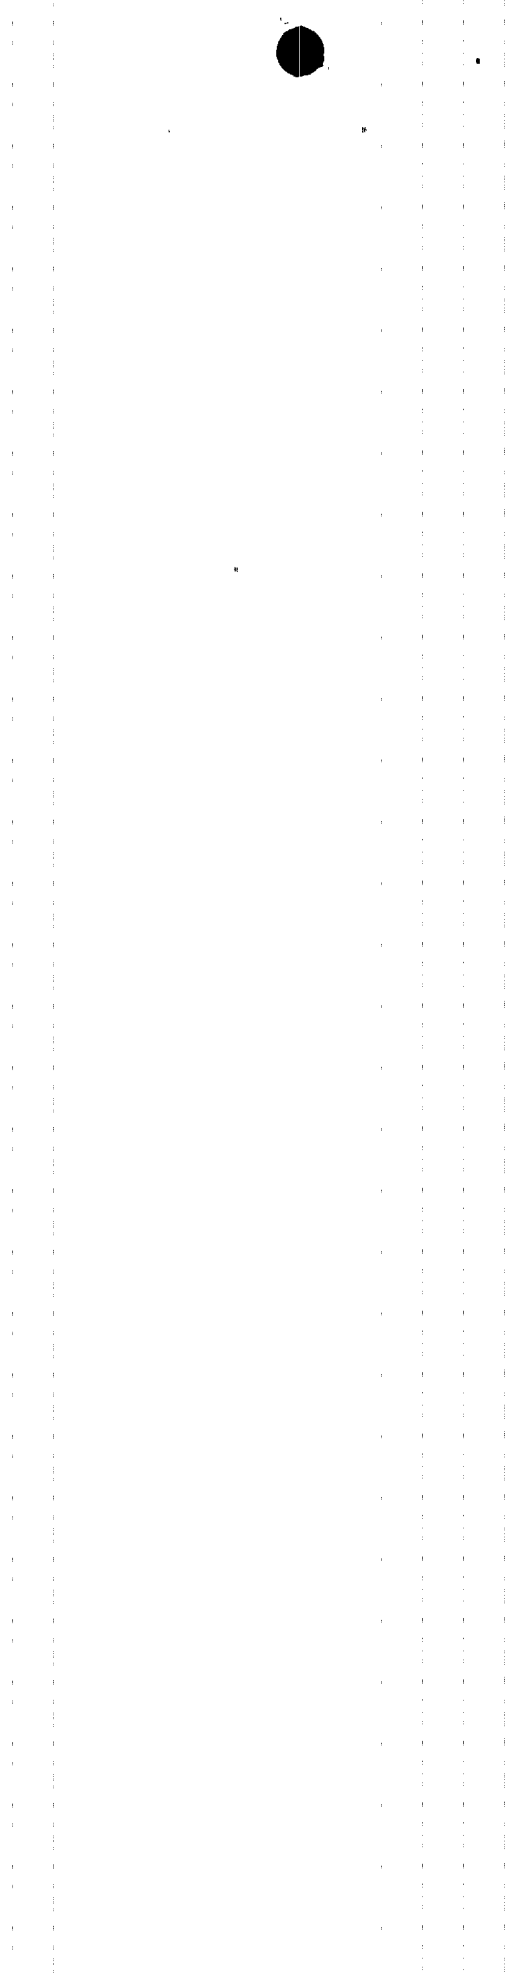

(2) Technical Specifications and Environmental Protection Plan

The Technical Specifications contained in Appendix A, as revised through Amendment No.38 , and the Environmental Protection Plan contained in Appendix B, are hereby incorporated into this license. APS shall operate the facility in accordance with the Technical Specifications and the Environmental Protection Plan, except where otherwise stated in specific license conditions.

3. This license amendment is effective as of the date of issuance and must be fully implemented no later than 45 days from the date of issuance.


FOR THE NUCLEAR REGULATORY COMMISSION.

Theodore R. Quay

Theodore R. Quay, Director
Project Directorate V
Division of Reactor Projects III/IV/V
Office of Nuclear Reactor Regulation

Attachment:
Changes to the Technical
Specifications

Date of Issuance: October 1, 1992

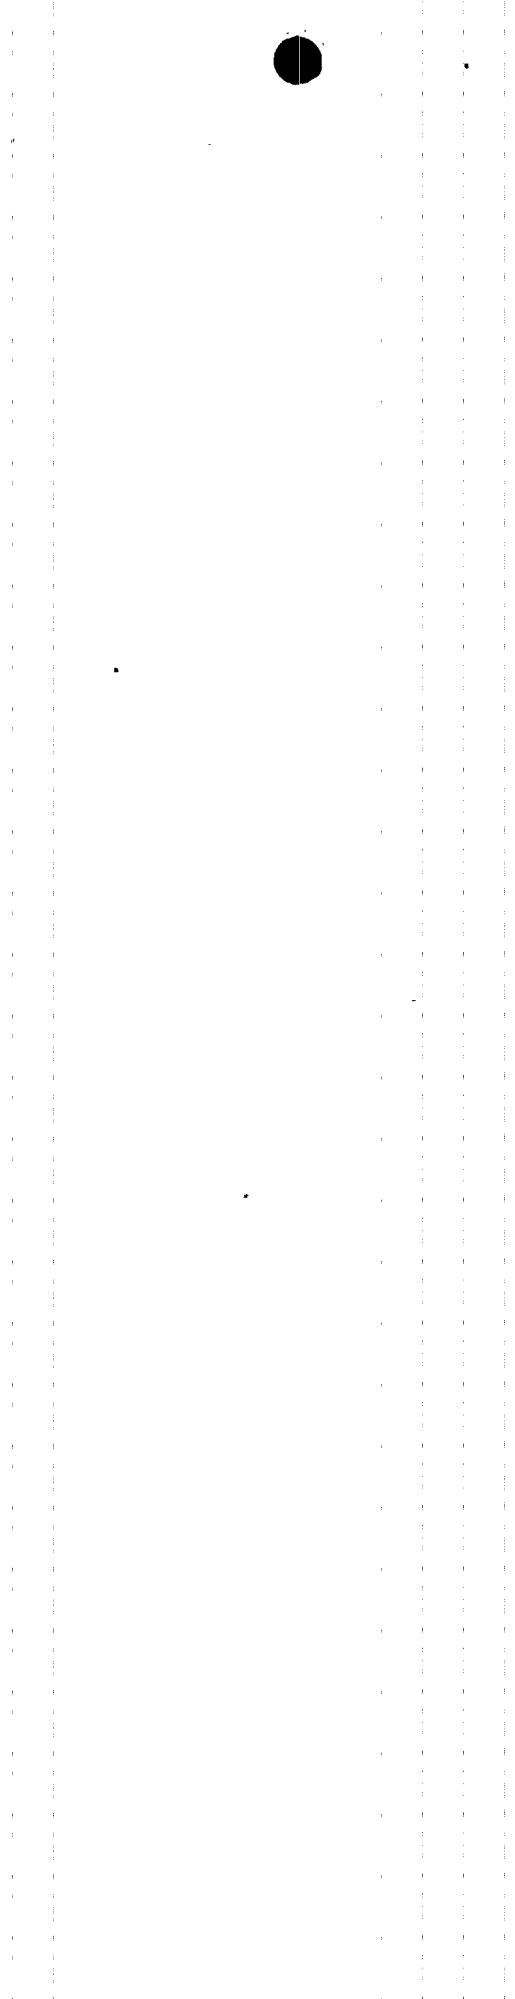

ATTACHMENT TO LICENSE AMENDMENT

AMENDMENT NO. 38 TO FACILITY OPERATING LICENSE NO. NPF-74

DOCKET NO. STN 50-530


Replace the following pages of the Appendix A Technical Specifications with the enclosed pages. The revised pages are identified by amendment number and contain vertical lines indicating the areas of change.

Remove

3/4 7-15
B 3/4 7-4

Insert

3/4 7-15
B 3/4 7-4

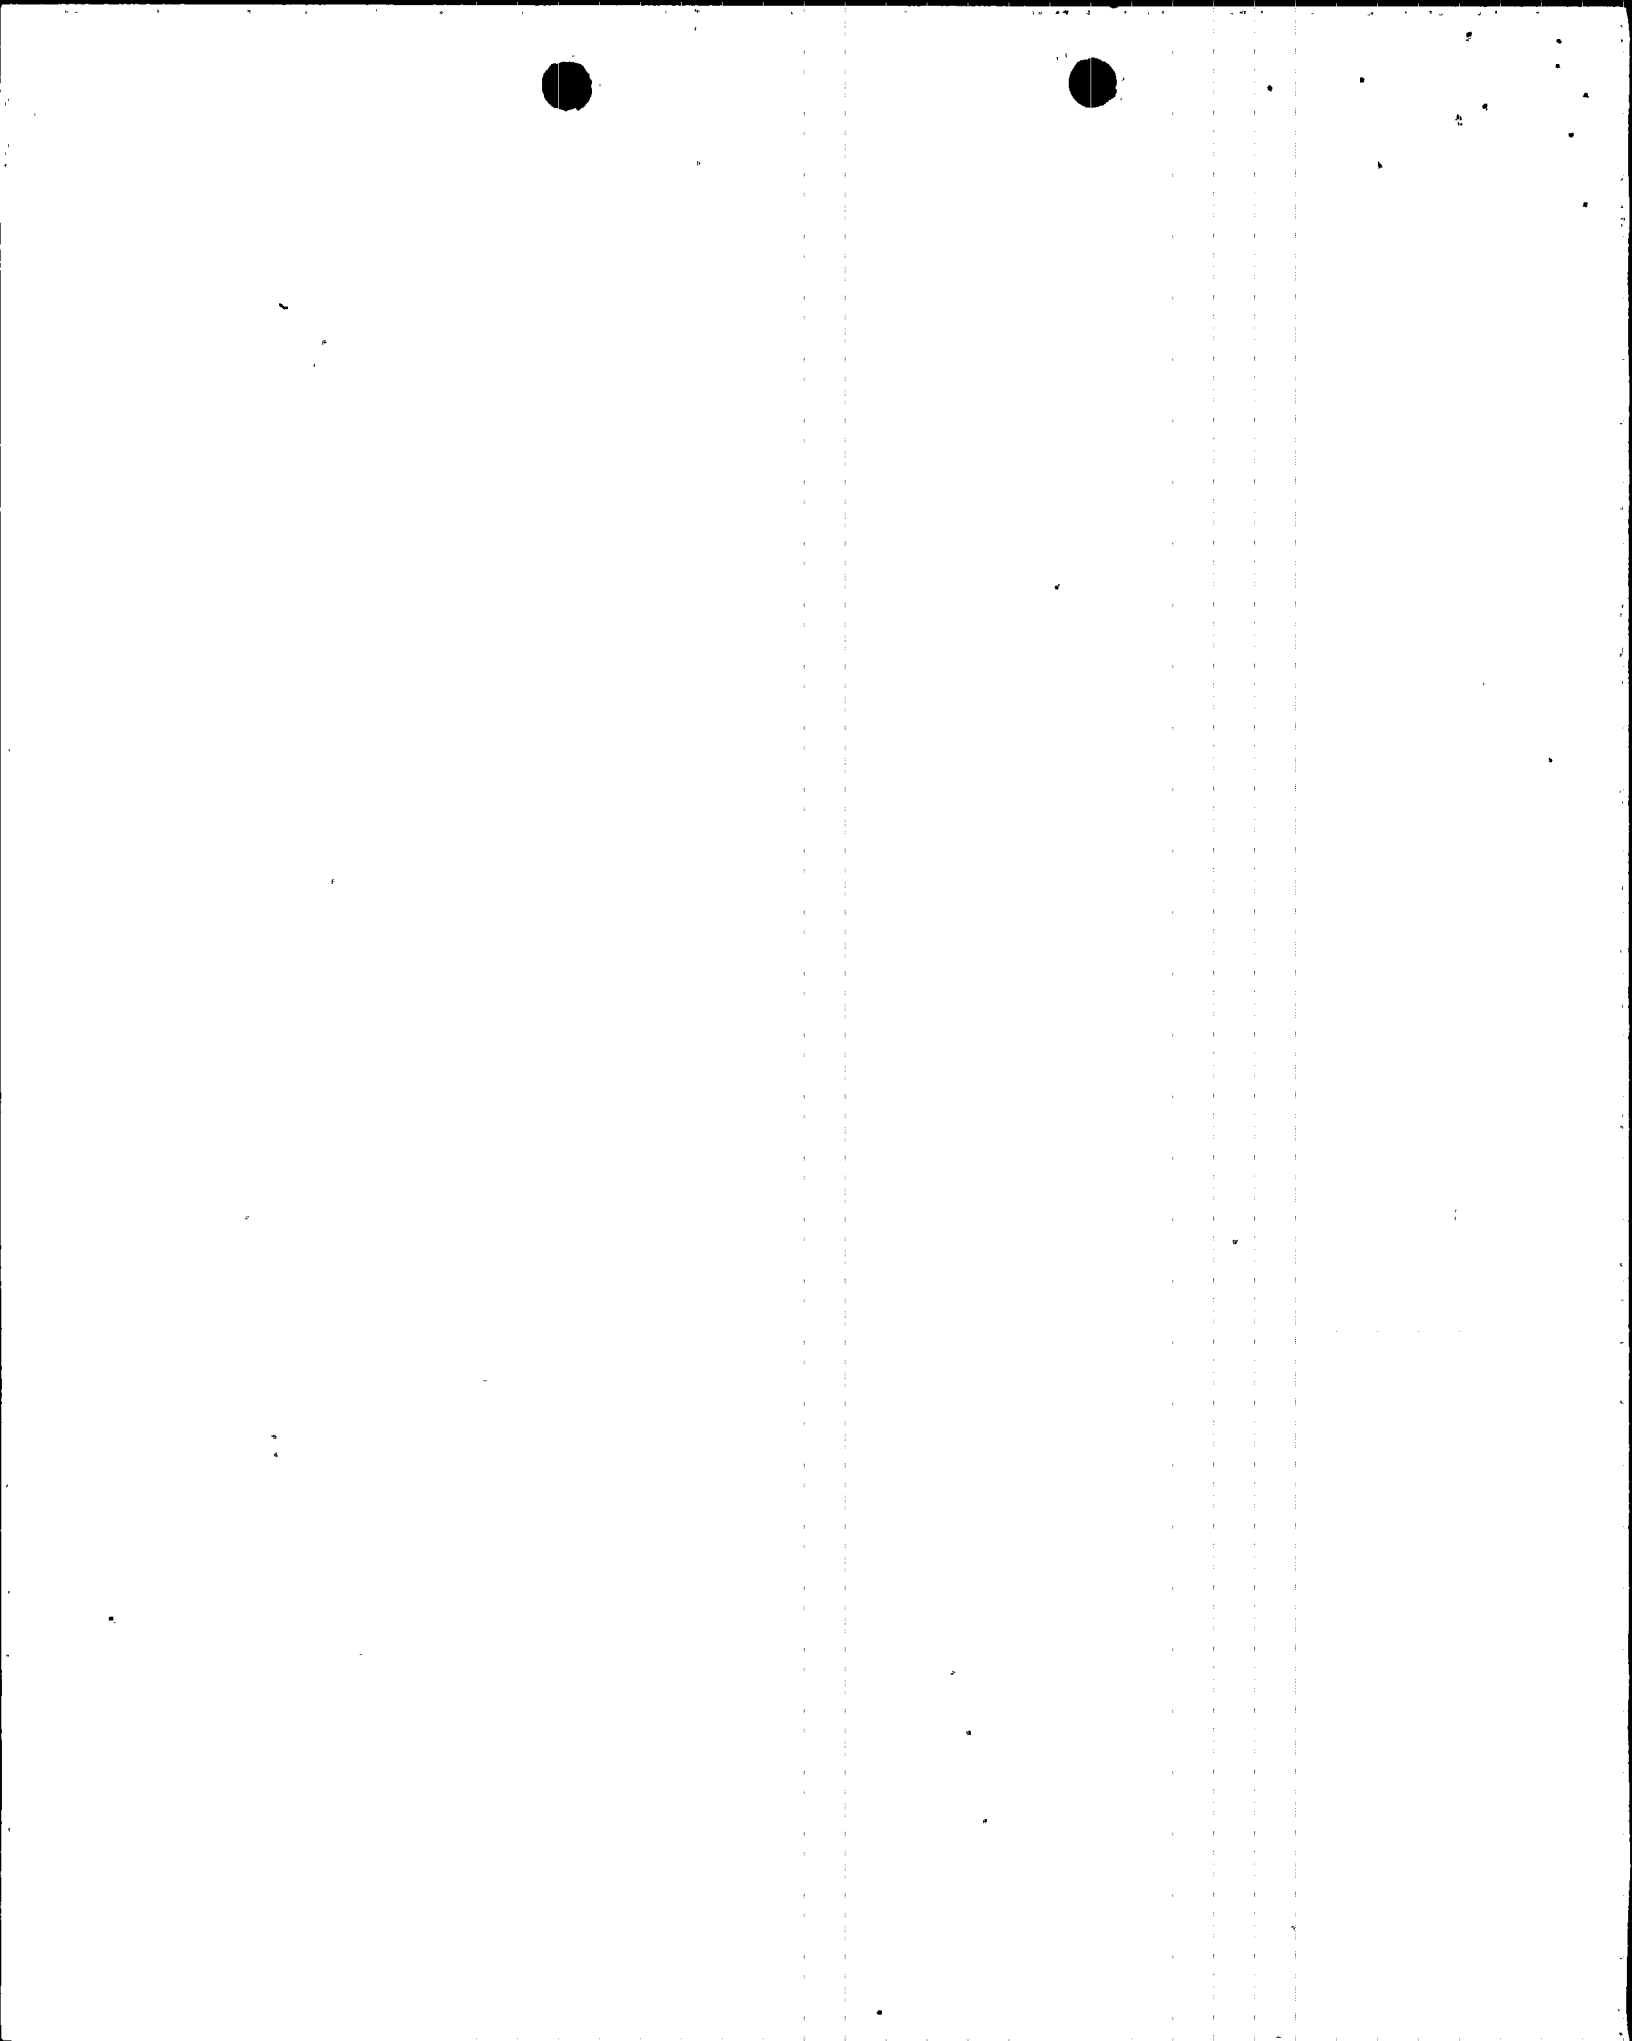

PLANT SYSTEMS

3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.6 At least two independent essential chilled water loops shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With only one essential chilled water loop OPERABLE, restore at least two loops to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With only one essential chilled water system OPERABLE:
 1. Within 1 hour verify that the normal HVAC system is providing space cooling to the vital power distribution rooms that depend on the inoperable essential chilled water system for space cooling, and
 2. Within 8 hours establish OPERABILITY of the safe shutdown systems which do not depend on the inoperable essential chilled water system (one train each of boration, pressurizer heaters and auxiliary feedwater), and
 3. Within 24 hours establish OPERABILITY of all required systems, subsystems, trains, components, and devices that depend on the remaining OPERABLE essential chilled water system for space cooling.

If these conditions are not satisfied within the specified time, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.7.6.1 At least two essential chilled water loops shall be demonstrated OPERABLE at least once per 31 days by verifying that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is not locked, sealed, or otherwise secured in position, is in its correct position.

4.7.6.2 Once per 18 months during shutdown, verify that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is locked, sealed, or otherwise secured in position, is in its correct position.

PLANT SYSTEMS

3/4.7.7 CONTROL ROOM ESSENTIAL FILTRATION SYSTEM

LIMITING CONDITION FOR OPERATION

3.7.7 Two independent control room essential filtration systems shall be OPERABLE.

APPLICABILITY: All MODES.

ACTION:

MODES 1, 2, 3, and 4:

With one control room essential filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

MODES 5 and 6:

- a. With one control room essential filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or initiate and maintain operation of the remaining OPERABLE control room essential filtration system.
- b. With both control room essential filtration systems inoperable, or with the OPERABLE control room essential filtration system, required to be OPERABLE by ACTION a., not capable of being powered by an OPERABLE emergency power source, suspend all operations involving CORE ALTERATIONS or positive reactivity changes.

SURVEILLANCE REQUIREMENTS

4.7.7 Each control room essential filtration system shall be demonstrated OPERABLE:

- a. At least once per 31 days on a STAGGERED TEST BASIS by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 15 minutes.
- b. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire, or chemical release in any ventilation zone communicating with the system by:

PLANT SYSTEMS

BASES

3/4.7.1.4 ACTIVITY

The limitations on secondary system specific activity ensure that the resultant offsite radiation dose will be limited to a small fraction of 10 CFR Part 100 limits in the event of a steam line rupture. This dose also includes the effects of a coincident 1 gpm primary-to-secondary tube leak in the steam generator of the affected steam line and a concurrent loss-of-offsite electrical power. These values are consistent with the assumptions used in the safety analyses.

3/4.7.1.5 MAIN STEAM LINE ISOLATION VALVES

The OPERABILITY of the main steam line isolation valves ensures that no more than one steam generator will blow down in the event of a steam line rupture. This restriction is required to (1) minimize the positive reactivity effects of the Reactor Coolant System cooldown associated with the blowdown, and (2) limit the pressure rise within containment in the event the steam line rupture occurs within containment. The OPERABILITY of the main steam isolation valves within the closure times of the surveillance requirements are consistent with the assumptions used in the safety analyses.

3/4.7.1.6 ATMOSPHERIC DUMP VALVES

The limitation on maintaining the nitrogen accumulator at a pressure ≥ 400 psig is to ensure that a sufficient volume of nitrogen is in the accumulator to operate the associated ADV which holds the plant at hot standby while dissipating core decay heat or which allows a flow of sufficient steam to maintain a controlled reactor cooldown rate. A pressure of 400 psig retains sufficient nitrogen volume for 4 hours of operation at hot standby plus 6.5 hours of operation to reach cold shutdown under natural circulation conditions in the event of failure of the normal control air system.

3/4.7.2 STEAM GENERATOR PRESSURE/TEMPERATURE LIMITATION

The limitation on steam generator pressure and temperature ensures that the pressure induced stresses in the steam generators do not exceed the maximum allowable fracture toughness stress limits. The limitations to 120°F and 230 psig are based on a steam generator RT_{NDT} of 40°F and are sufficient to prevent brittle fracture.

3/4.7.3 ESSENTIAL COOLING WATER SYSTEM

The OPERABILITY of the essential cooling water system ensures that sufficient cooling capacity is available for continued operation of safety-related equipment during normal and accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

PLANT SYSTEMS

BASES

3/4.7.4 ESSENTIAL SPRAY POND SYSTEM

The OPERABILITY of the essential spray pond system ensures that sufficient cooling capacity is available for continued operation of equipment during normal and accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

3/4.7.5 ULTIMATE HEAT SINK

The limitations on the ultimate heat sink level and temperature ensure that sufficient cooling capacity is available to either (1) provide normal cooldown of the facility, or (2) to mitigate the effects of accident conditions within acceptable limits.

The limitations on minimum water level and maximum temperature are based on providing a 27-day cooling water supply to safety-related equipment without exceeding their design basis temperature and is consistent with the intent of the recommendations of Regulatory Guide 1.27, "Ultimate Heat Sink for Nuclear Plants," March 1974.

3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM

The OPERABILITY of the essential chilled water system ensures that sufficient cooling capacity is available for continued operation of equipment and control room habitability during accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

The Essential Chilled Water System (ECWS), in conjunction with respective emergency HVAC units, is required in accordance with Specification Definition 1.18 to provide heat removal in maintaining the various Engineered Safety Features (ESFs) room space design temperatures below the associated equipment qualification limits for the range of Design Basis Accident conditions. The 72 hour ACTION requirement for a single ECWS train out-of-service is consistent with the operability requirements of the Emergency Core Cooling System, Essential Cooling Water System, Auxiliary Feedwater System, and Containment Spray System Limiting Conditions for Operation. The normal HVAC system is used in maintaining the space design conditions of required safety systems during normal operating conditions. The normal HVAC system is also used in maintaining the space design conditions in the vital power distribution rooms during normal operating conditions. Action requirements are provided to ensure operability of the vital bus inverters and emergency battery chargers, by verifying within one hour that the normal HVAC system is providing space cooling to the vital power distribution rooms. The Action requirement is provided to establish within 8 hours operability of the safe shutdown systems which do not depend on the inoperable ECWS. The 8 hour period provides a reasonable time in which to establish operability of this complement of key safety systems. This requirement ensures that a functional train of safe shutdown equipment is available to put the plant in a safe, stable condition for the most probable abnormal operational occurrences. An Action requirement of 24 hours is provided to establish operability of the remaining required safety systems which do not depend on the inoperable ECWS.