


REVISIONS					
NO	DATE	DESCRIPTION	BY	CH	APPROVED
0	7/16/84	THE FOLLOWING CHANGES MADE PRIOR TO DRAWING ISSUE: GEN. C.E. DWG. N° 8, TO EBASCO DWG. N° 8, WHERE APPLICABLE (NOT CIRCLED).	A.E.Z.	A.S.	[Signature]
1	1/7/85	PC/M-285-286 ADDED (G2) VALVE GENERAL REVISIONS REVISED: (G3, F3, E3, D3) VA. MODE	A.S.	A.S.	[Signature]
2	3/4/85	PC/M-285-283 PREVIOUSLY INCORPORATED BY C.E.	A.H.	A.S.	[Signature]
3	9/4/86	APPD BY A.I. UGLOW P.L. PE # 31840 PC/M-285-284: GENERAL PIPING REVISION GEN. REV. (B #) NOTE	A.S.	A.S.	[Signature]

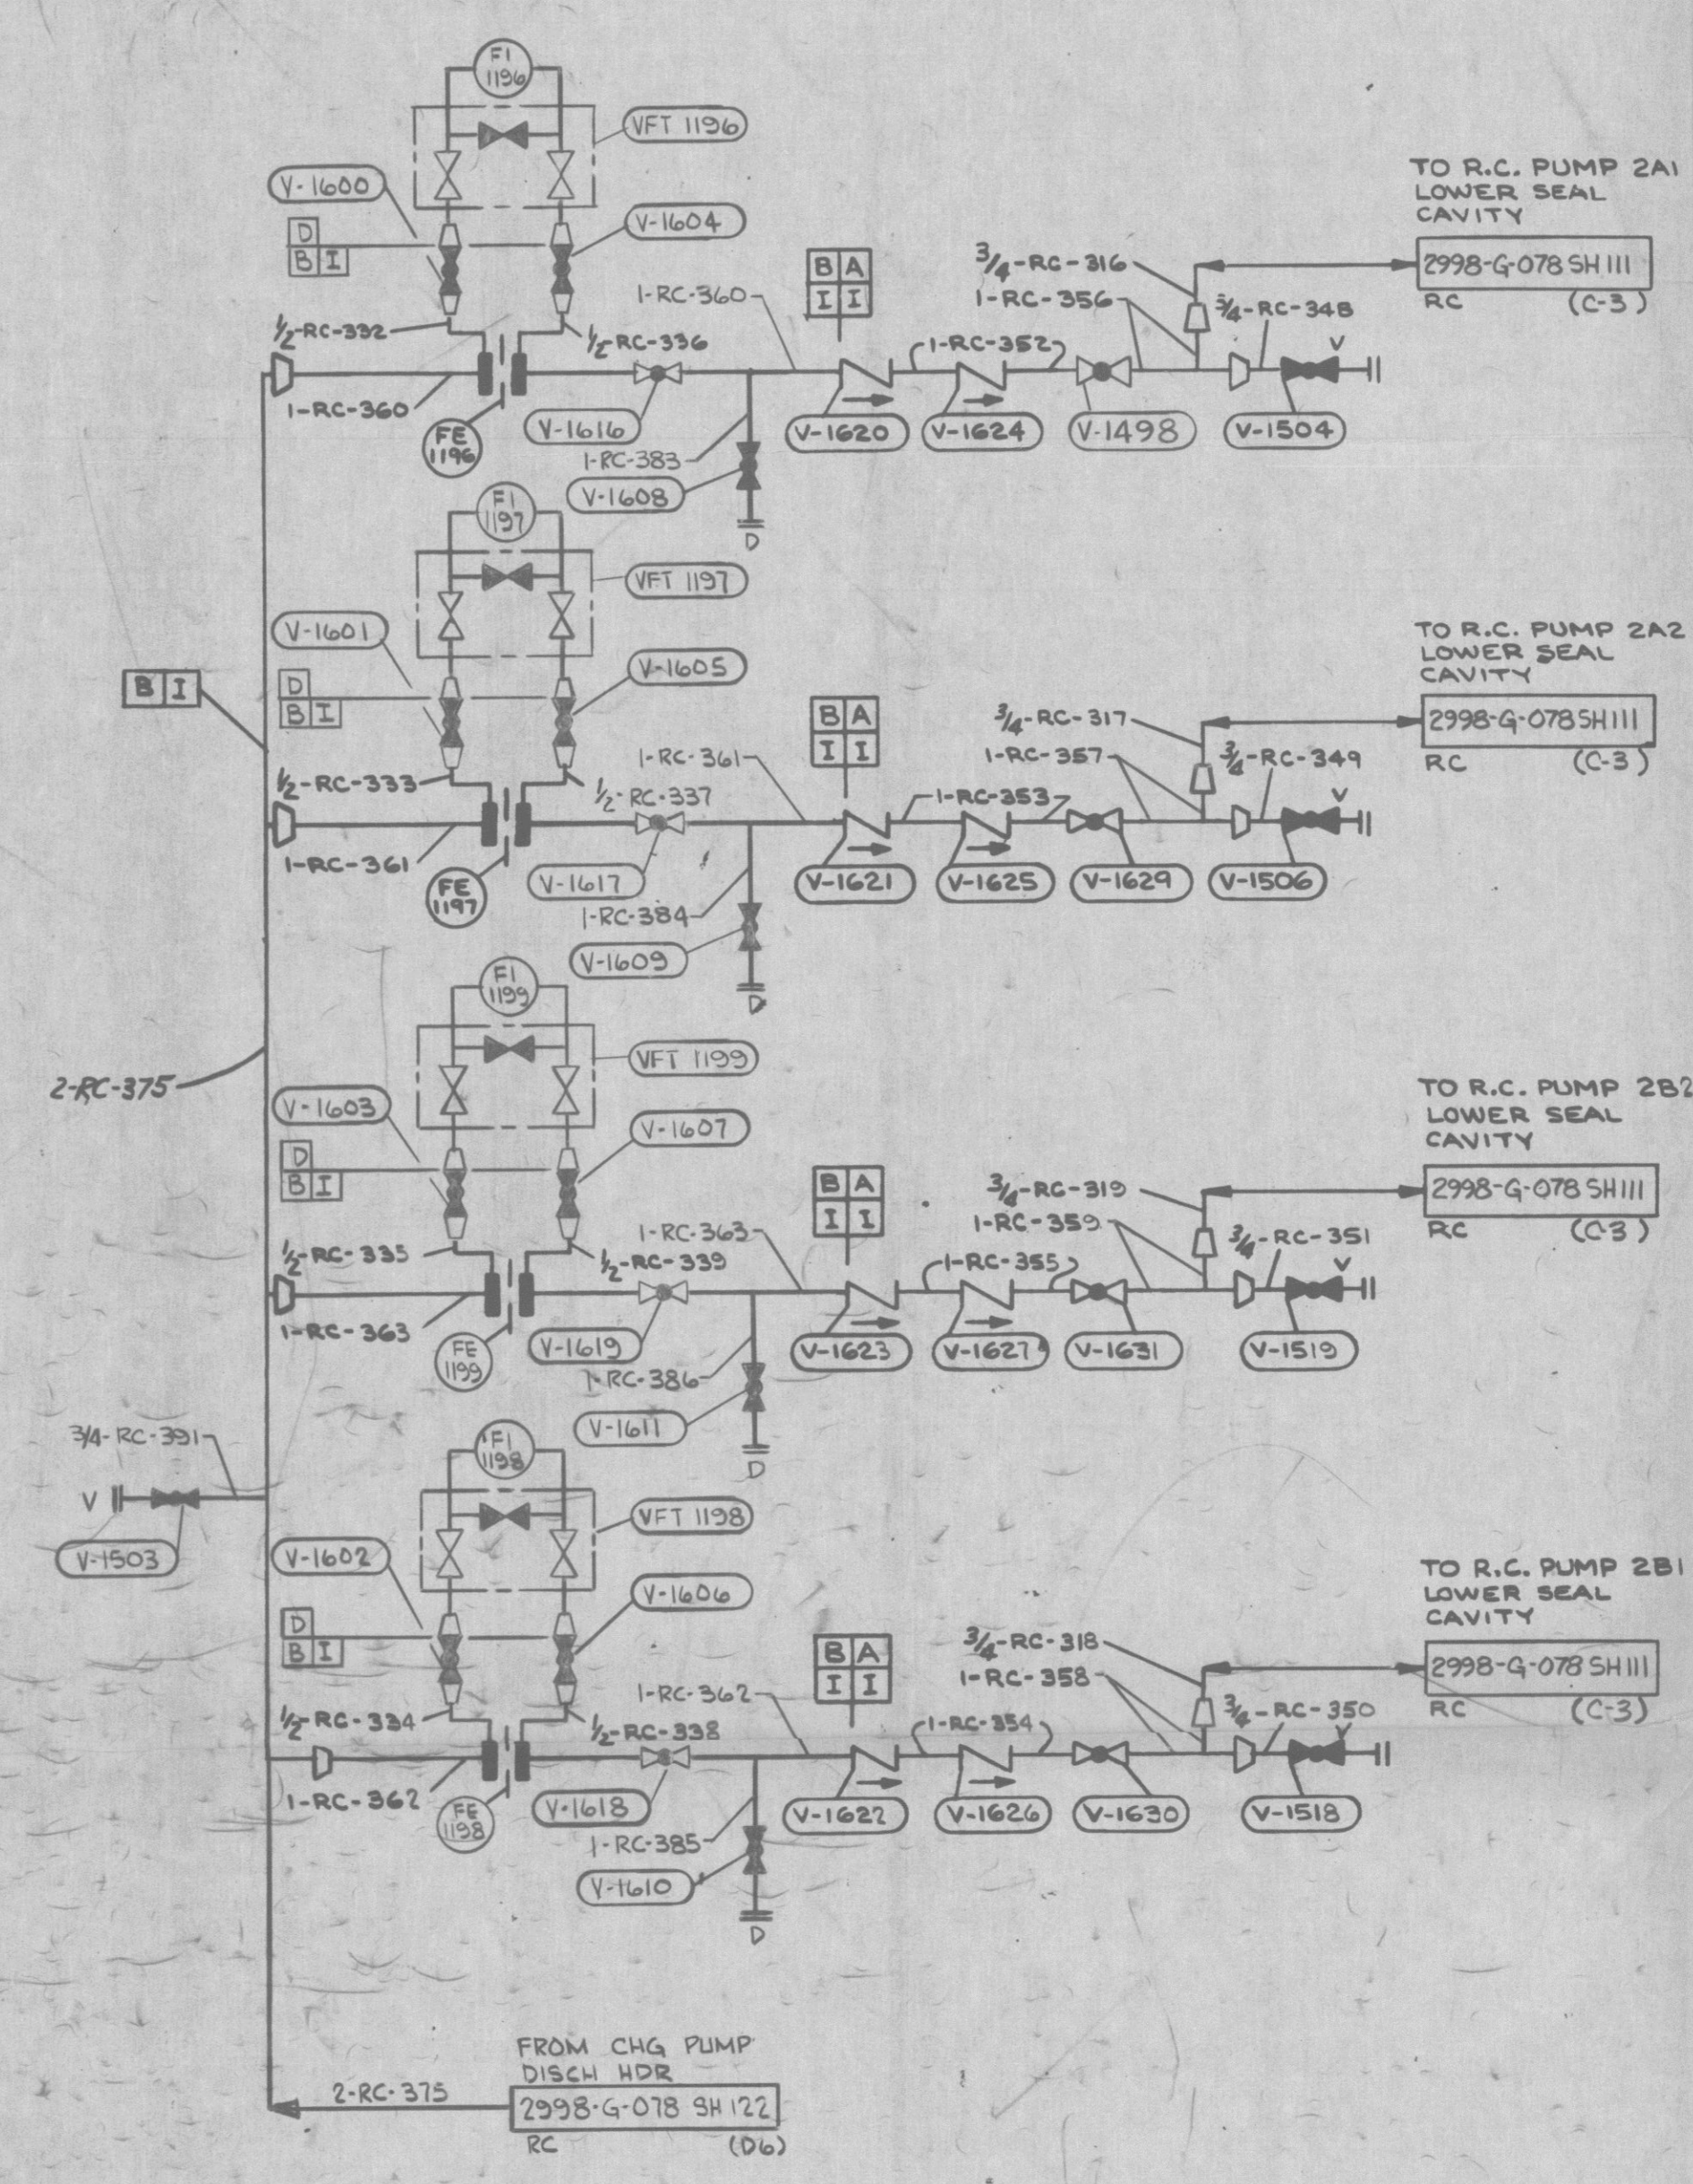

FOR SYMBOLS, ABBREVIATIONS & REFERENCE DRAWINGS SEE DWG 2998-G-078 SH. 100

Docket # 50-335
Contract # 2998-060201-71
Date 8/30/82
REGULATORY DOCKET FILE

RECEIVED
OCT 07 1986

DOCUMENT CONTROL CENTER
INFORMATION ONLY

VERIFY WITH A CONTROLLED COPY
THE INFORMATION SHOWN ON REV 0 OF THIS DRAWING HAS BEEN PHOTOGRAPHICALLY REPRODUCED FROM COMBUSTION ENGINEERING DRAWING NO E-1372-30-15 REV 7 (COMPAR NUMBER 2998-14980, REV 6 J), AND EBASCO SERVICES INCORPORATED BEARS NO RESPONSIBILITY FOR THE DESIGN INFORMATION SHOWN.

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF SEPTEMBER 1, 1975 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST LUCIE PLANT
1983 890 MW(D) EXTENSION - UNIT NO. 2
FLOW DIAGRAM
REACTOR COOLANT PUMP
SEAL INJECTION ADDITION
EBASCO SERVICES INCORPORATED

SCALE: N/A
APPROVED: [Signature]
DATE: 5/16/84
DIV. MECH: [Signature]
DR. AEZ: [Signature]
CH. SWENSON: [Signature]

2998-G-078
SHEET 115
3

NUCLEAR SAFETY
RELATED

ST
APERTURE
CARD

H
G
F
E
D
C
B
A

8 7 6 5 4 3 2 1 0