


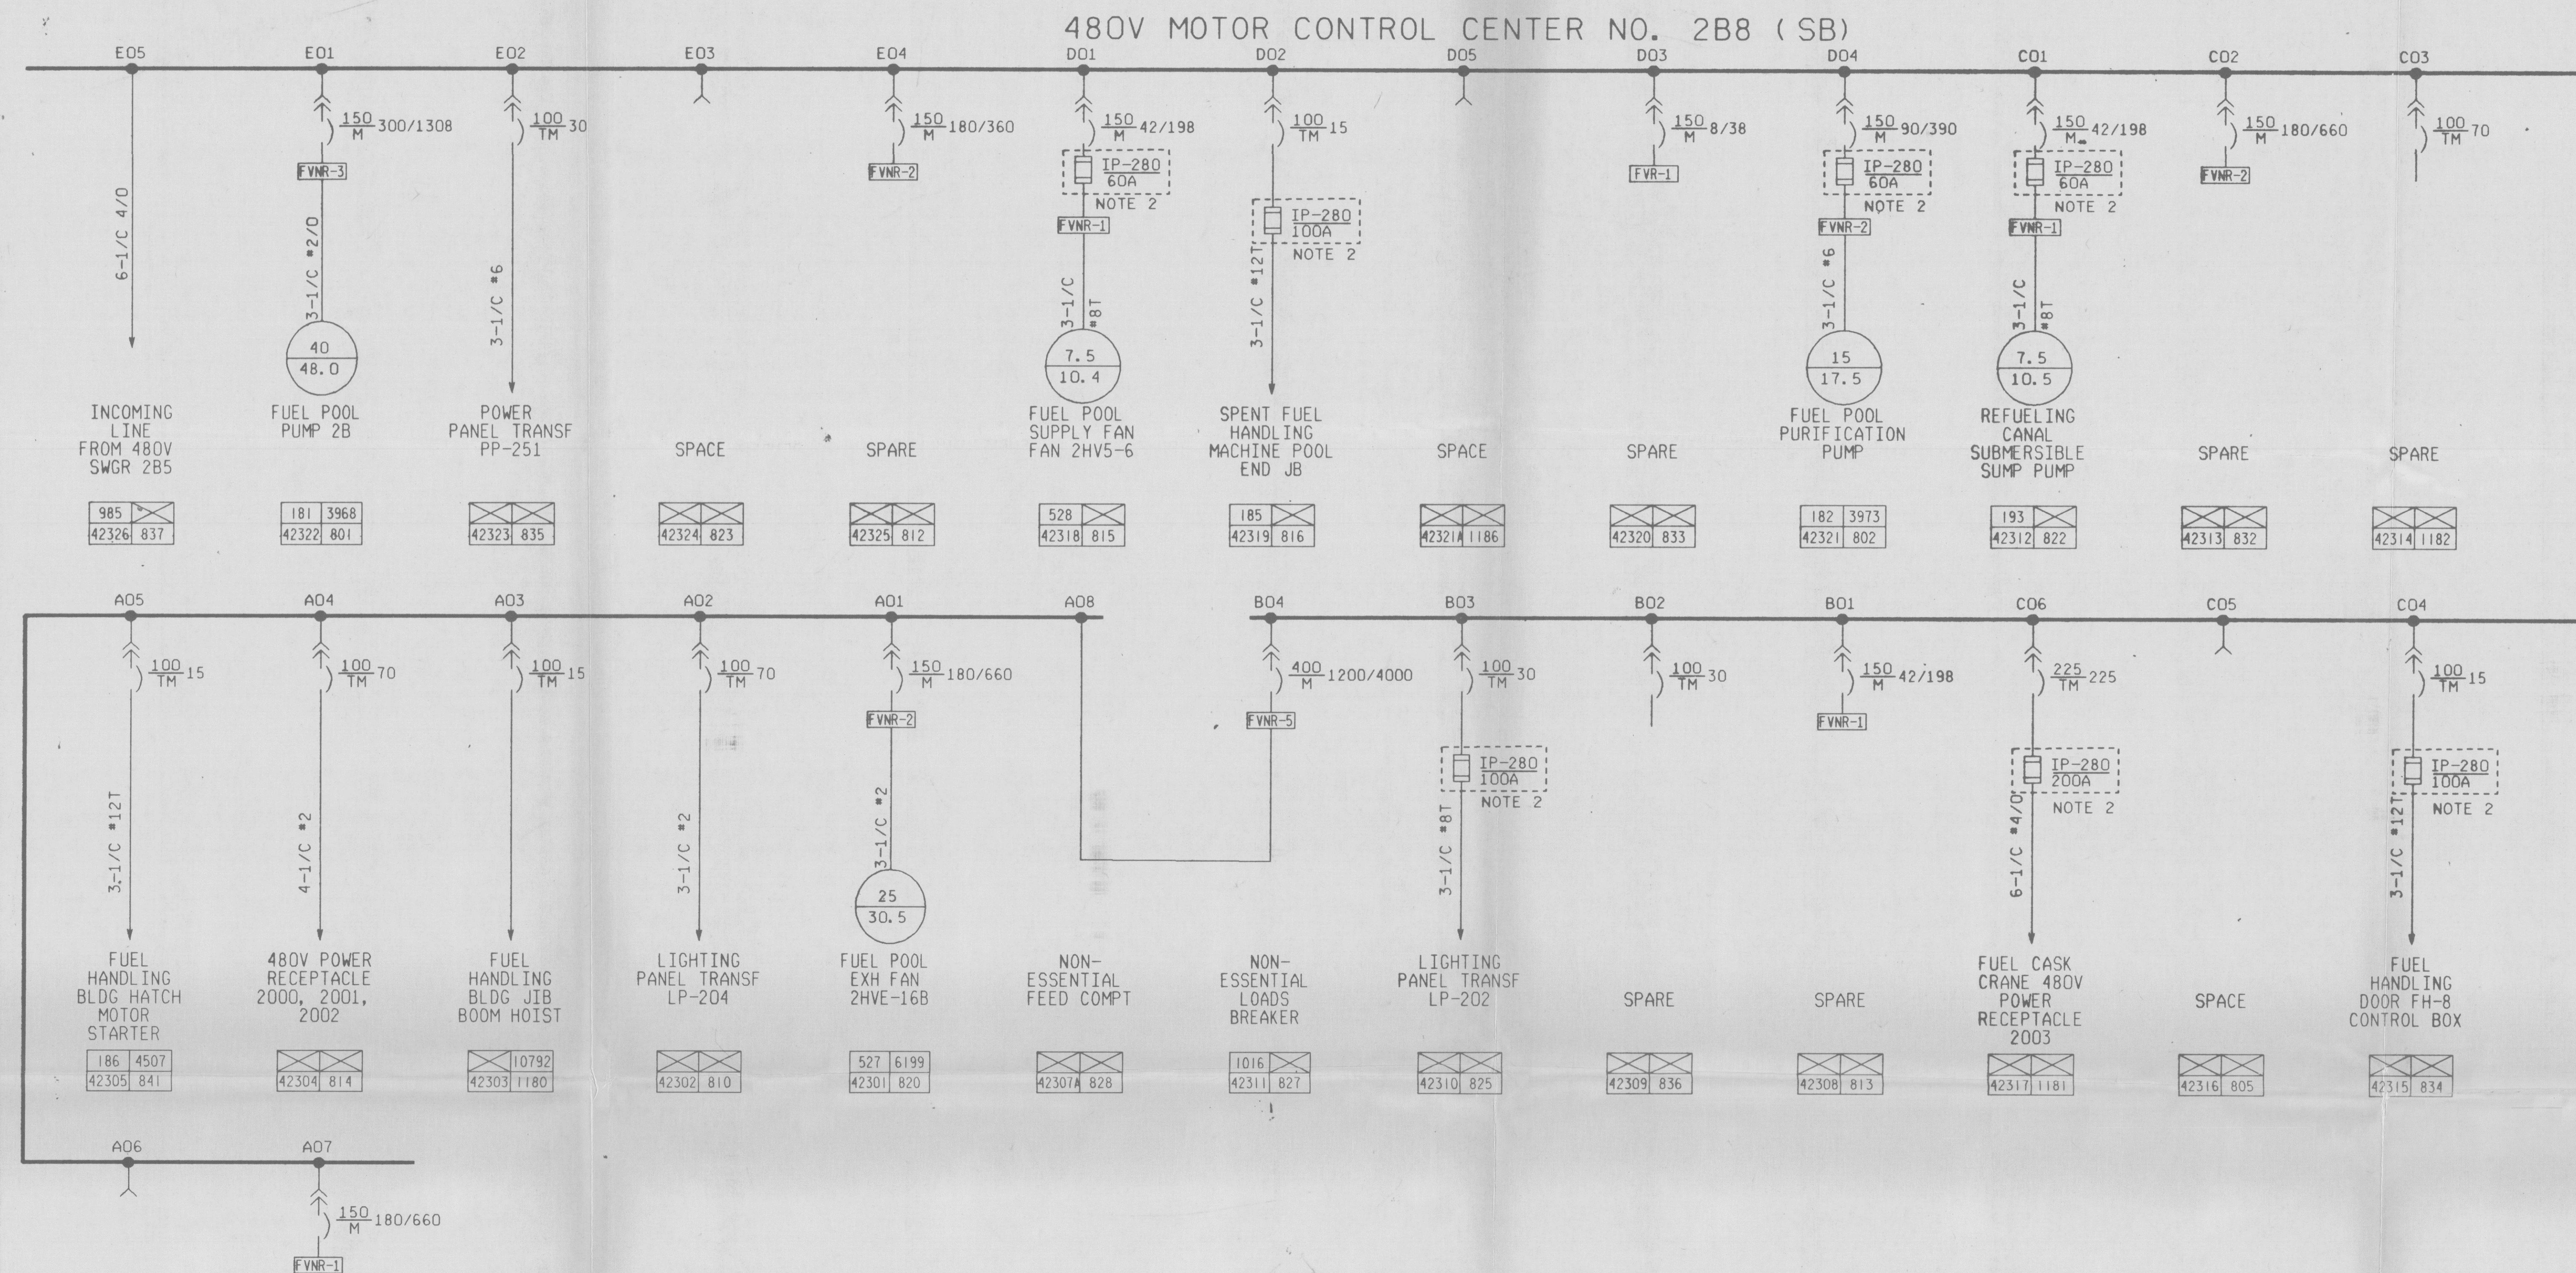

- NOTES:
1. FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS SEE INDEX DRAWING 2998-G-275SH.A
 2. SECOND PROTECTIVE DEVICE IS REQUIRED TO ASSURE CIRCUIT IS IN CONFORMANCE WITH NRC REG. GUIDES 1.63 OR 1.75.

STATE OF FLORIDA
ALAN L. SCHILDKRAUT
29996
Registered PE

Approval Date: 04/03/84

NUCLEAR SAFETY RELATED

THE ORIGINAL DRAWING WITH APPROVAL SIGNATURES AND THE PE SEAL AND SUBSEQUENT REVISIONS THEREOF WITH APPROVAL NAMES AND INITIALS ARE MAINTAINED IN THE FILES OF EBASCO SERVICES INCORPORATED.

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF SEPT. 1, 1975, BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.


FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983-890MW (e) EXTENSION-UNIT NO. 2

**480V MOTOR CONTROL CENTER
NO. 2B8 & NO. 2B9
ONE LINE DIAGRAMS**

EBASCO SERVICES INCORPORATED

SCALE: NONE
APPROVED: A. SCHILDKRAUT
DATE: 04-03-84
DIV. ELECTRICAL
DR. J. McKNIGHT
CH. R. ENGESSER

2998-G-275
SHEET 42

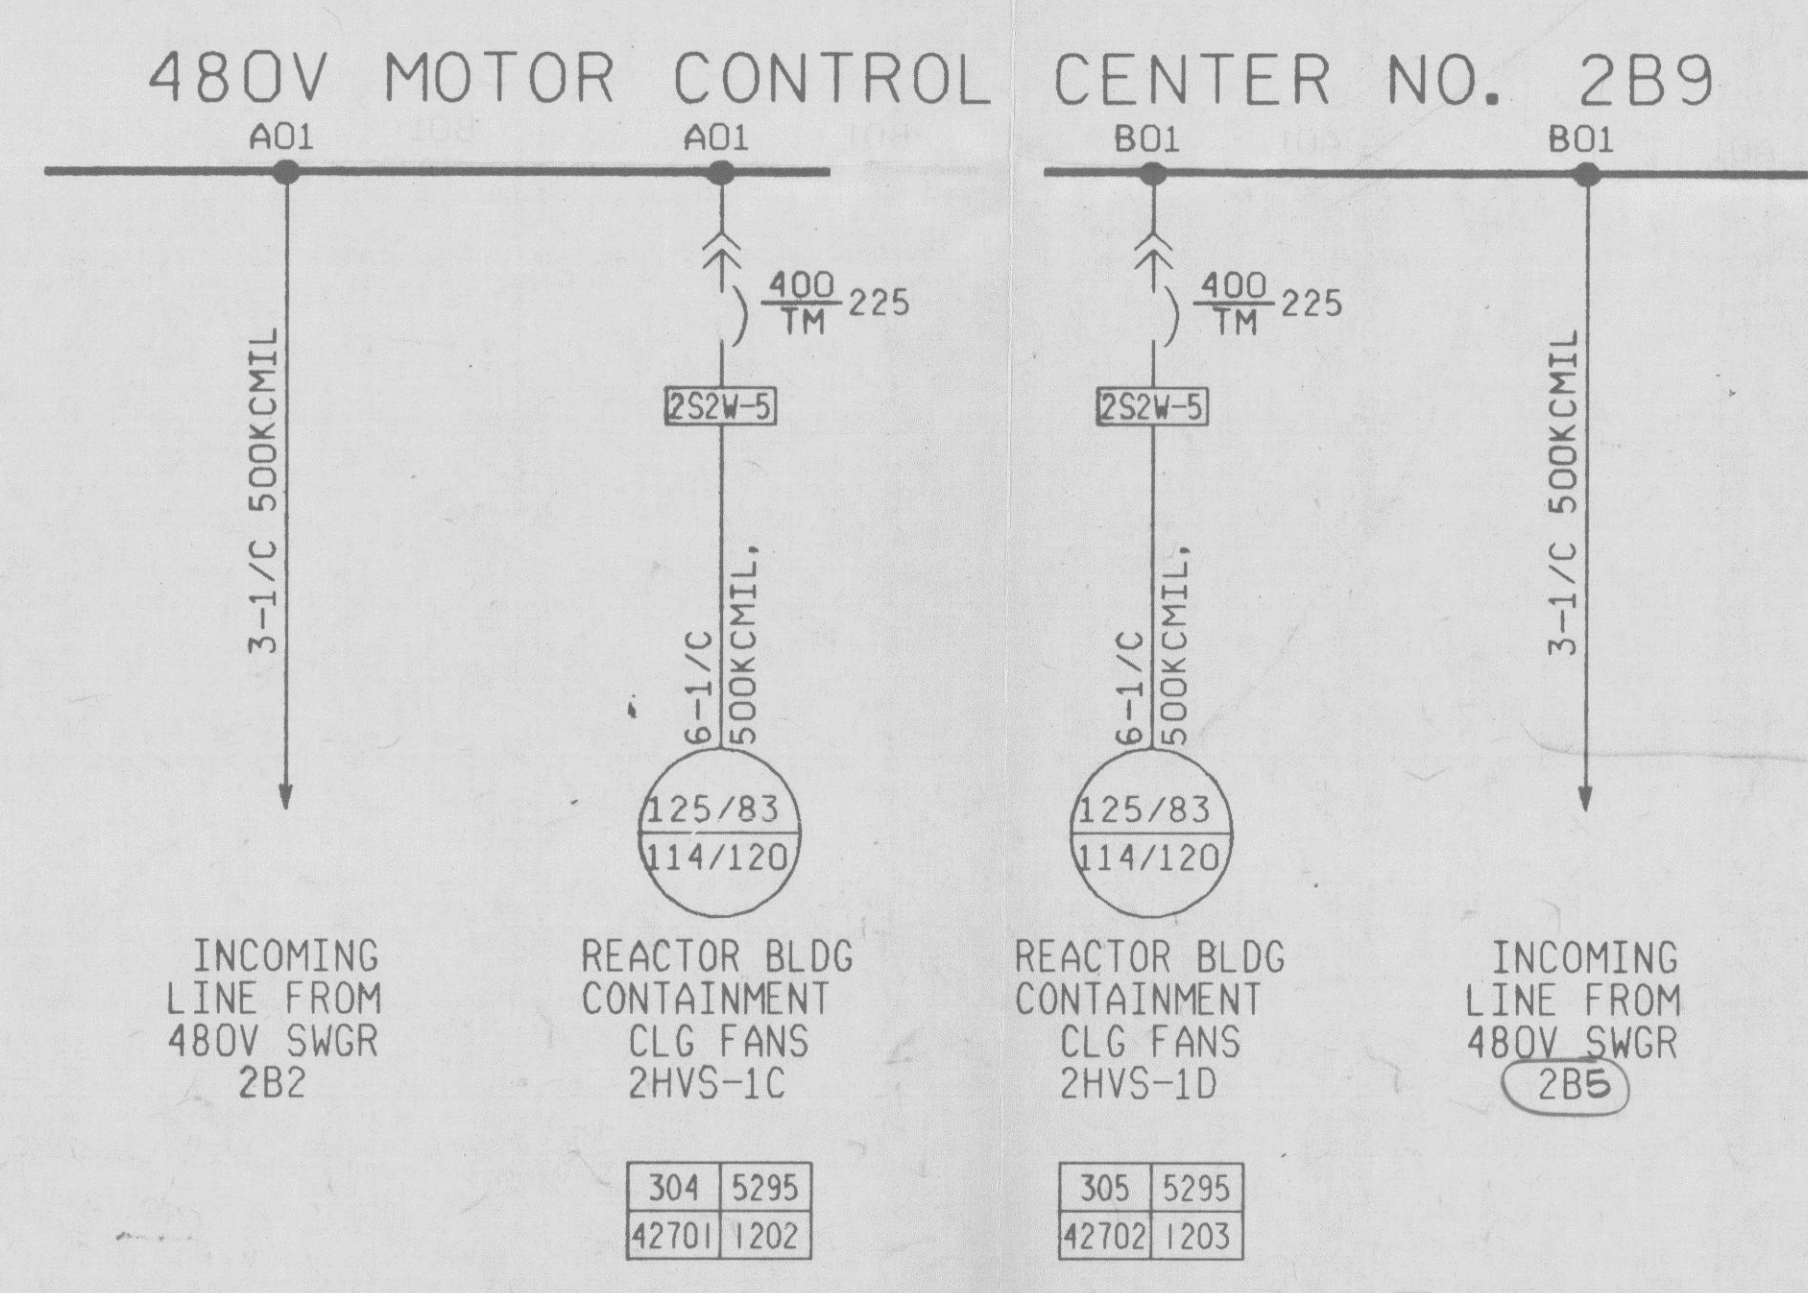

NO	DATE	REVISION	BY	CH	APPROVED
1	11-18-86	REVISED 2011(NII) PER GENERAL AS BUILT	AP	R.C.	
2	8-6-85	DESIGNED (NOTE 1) DNG NO. (AZ, N) PER GENERAL AS BUILT	JVC	R.C.	
3	5-28-85	REVISED: NOTE (418) PER PDM 015-293	GOUD	R.C.	

INFORMATION ONLY
VERIFY WITH A CONTROLLED COPY BEFORE USE.