

# PRIORITY 1

(ACCELERATED RIDS PROCESSING)

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9510270010      DOC. DATE: 95/10/11      NOTARIZED: NO      DOCKET #  
 FACIL: STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Public Service Co.      05000529  
 AUTH. NAME      AUTHOR AFFILIATION  
 LEVINE, J.M.      Arizona Public Service Co. (formerly Arizona Nuclear Power  
 RECIP. NAME      RECIPIENT AFFILIATION  
                          Document Control Branch (Document Control Desk) *See Report*

SUBJECT: Forwards Suppl 1 to "Palo Verde Nuclear Generating Station  
 Unit 2 SG Eddy Current Exam 5th Refueling Outage."

DISTRIBUTION CODE: A047D      COPIES RECEIVED: LTR 1 ENCL 1      SIZE: 14.350  
 TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code - GL-89-04

NOTES: Standardized plant. 05000529


	RECIPIENT		COPIES		
	ID CODE/NAME	LTR	ENCL		
	PD4-2 LA	1	1		
	HOLIAN, B	1	1		
INTERNAL:	ACRS	6	0		
	<del>FILE CENTER</del> 01	1	1		
	NRR/DE/EMCB	1	1		
	NUDOCS-ABSTRACT	1	1		
	RES/DSIR/EIB	1	1		
EXTERNAL:	LITCO ANDERSON	1	1		
	NRC PDR	1	1		
	PD4-2 PD	1	1		
	TRAN, L	1	1		
	AEOD/SPD/RAB	1	1		
	NRR/DE/ECGB	1	1		
	NRR/DE/EMEB	1	1		
	OGC/HDS2	1	0		
	NOAC	1	1		

**NOTE TO ALL "RIDS" RECIPIENTS:**

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL  
 DESK, ROOM OWFN 5D8 (415-2083) TO ELIMINATE YOUR NAME FROM  
 DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 21 ENCL 14

MA-2

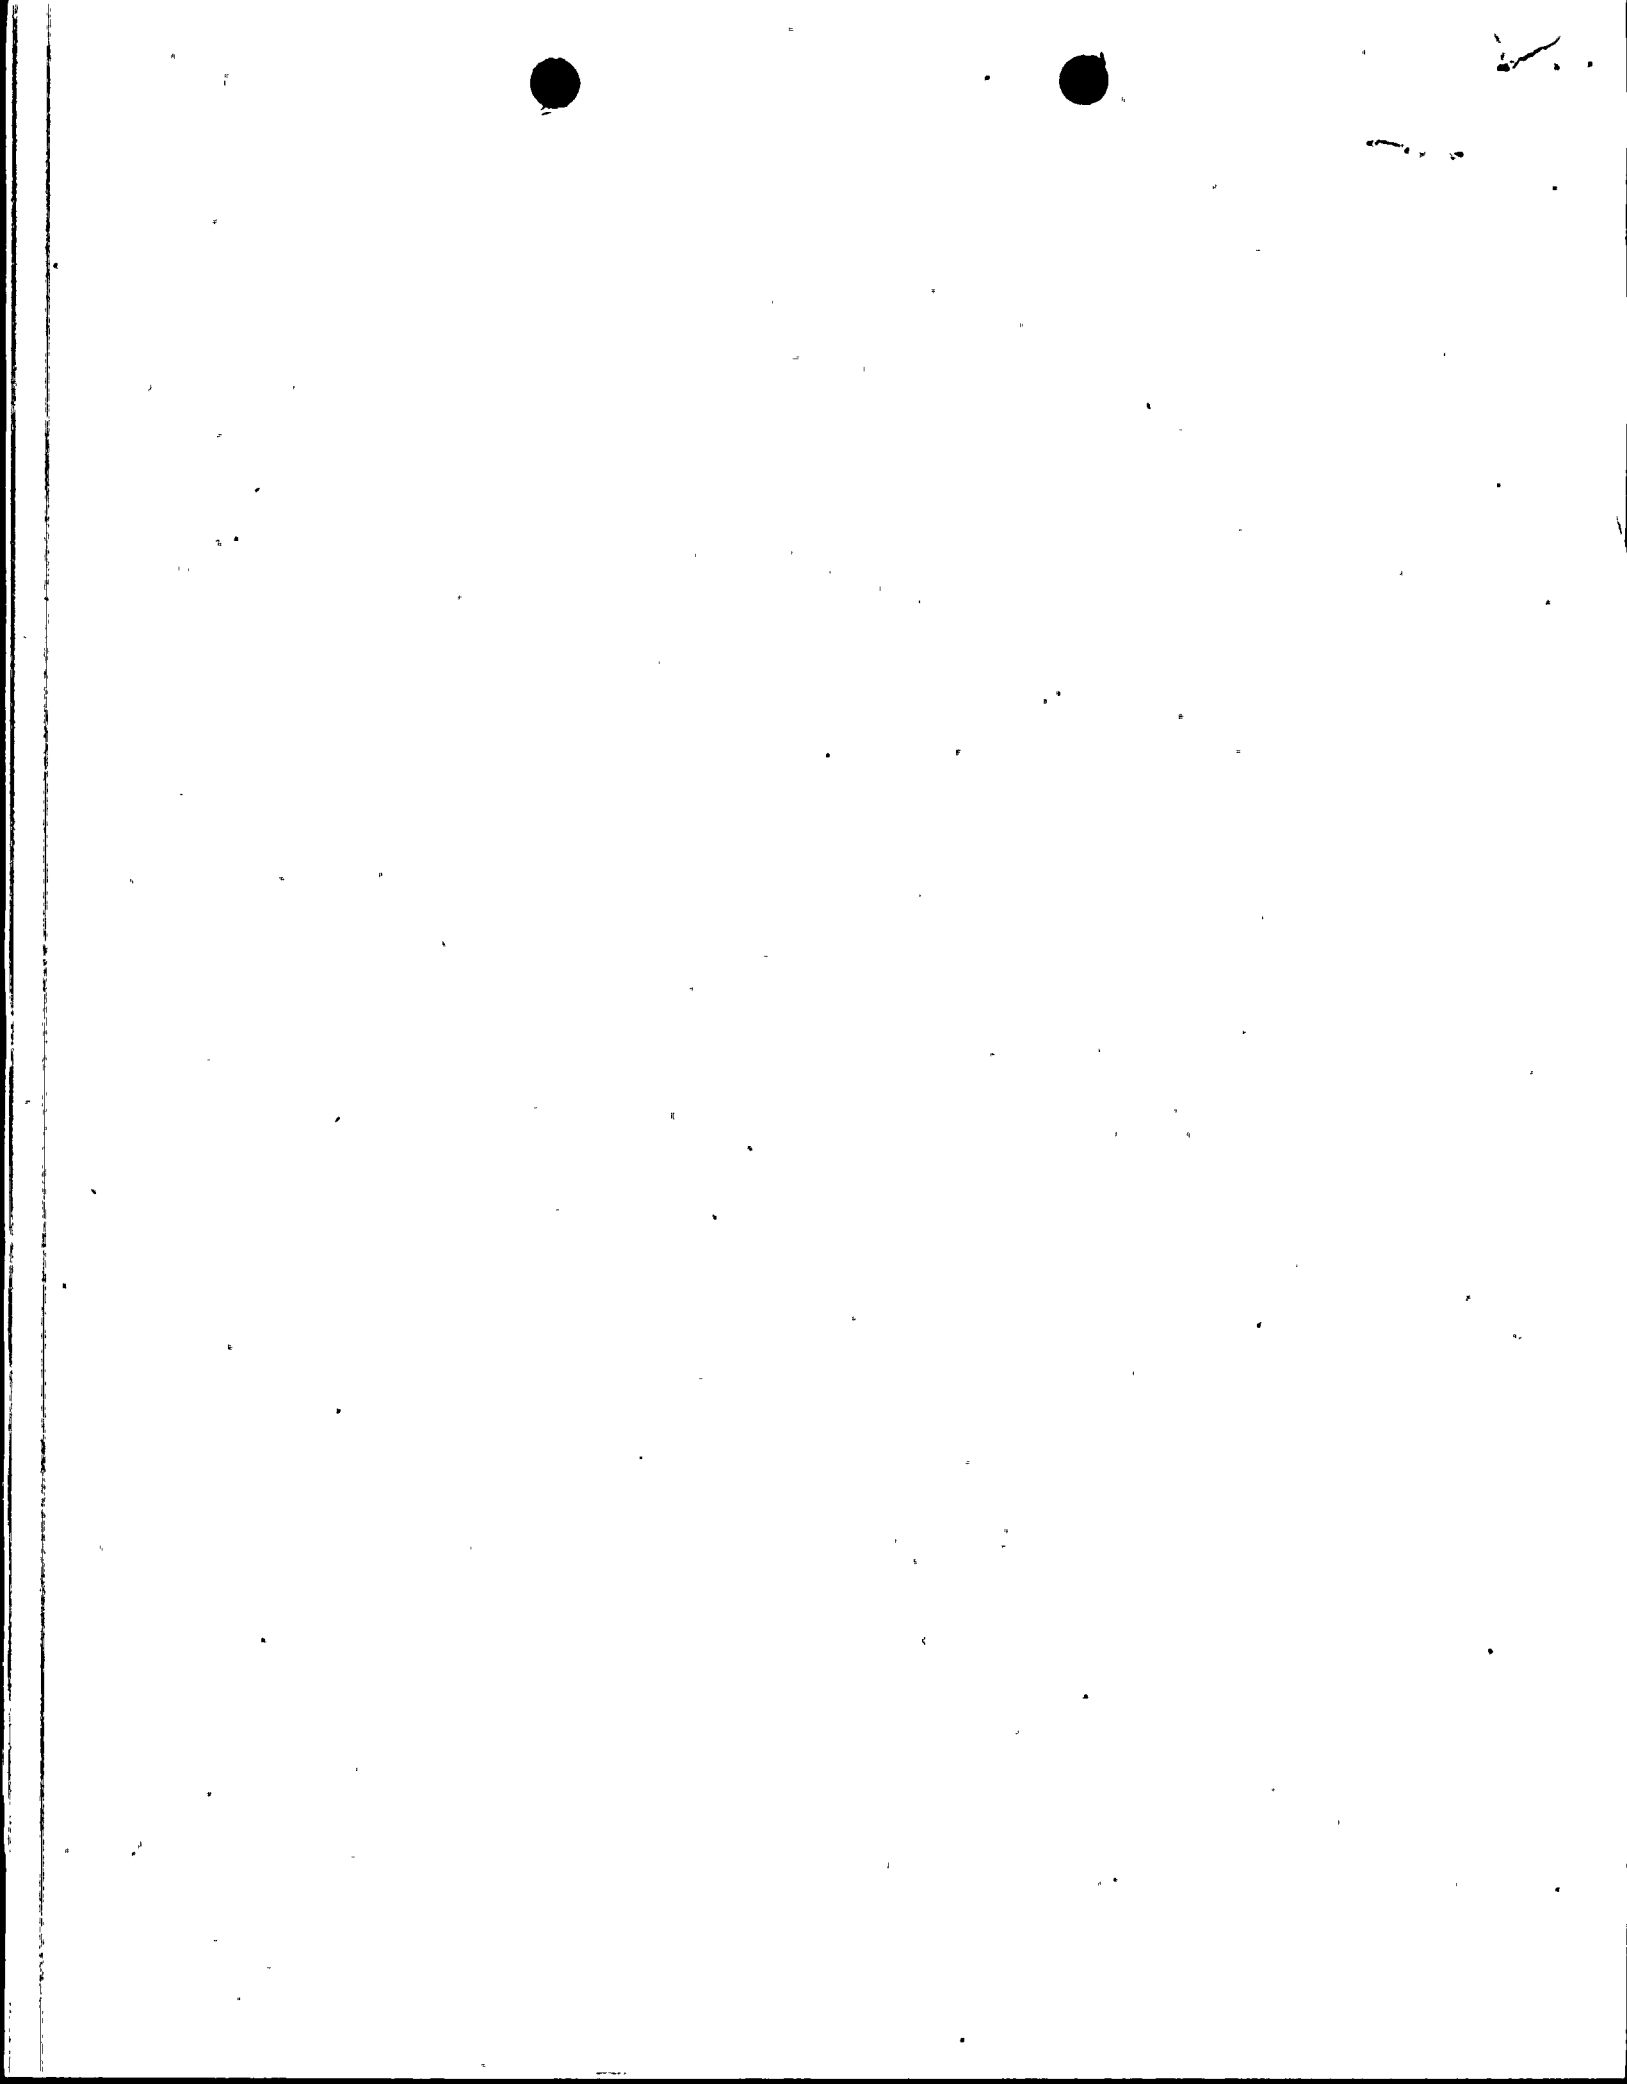

**Arizona Public Service Company**

PALO VERDE NUCLEAR GENERATING STATION

P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

192-00950-JML/BAG/KR

October 11, 1995

JAMES M. LEVINE  
VICE PRESIDENT  
NUCLEAR PRODUCTION

U. S. Nuclear Regulatory Commission  
ATTN: Document Control Desk  
Mail Station P1-37  
Washington, D.C. 20555-0001


Dear Sirs:

**Subject: Palo Verde Nuclear Generating Station (PVNGS)  
Unit 2  
Docket No. STN 50-529 (License No. NPF-51)  
Special Report 2-SR-95-001-01**

Attached please find Supplement 1 to Special Report 2-SR-95-001 prepared and submitted pursuant to Technical Specification (TS) Surveillance Requirement 4.4.4.5.b and TS 6.9.2. This supplement is being submitted to provide the complete results of the Steam Generator Tube Inservice Inspection.

A copy of this supplement is being forwarded to the Regional Administrator, NRC Region IV. If you have any questions, please contact Burton A. Grabo, Section Leader, Nuclear Regulatory Affairs, at (602) 393-6492.

Sincerely,

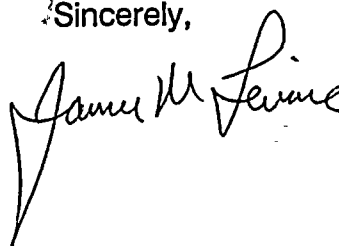

JML/BAG/KR/rv

Attachment

cc: L. J. Callan (all with attachment)  
K. E. Perkins  
K. E. Johnston  
B. E. Holian

280085  
9510270010 951011  
PDR ADDCK 05000529  
Q PDR

AD47/1

