LOCATION SYMBOLS

O-ESC SA
△-RTGB-106
□-LOCAL

ALL EQUIPMENT NOT DESIGNATED BY A SYMBOL IS LOCATED IN 480V MCC # 1A6

FOR ISOLATION SW "55" DEVELOPMENT SEE CWD 1011

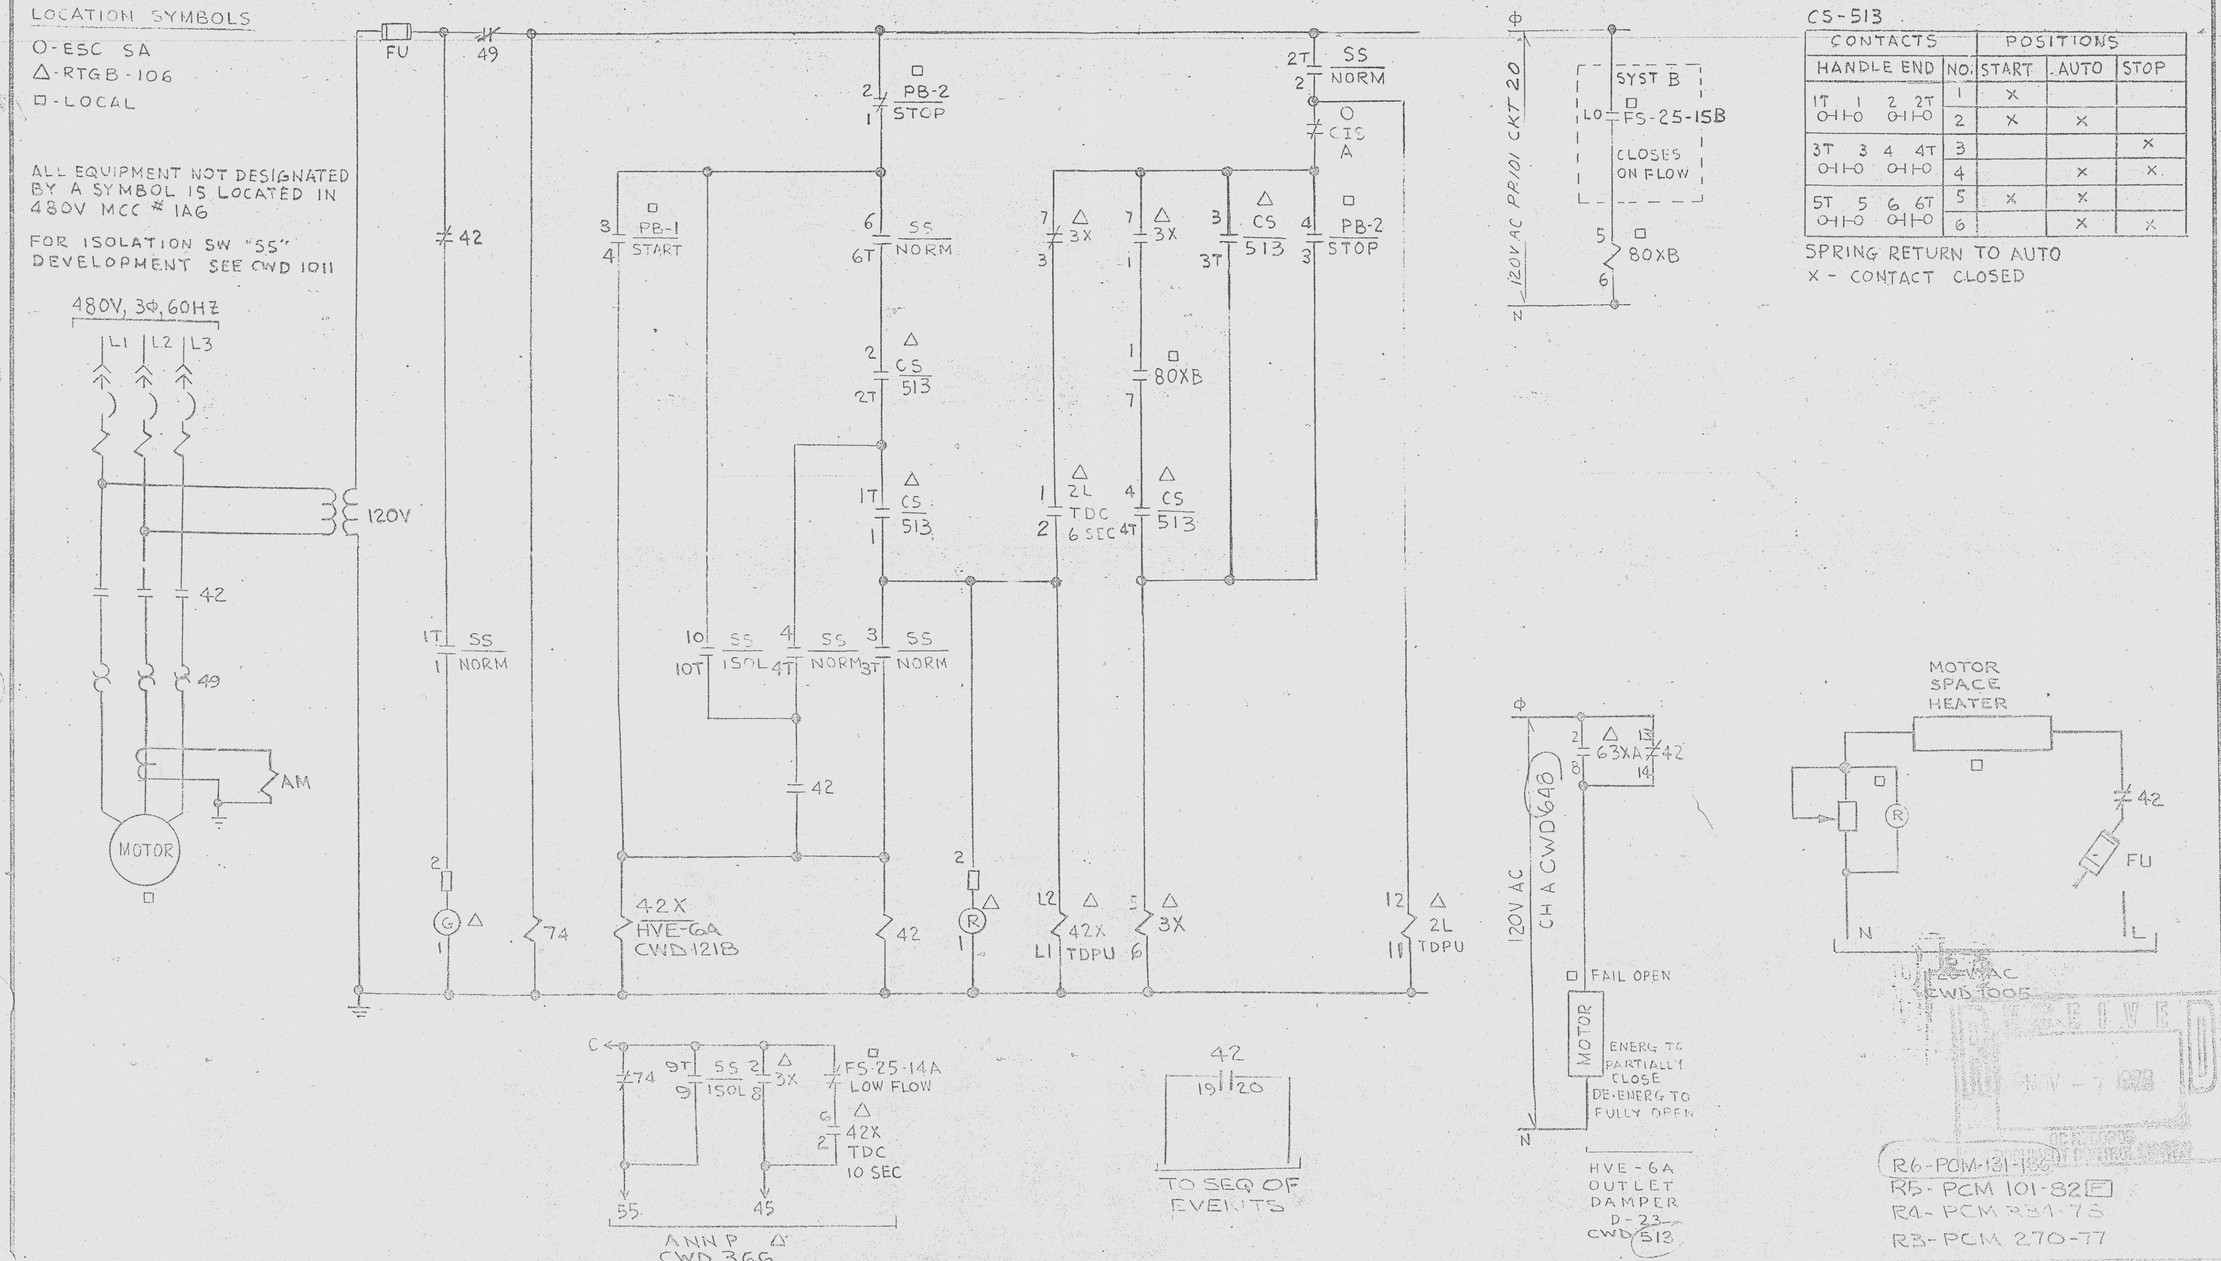

CS-513

CONTACTS		POSITIONS		
HANDLE END	NO.	START	AUTO	STOP
1T 1 2 2T	1	X		
	2	X	X	
3T 3 4 4T	3			X
	4		X	X
5T 5 6 6T	5	X	X	
	6		X	X

SPRING RETURN TO AUTO
X - CONTACT CLOSED

LEGEND

3X - CIS OVERRIDE RELAY

REV	DATE	BY	APPROVED	REV	DATE	BY	APPROVED
8				4	8-26-79	DV	
7				3	10-9-78	DV	
6	10-20-82			2	12-2-75	DV	
5	5-29-80	EM		1	9-11-74	DV	

EBASCO SERVICES INCORPORATED
NEW YORK

DIV. ELEC. DR. RM
SCALE — CK. RK
DATE SEP 21, 1972
APPROVED R.C. Nordlie
V.O. MM

FLORIDA POWER & LIGHT CO.
HUTCHINSON ISLAND PLANT-UNIT NO. 1
SCHEMATIC DIAGRAM
SHIELD BLDG VENT EXHAUST FAN HVE-6A

6770-B-326
SHEET 513

Ridgway's LOK-IN 12/16/69

9701270078-28
E

ANSTEC APERTURE CARD