


8770-G-093

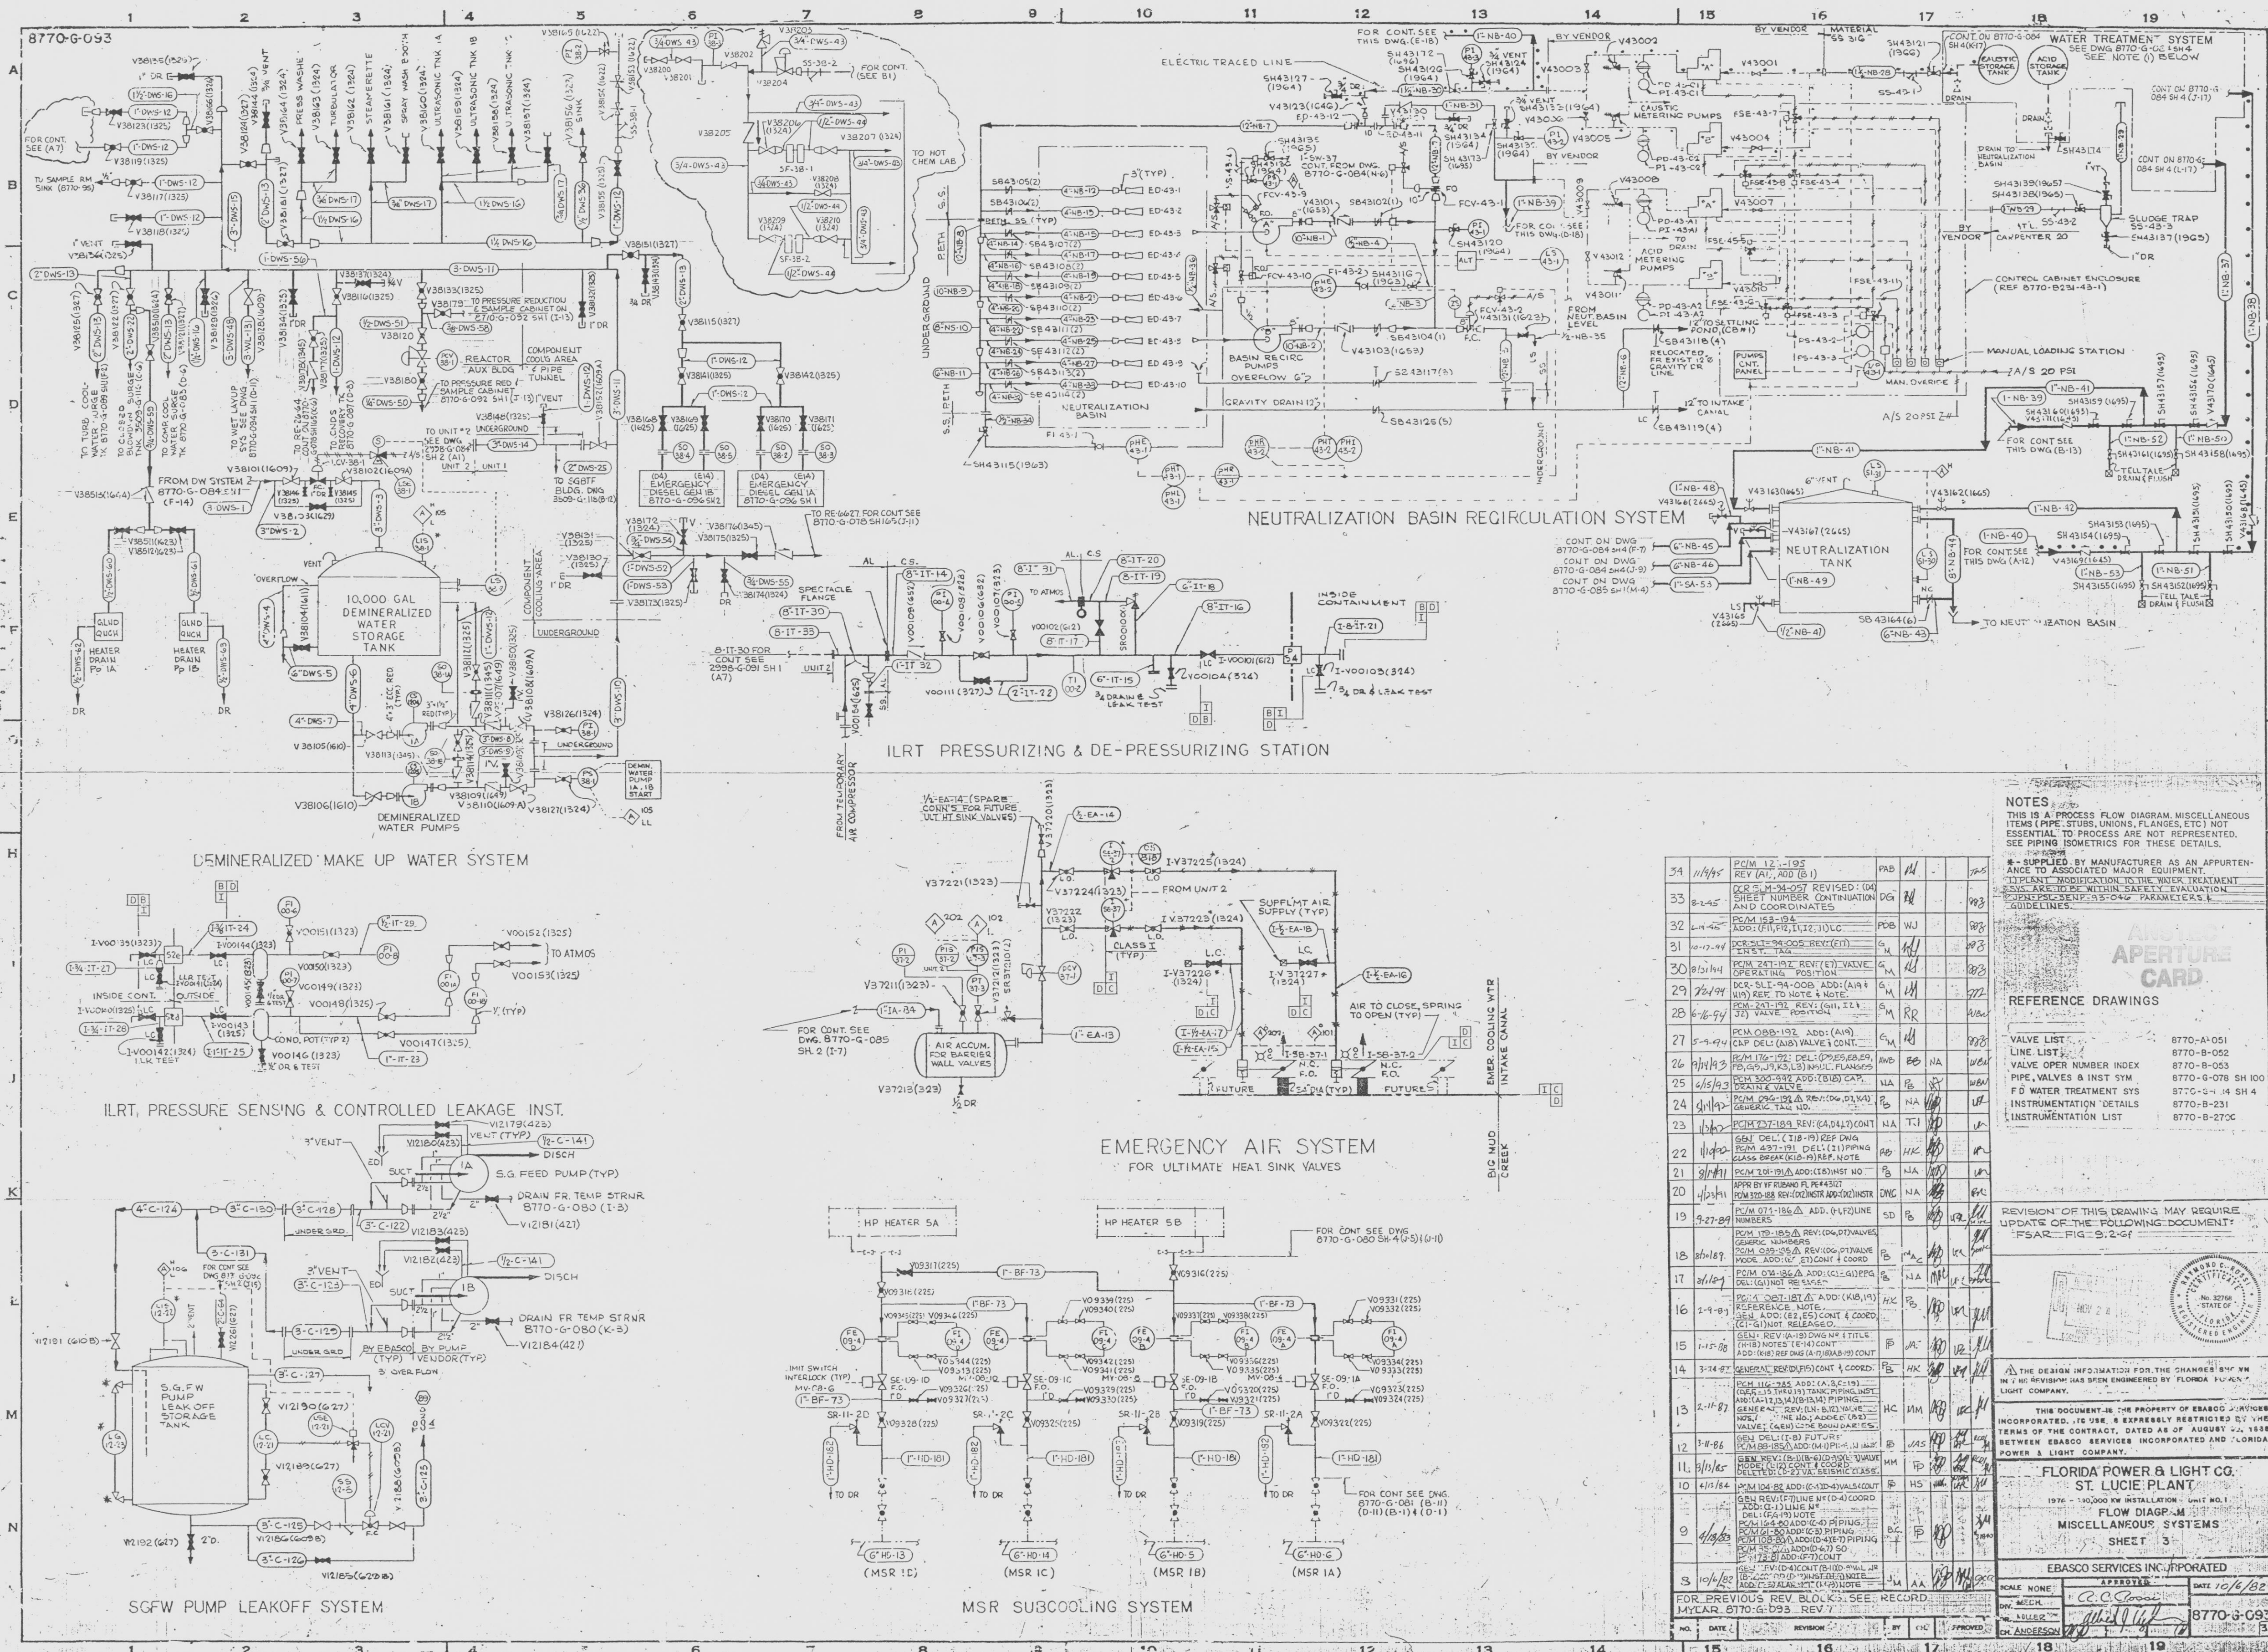

NOTES
THIS IS A PROCESS FLOW DIAGRAM. MISCELLANEOUS ITEMS (PIPE, STUBS, UNIONS, FLANGES, ETC.) NOT ESSENTIAL TO PROCESS ARE NOT REPRESENTED. SEE PIPING ISOMETRICS FOR THESE DETAILS.

* SUPPLIED BY MANUFACTURER AS AN APPURTENANCE TO ASSOCIATED MAJOR EQUIPMENT.
† TYPICAL MODIFICATION TO THE WATER TREATMENT SYSTEM ARE TO BE WITHIN SAFETY EVALUATION GUIDELINES.

APERTURE CARD

REFERENCE DRAWINGS

VALVE LIST
LINE LIST
VALVE OPER. NUMBER INDEX
PIPE, VALVES & INST. SYM.
F & W WATER TREATMENT SYS.
INSTRUMENTATION DETAILS
INSTRUMENTATION LIST

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT:
FSAR - FIG. 9.2-6f

THE DESIGN INFORMATION FOR THE CHANGES BY WH IN THIS REVISION HAS BEEN ENGINEERED BY FLORIDA POWER & LIGHT COMPANY.

THIS DOCUMENT IS THE PROPERTY OF EBARCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF AUGUST 22, 1988 BETWEEN EBARCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT CO.
ST. LUCIE PLANT
1976 - 10,000 KW INSTALLATION - UNIT NO. 1
FLOW DIAGRAM - M
MISCELLANEOUS SYSTEMS
SHEET 3

EBARCO SERVICES INCORPORATED

SCALE NONE
APPROVED
DATE 10/4/88
8770-G-093

FOR PREVIOUS REV. BLOCK, SEE RECORD
MYLAR 8770-G-093 REV 7

DATE 10/4/88
REVISION 7
BY CIL
APPROVED

9701270078-02
E