

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9706230347 DOC. DATE: 97/06/13 NOTARIZED: NO DOCKET #
 FACIL: STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Public 05000530
 AUTH. NAME AUTHOR AFFILIATION
 OVERBECK, G.R. Arizona Public Service Co. (formerly Arizona Nuclear Power
 RECIPIENT AFFILIATION
 RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk) *See Rpt.*

SUBJECT: Forwards Suppl 1 to Special Rept 3-SR-97-001 prepared & submitted, per Tech Spec Surveillance Requirement 4.4.4.5.b & TS 6.9.2. Suppl being submitted to provide complete results of SG tube ISI.

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1 + 150
 TITLE: OR Submittal: Inservice/Testing/Relief from ASME Code - GL-89-04

NOTES: Standardized plant.

05000530


	RECIPIENT		COPIES			RECIPIENT		COPIES	
	ID CODE/NAME		LTR	ENCL		ID CODE/NAME		LTR	ENCL
	PD4-2 LA		1	1		PD4-2 PD		1	1
	THOMAS, C		1	1					
INTERNAL:	ACRS		1	1		AEOD/SPD/RAB		1	1
	<u>FILE CENTER</u> 01		1	1		NRR/DE/EMEB		1	1
	NUDOCS -ABSTRACT		1	1		OGC/HDS2		1	0
	RES/DET/EIB		1	1		RES/DET/EMEB		1	1
EXTERNAL:	LITCO ANDERSON		1	1		NOAC		1	1
	NRC PDR		1	1					

NOTE TO ALL "RIDS" RECIPIENTS:
 PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM OWFN 5D-5 (EXT. 415-2083) TO ELIMINATE YOUR NAME FROM
 DISTRIBUTION LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTR 14 ENCL 13

JA2

C
A
T
E
G
O
R
Y
1
D
O
C
U
M
E
N
T

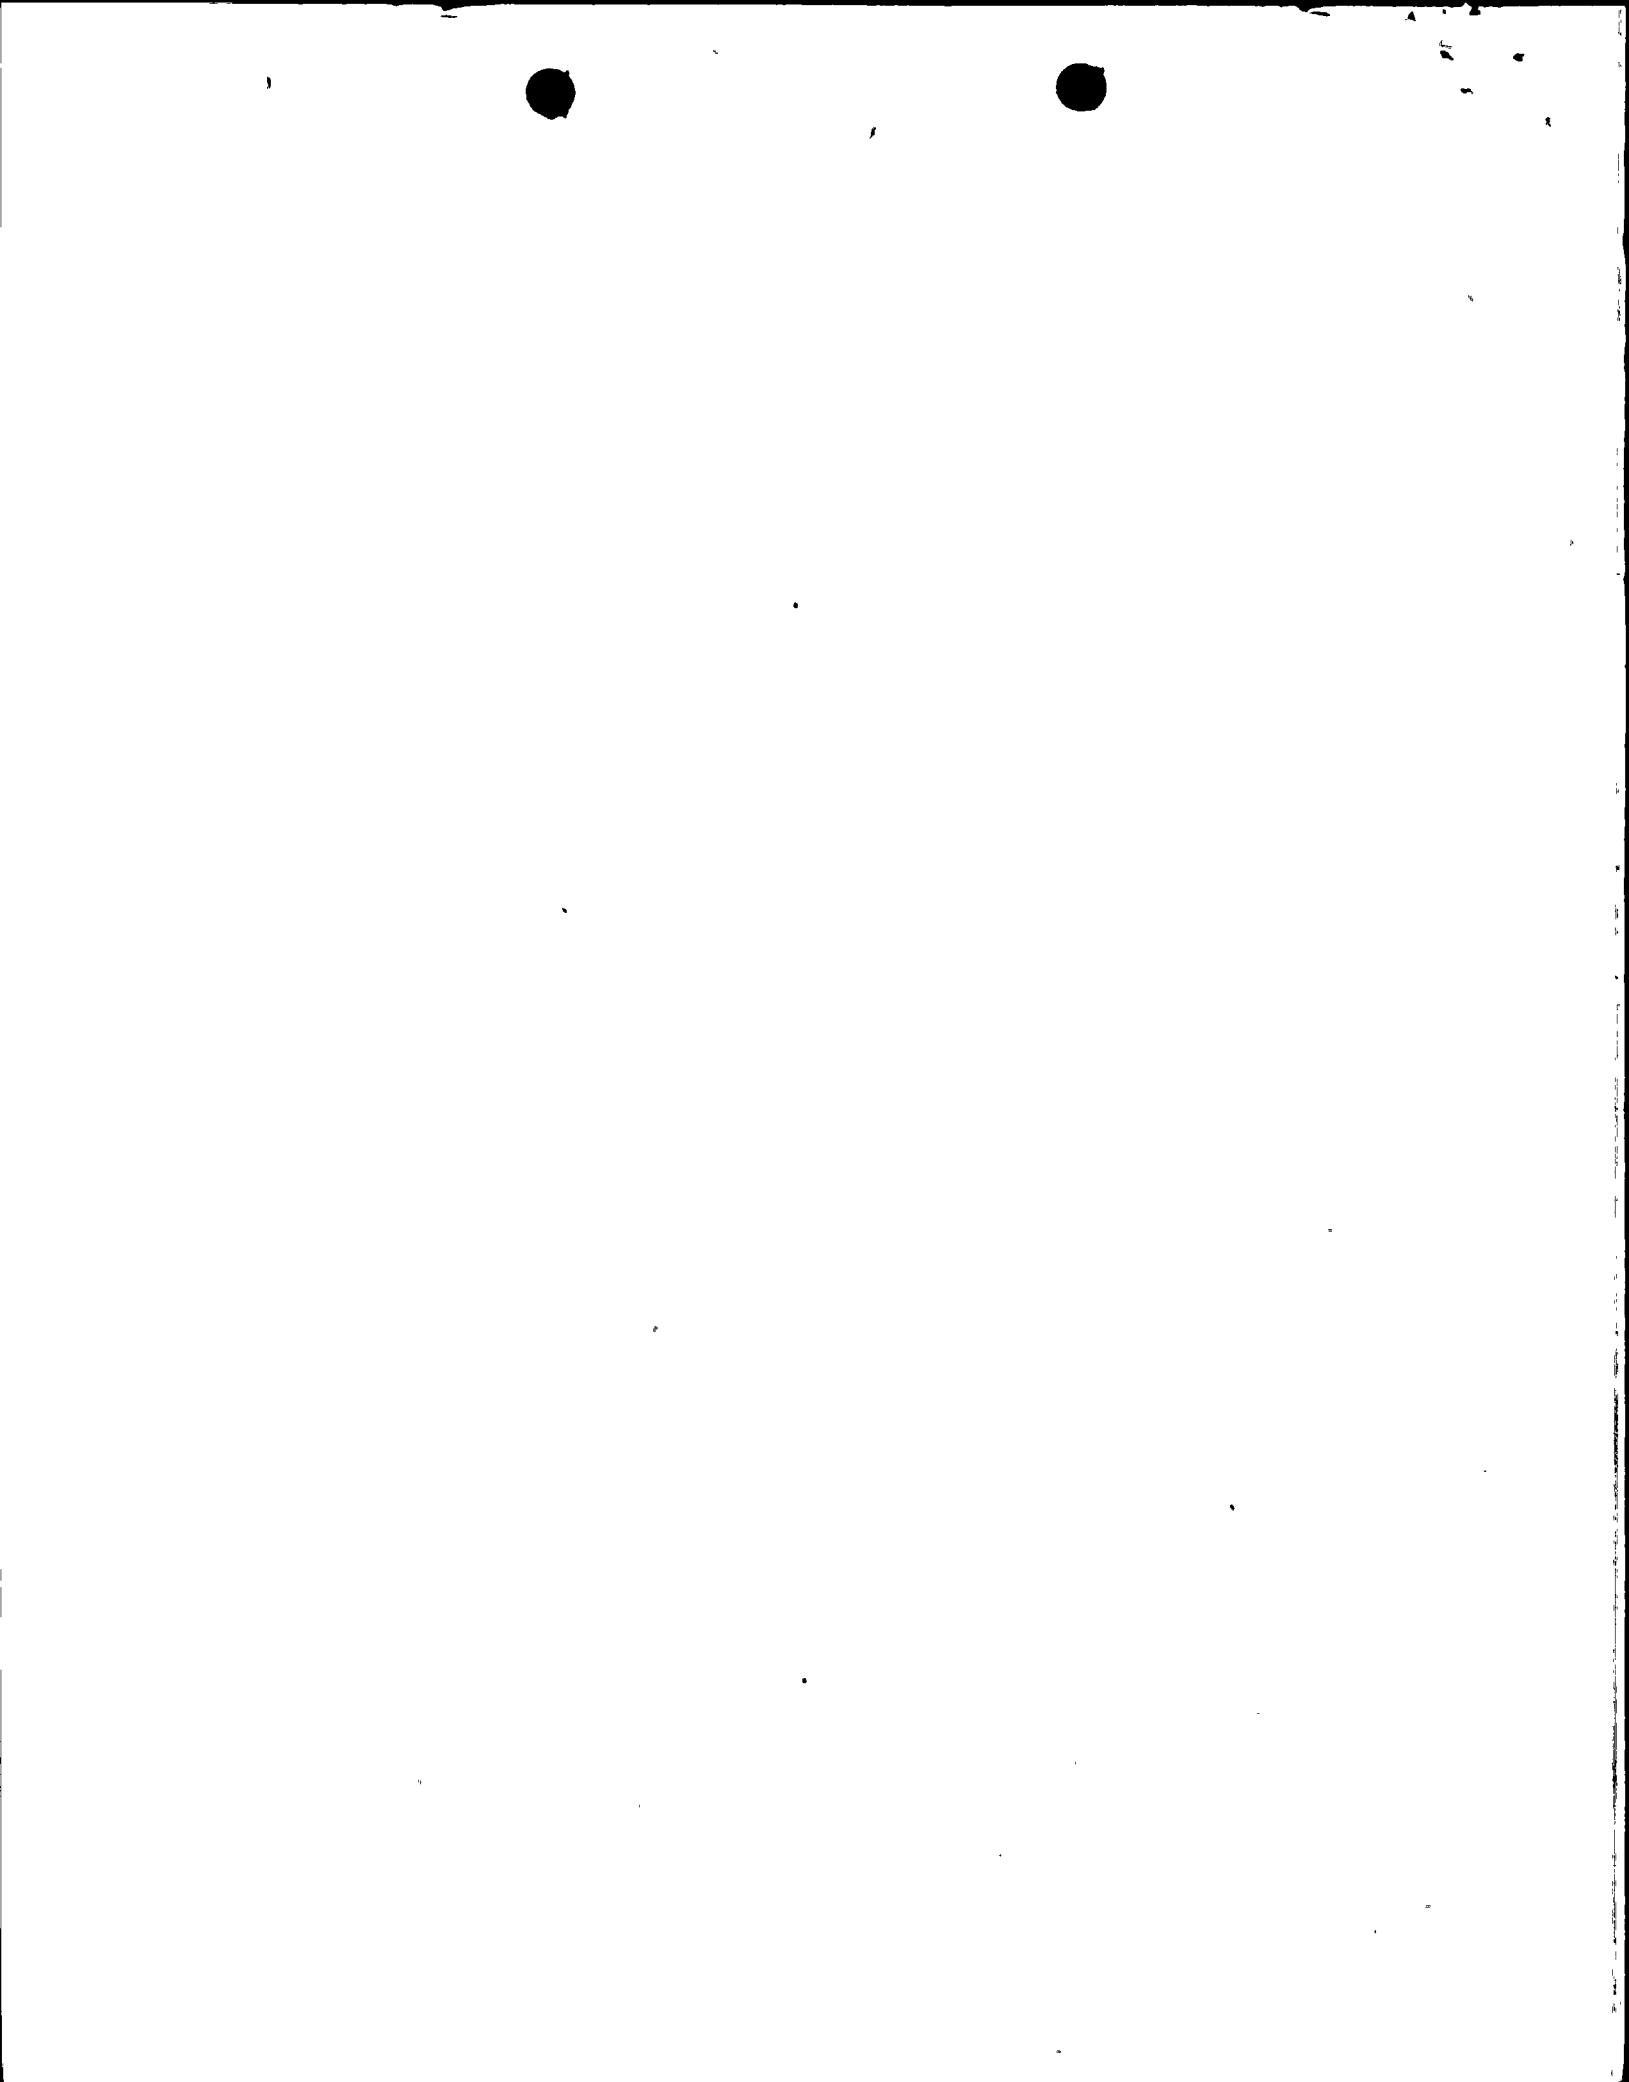



Palo Verde Nuclear
Generating Station

Gregg R. Overbeck
Vice President
Nuclear Production

TEL 602/393-5148
FAX 602/393-6077

Mail Station 7602
P.O. Box 52034
Phoenix, AZ 85072-2034

192-00992 -GRO/DGM/KR
June 13, 1997

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Mail Station P1-37
Washington, D.C. 20555-0001

Dear Sirs:

**Subject: Palo Verde Nuclear Generating Station (PVNGS)
Unit 3
Docket No. STN 50-530 (License No. NPF-74)
Special Report 3-SR-97-001-01**

Attached please find Supplement 1 to Special Report 3-SR-97-001 prepared and submitted pursuant to Technical Specification (TS) Surveillance Requirement 4.4.4.5.b and TS 6.9.2. This supplement is being submitted to provide the complete results of the Steam Generator Tube Inservice Inspection.

A copy of this supplement is being forwarded to the Regional Administrator, NRC Region IV. If you have any questions, please contact Daniel G. Marks, Section Leader, Nuclear Regulatory Affairs, at (602) 393-6492.

Sincerely,

GRO/DGM/KR/kr

Attachment

cc: E. W. Merschoff (all with attachment)
K. E. Perkins
F. L. Brush
J. W. Clifford

AD47
/ /

9706230347 970613
PDR ADCK 05000530
PDR





4582

1
1
15

1
1
15