

CATEGORY 1

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9710210080 DOC. DATE: 97/10/10 NOTARIZED: NO DOCKET #
FACIL: STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528
STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529
STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530
AUTH. NAME AUTHOR AFFILIATION
KRAINIK, A.K. Arizona Public Service Co. (formerly Arizona Nuclear Power
RECIP. NAME RECIPIENT AFFILIATION
Document Control Branch (Document Control Desk)

SUBJECT: Forwards Rev 5 to 30DP-9MT01, "Assessment of Risk When Performing Maint," in response to request from NRC staff.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1+29
TITLE: OR Submittal: General Distribution


NOTES: STANDARDIZED PLANT 05000528
Standardized plant. 05000529
Standardized plant. 05000530

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD4-2 LA	1 1	PD4-2 PD	1 1
	THOMAS, K	1 1		
INTERNAL:	ACRS	1 1	<u>FILE CENTER 01</u>	1 1
	NRR/DE/ECGB/A	1 1	NRR/DE/EMCB	1 1
	NRR/DRCH/HICB	1 1	NRR/DSSA/SPLB	1 1
	NRR/DSSA/SRXB	1 1	NUDOCS-ABSTRACT	1 1
	OGC/HDS2	1 0		
EXTERNAL:	NOAC	1 1	NRC PDR	1 1

NOTE TO ALL "RIDS" RECIPIENTS:
PLEASE HELP US TO REDUCE WASTE. TO HAVE YOUR NAME OR ORGANIZATION REMOVED FROM DISTRIBUTION LISTS OR REDUCE THE NUMBER OF COPIES RECEIVED BY YOU OR YOUR ORGANIZATION, CONTACT THE DOCUMENT CONTROL DESK (DCD) ON EXTENSION 415-2083

TOTAL NUMBER OF COPIES REQUIRED: LTTR 14 ENCL 13

may

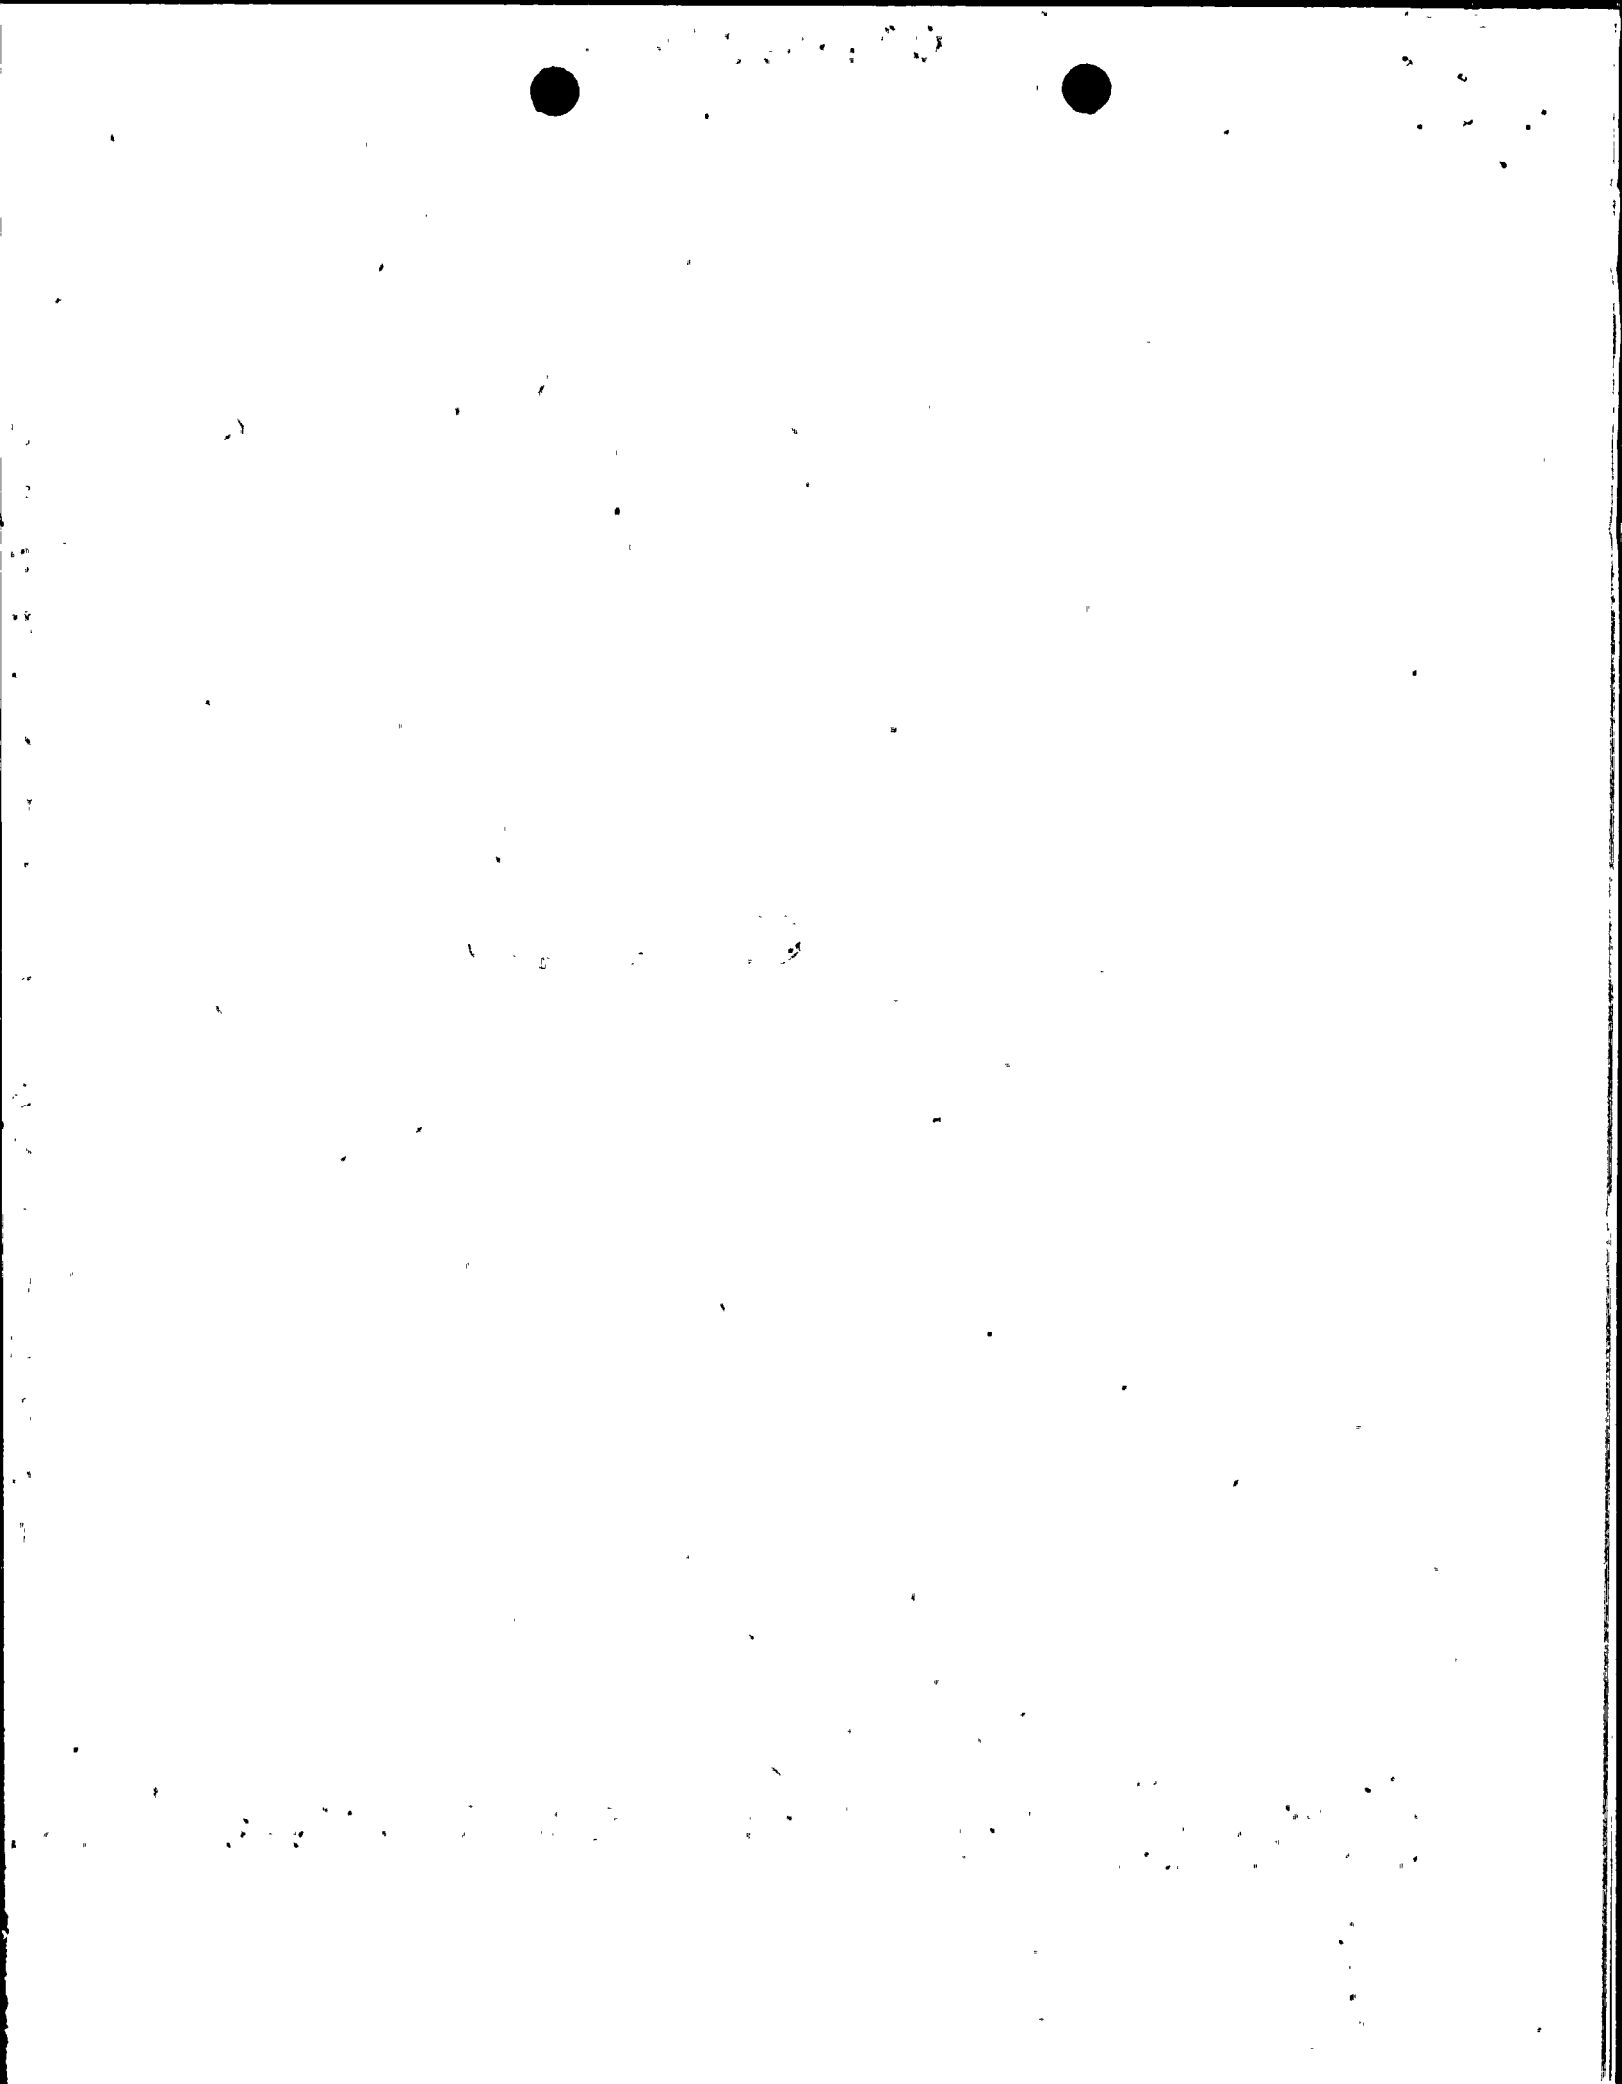

Arizona Public Service Company

PALO VERDE NUCLEAR GENERATING STATION
P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Mail Station P1-37
Washington, DC 20555-0001

102-04029 - AKK/GAM
October 10, 1997


Dear Sirs:

**Subject: Palo Verde Nuclear Generating Station (PVNGS)
Units 1, 2, and 3
Docket Nos. STN 50-528/529/530
Submittal of Risk Assessment Procedure**

In response to a request from the NRC Staff, Arizona Public Service Company (APS) is providing the enclosed PVNGS procedure, "Assessment of Risk When Performing Maintenance," 30DP-9MT01, Revision 5. This procedure, which includes the plant configuration risk indicator matrix, is being provided to assist the Staff review of the proposed PVNGS Technical Specification amendments to extend the allowed outage times for the safety injection tanks, low pressure safety injection system, and emergency diesel generators. The proposed amendments were requested by APS in letter no. 102-03392-WLS/SAB/GAM to NRC, dated June 13, 1995.

Should you have any questions, please contact Scott A. Bauer, Licensing Section Leader, at (602) 393-5978.

Sincerely,

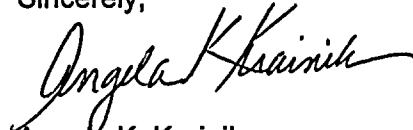

Angela K. Krainik
Department Leader
Nuclear Regulatory Affairs

AKK/GAM/rh

Enclosure

cc: E. W. Merschoff (w/o enclosure)
K. E. Perkins (w/o enclosure)
K. M. Thomas (w enclosure)
J. H. Moorman (w/o enclosure)
M. L. Wohl (w enclosure)

9710210080 971010
PDR ADDCK 05000528
P PDR



ADD1/1