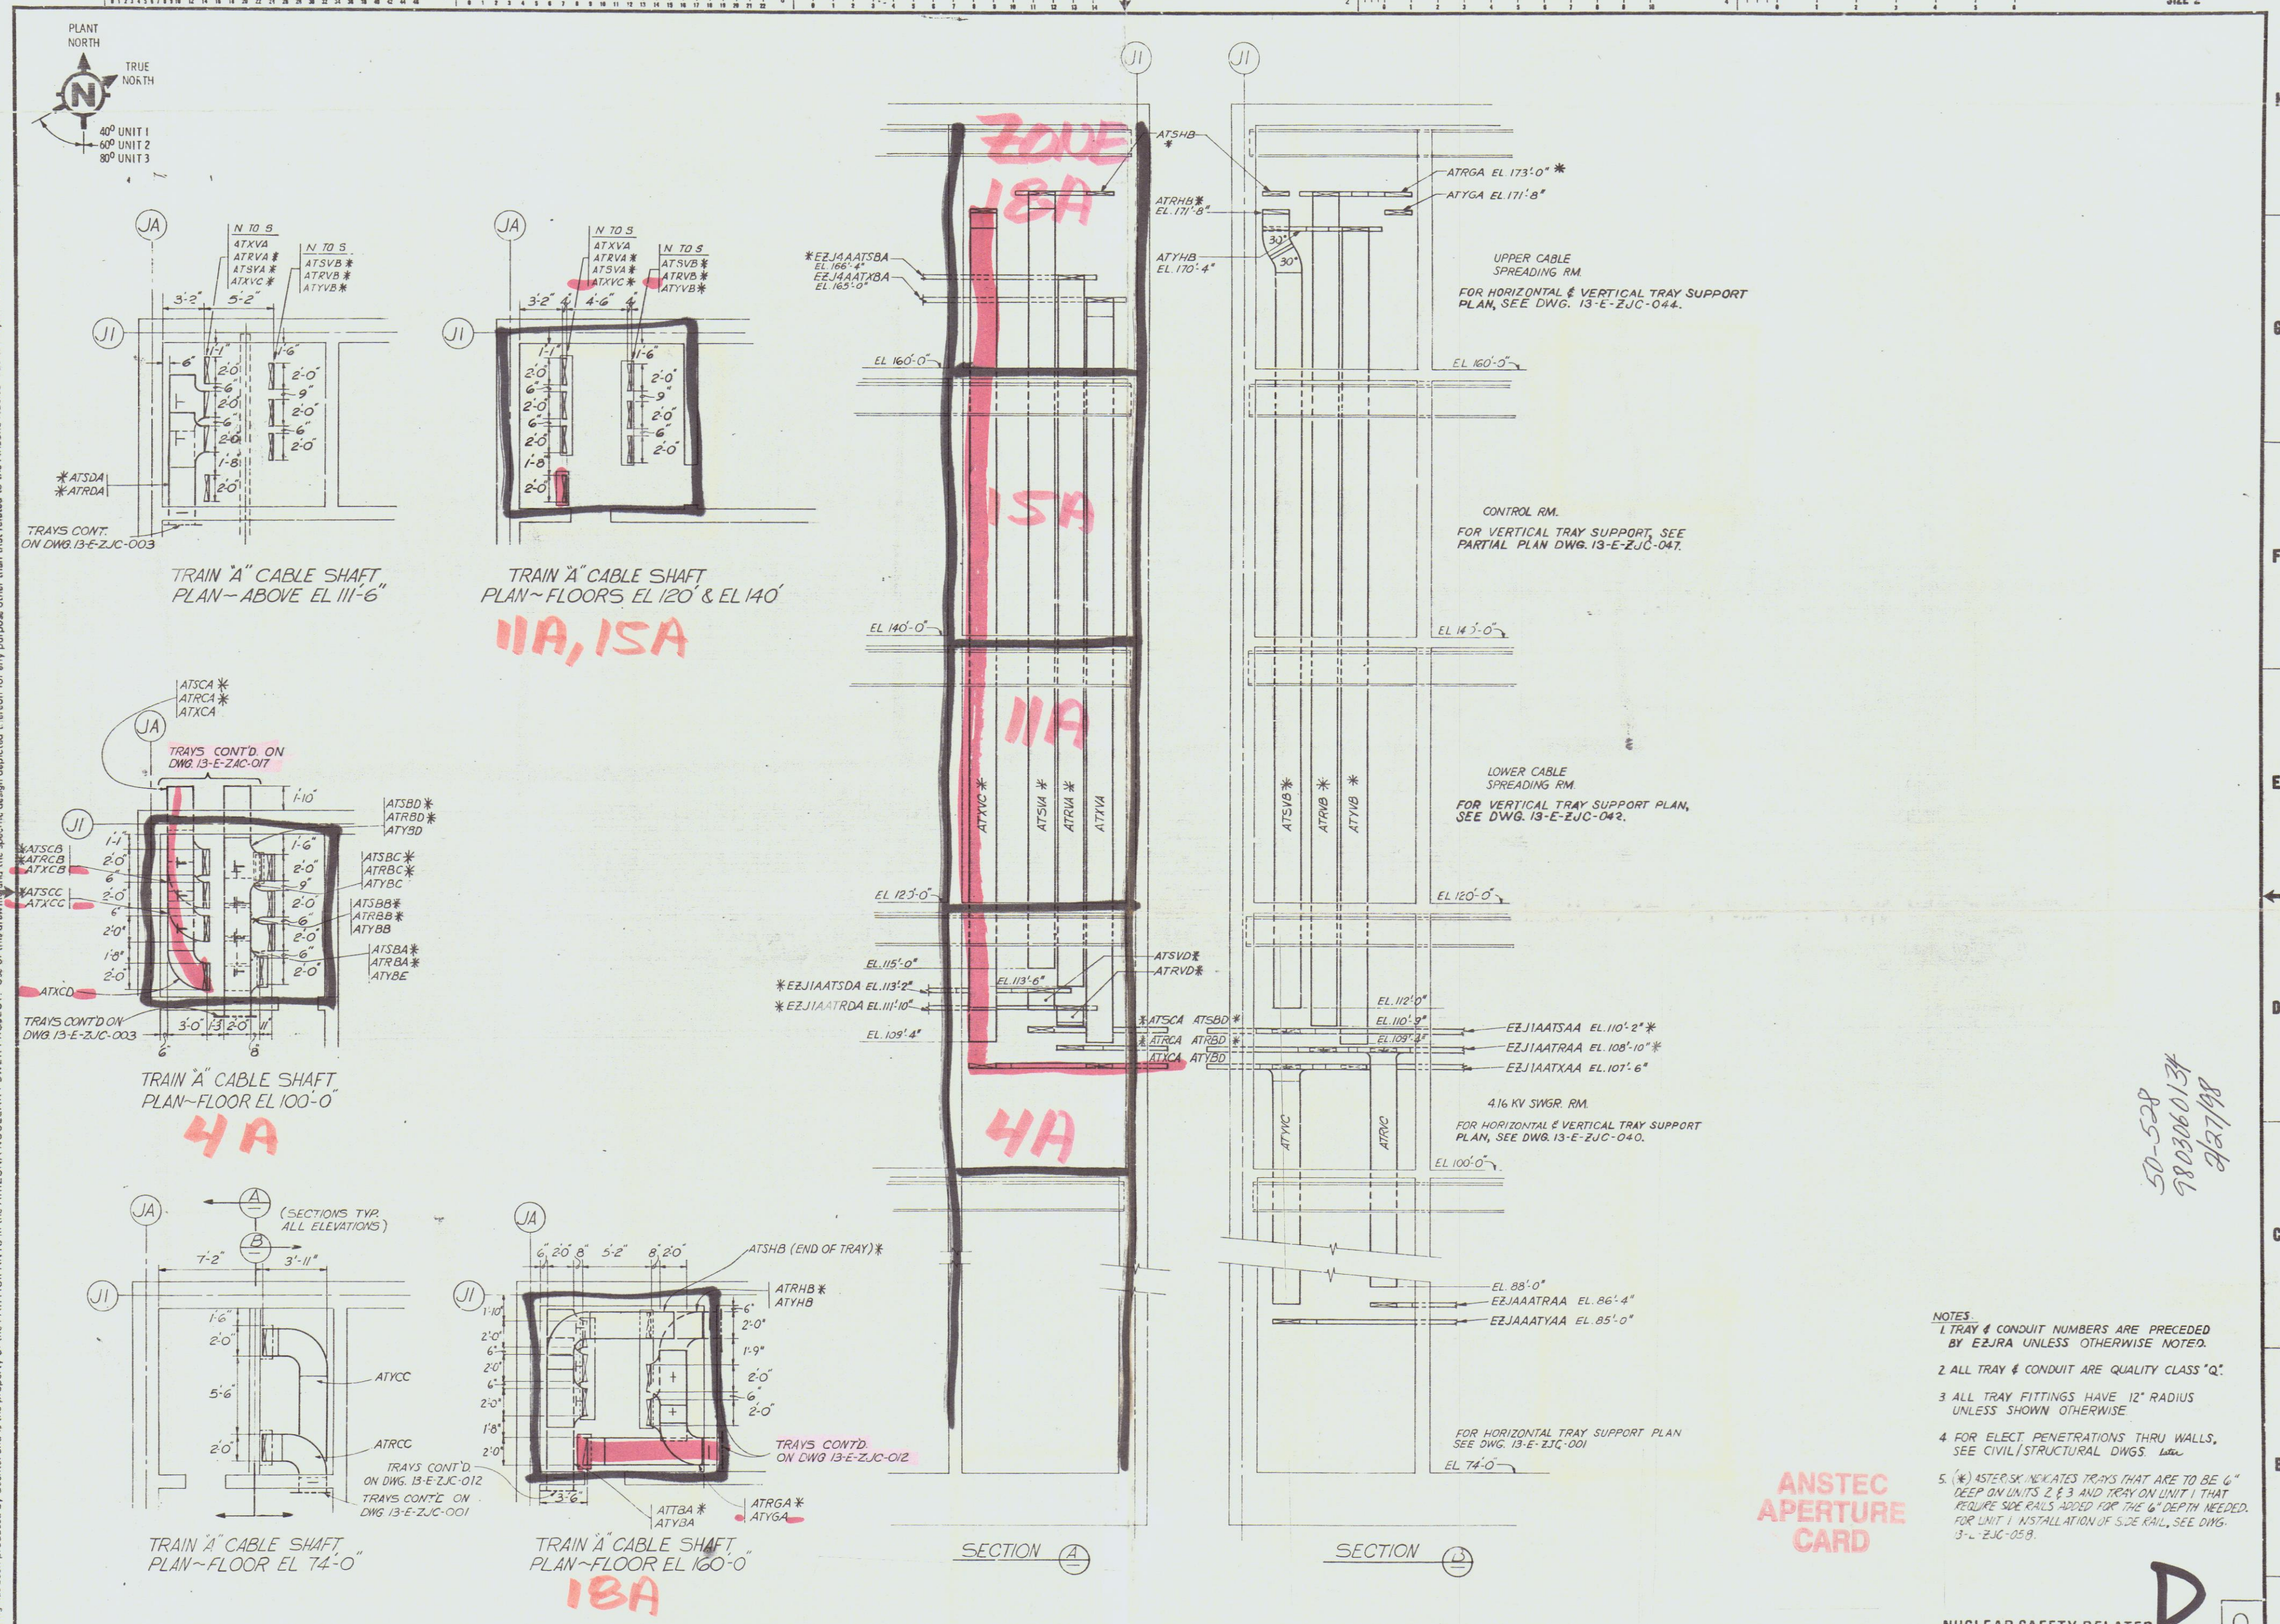

NOTES
1. TRAY & CONDUIT NUMBERS ARE PRECEDED BY EZJRA UNLESS OTHERWISE NOTED.
2. ALL TRAY & CONDUIT ARE QUALITY CLASS "Q".
3. ALL TRAY FITTINGS HAVE 12" RADIUS UNLESS SHOWN OTHERWISE.
4. FOR ELECT. PENETRATIONS THRU WALLS, SEE CIVIL/STRUCTURAL DWGS. Later
5. (*) ASTERISK INDICATES TRAYS THAT ARE TO BE 6" DEEP ON UNITS 2 & 3 AND TRAY ON UNIT 1 THAT REQUIRE SIDE RAILS ADDED FOR THE 6" DEPTH NEEDED. FOR UNIT 1 INSTALLATION OF SIDE RAIL, SEE DWG. 13-E-ZJC-058.

ANSTEC APERTURE CARD

50-528
9803061314
9/27/98

NUCLEAR SAFETY RELATED D Q

NO.	DATE	REVISIONS	DR	CH'K	DGS	ENG	EGS	CHF ENG	PRJ ENG
4	11/21/91	ADDED TRAY SUPPORT NOTATIONS							
3		INCORP. DCN #2 & #3							
2	1/1/91	INCORP. DCN #1							
1	5/29/91	REVISED TRAY NUMBERS & DIMENSIONS AS SHOWN							
0		ISSUED FOR CONSTRUCTION							
6	3/1/87	REVISED NOTE ON P.E. STAMP							
5	9/1/1	INCORP. DCN'S 4 & 5							

REV 6 BY 11980
REV 5 BY 14504
REV 4 & SUBSEQUENT REV'S BY 11980

BECHTEL
LOS ANGELES

ARIZONA NUCLEAR POWER PROJECT
PALO VERDE NUCLEAR GENERATING STATION

CONTROL BUILDING
CABLE RISER SHAFTS
PLAN SECTIONS & DETAILS SHEET 1

SCALE	JOB NO.	DRAWING NO.	REV.
1/8" = 1'-0"	10407	13-E-ZJC-030	6

9803160074