

G. REVISED TECHNICAL SPECIFICATIONS PAGES

Units 1, 2, and 3: Page 3.3.1-9

H. RETYPED TECHNICAL SPECIFICATION PAGES

Units 1, 2, and 3: Page 3.3.1-9

9906040021 990526
PDR ADOCK 05000528
P PDR

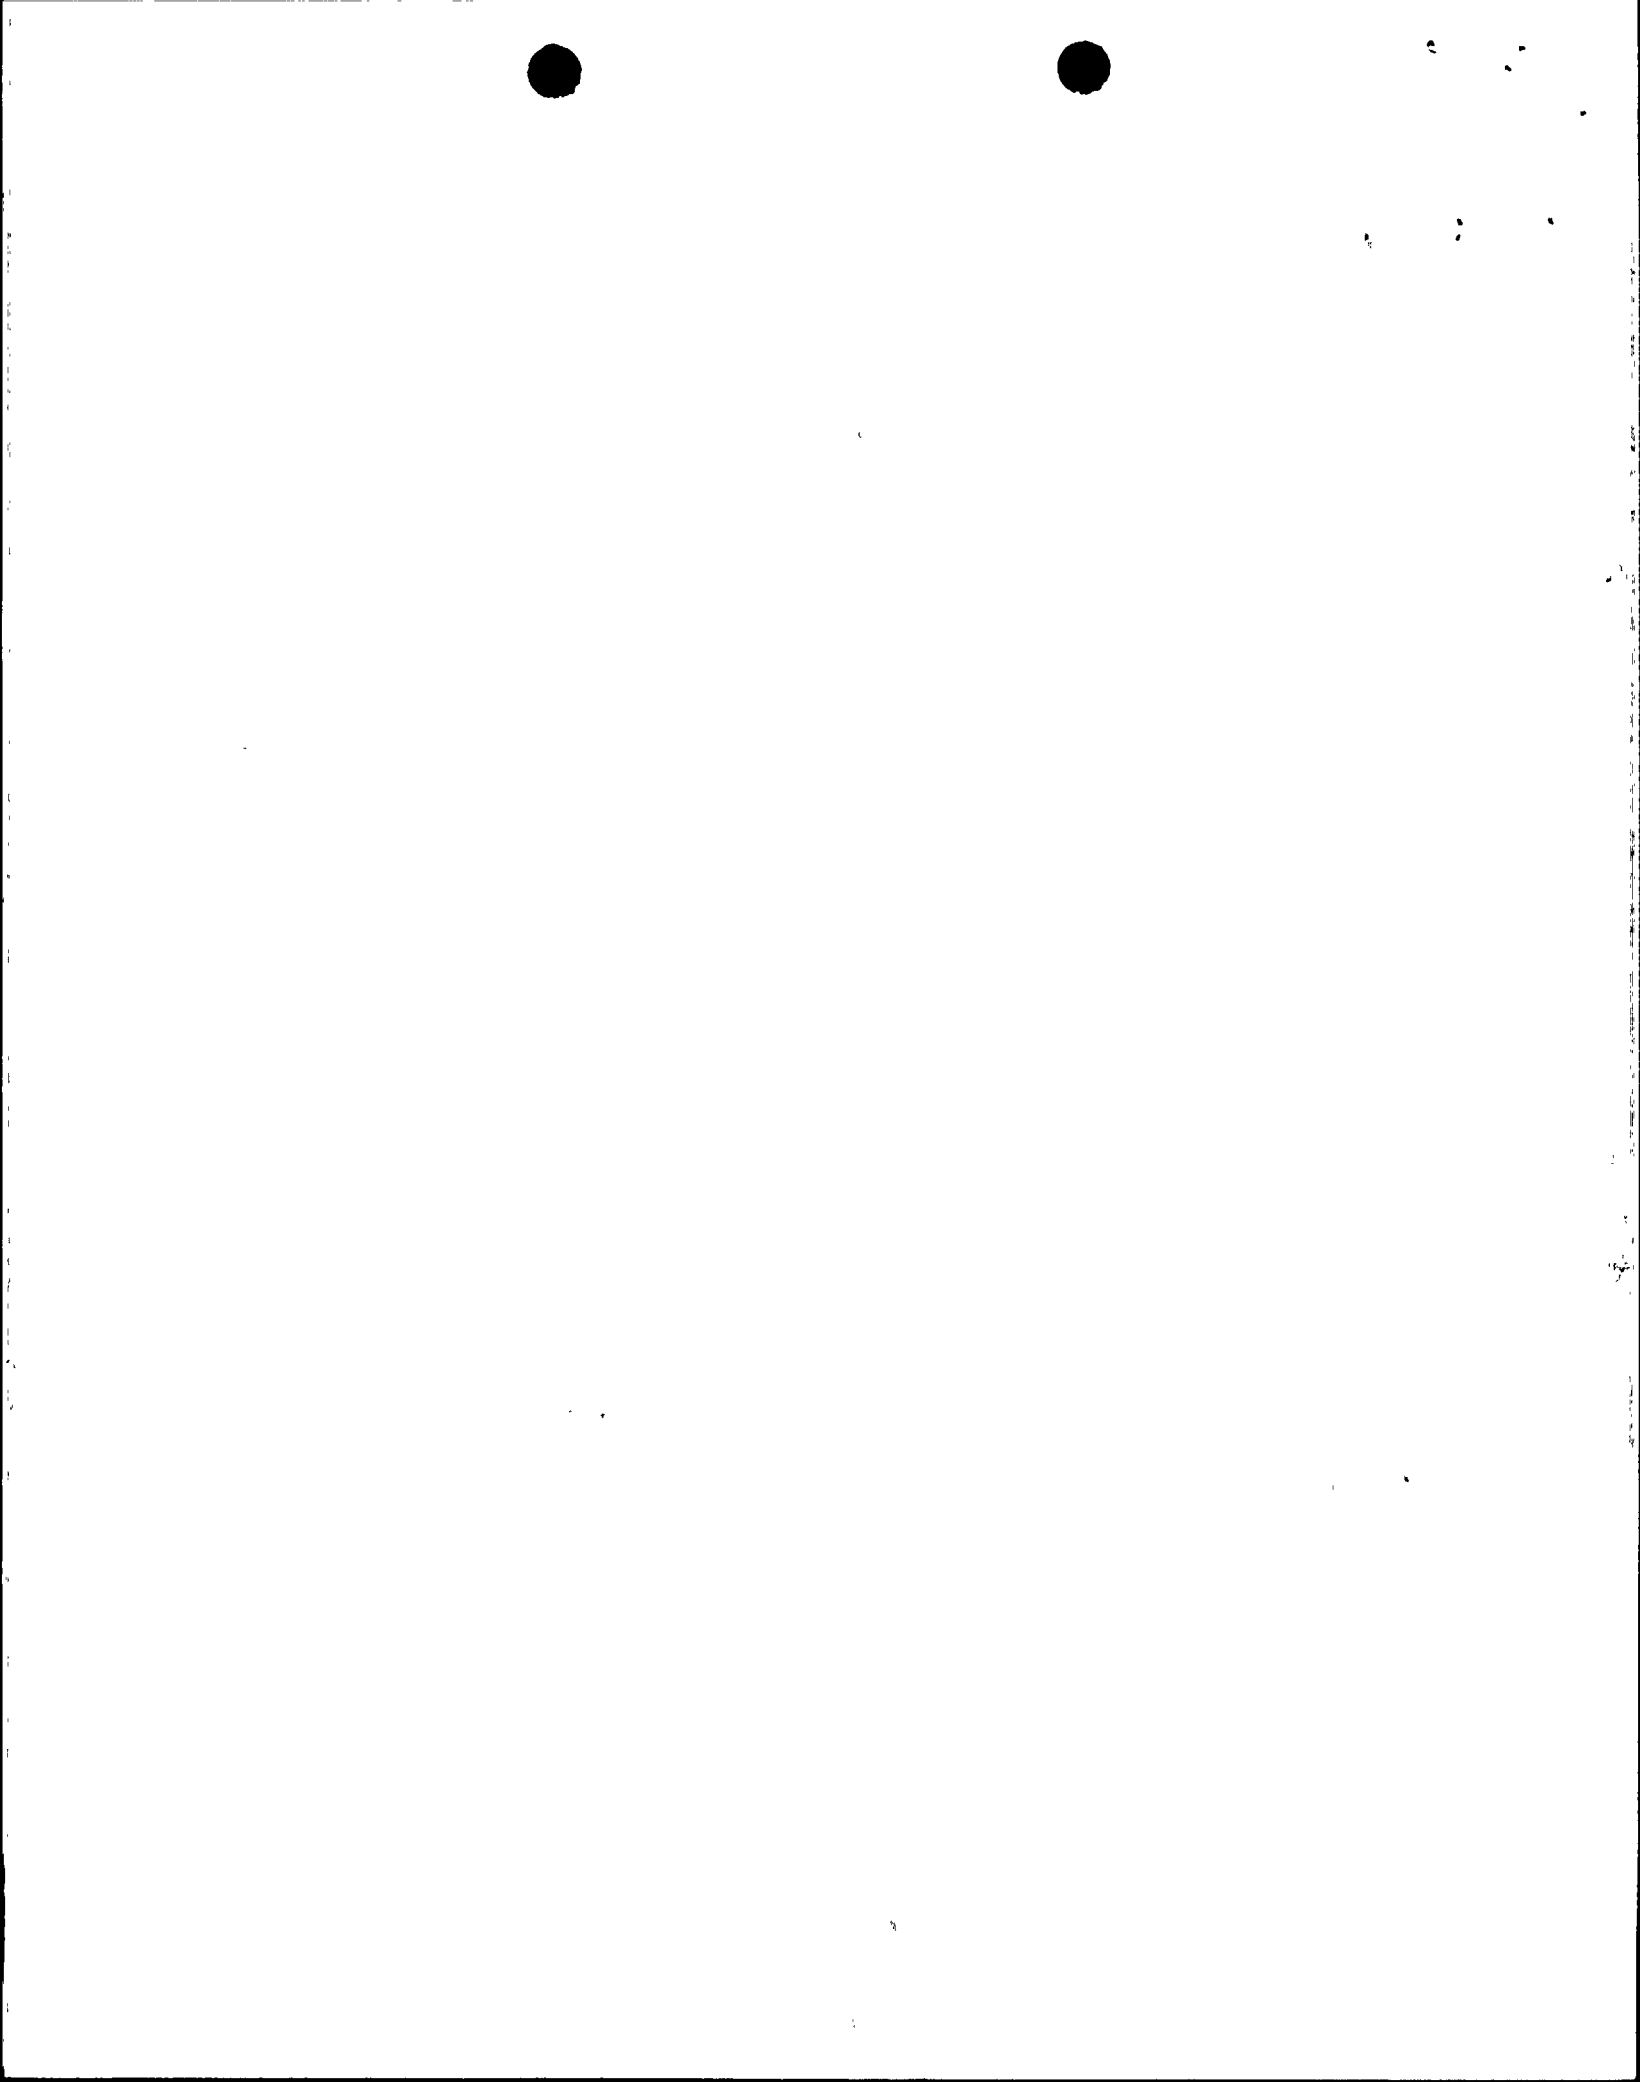


Table 3.3.1-1 (page 2 of 3)
Reactor Protective System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
8. Steam Generator #1 Level - Low	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	≥ 43.7%
9. Steam Generator #2 Level - Low	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	≥ 43.7%
10. Steam Generator #1 Level - High	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	≤ 91.5%
11. Steam Generator #2 Level - High	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	≤ 91.5%
12. Reactor Coolant Flow, Steam Generator #1-Low	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	<div style="border: 1px solid black; padding: 5px;"> Ramp: ≤ 0.118 psid/sec. Floor: ≥ 11.7 psid Step: ≤ 10.2 psid </div>
13. Reactor Coolant Flow, Steam Generator #2-Low	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	<div style="border: 1px solid black; padding: 5px;"> Ramp: ≤ 0.118 psid/sec. Floor: ≥ 11.7 psid Step: ≤ 10.2 psid </div>

(continued)

Ramp: ≤ 0.115 psid/sec.
 Floor: ≥ 12.49 psid
 Step: ≤ 17.2 psid



100

Table 3.3.1-1 (page 2 of 3)
Reactor Protective System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
8. Steam Generator #1 Level - Low	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	≥ 43.7%
9. Steam Generator #2 Level - Low	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	≥ 43.7%
10. Steam Generator #1 Level - High	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	≤ 91.5%
11. Steam Generator #2 Level - High	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	≤ 91.5%
12. Reactor Coolant Flow, Steam Generator #1-Low	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	Ramp: ≤ 0.115 psid/sec. Floor: ≥ 12.49 psid Step: ≤ 17.2 psid
13. Reactor Coolant Flow, Steam Generator #2-Low	1,2	SR 3.3.1.1 SR 3.3.1.7 SR 3.3.1.9 SR 3.3.1.13	Ramp: ≤ 0.115 psid/sec. Floor: ≥ 12.49 psid Step: ≤ 17.2 psid

(continued)

