

LICENSEE EVENT REPORT

(PLEASE PRINT OR TYPE ALL REQUIRED INFORMATION)

CONTROL BLOCK: | | | | | | | | | | | | | | | | | | 1

0   1	M   I   D   C   C	2   0   0   0   0   0   0   0   0   0   0   0   0   0   0	3   4   1   1   1   1   1   1	5
7 8	LICENSEE CODE 14	LICENSE NUMBER 15 25	LICENSE TYPE 30	57 CAT 58 80

0   1	L	0   5   0   0   0   3   1   6	0   8   0   2   7   8	0   2   1   3   7   9
7 8	REPORT SOURCE 60	DOCKET NUMBER 61 68	EVENT DATE 69 74	REPORT DATE 75 80

EVENT DESCRIPTION AND PROBABLE CONSEQUENCES 10

0 2 ON 1-30-79, WHILE REVIEWING PAST CALIBRATION DATA IT WAS DISCOVERED THAT THE TURBINE

0 3 LOW FLUID OIL PRESSURE SWITCHES HAD BEEN SET AT A NON-CONSERVATIVE VALUE WITH

0 4 RESPECT TO T.S. TABLE 2.2-1 ITEM 17A FROM 3-20-78 (INITIAL TURBINE OPERATION)

0 5 THROUGH 8-2-78. ON 8-2-78 THE SWITCHES WERE READJUSTED TO WITHIN THE T.S. LIMIT.

0 6

0 7

0 8

0   9	I   A	A	B	I   N   S   T   R   U	S	Z
7 8	SYSTEM CODE 9 10	CAUSE CODE 11	CAUSE SUBCODE 12	COMPONENT CODE 13 18	COMP. SUBCODE 19	VALVE SUBCODE 20

17	EVENT YEAR	SEQUENTIAL REPORT NO.	OCCURRENCE CODE	REPORT TYPE	REVISION NO.
7 8	7   9	0   0   4	0   1	T	0
9	LER/RO REPORT NUMBER 21 22	23 24 26	27 28 29	30 31	32

ACTION TAKEN	FUTURE ACTION	EFFECT ON PLANT	SHUTDOWN METHOD	HOURS	ATTACHMENT SUBMITTED	NPRD-4 FORM SUB.	PRIME COMP. SUPPLIER	COMPONENT MANUFACTURER
E   18	X   19	Z   20	Z   21	0   0   0   0   22	Y   23	N   24	A   25	M   2   3   5   26
33	34	35	36	37 40	41	42	43	44 47

CAUSE DESCRIPTION AND CORRECTIVE ACTIONS 27

1 0 THE PRESSURE SWITCHES WERE INITIALLY CALIBRATED UTILIZING THE VENDORS RECOMMENDED

1 1 SET POINTS AND WERE NOT RECALIBRATED AS REQUIRED UPON RECEIPT OF THE UNIT TWO

1 2 T.S. TO PREVENT RECURRENCE, THE PRESSURE SWITCHES HAVE BEEN ADDED TO A ROUTINE

1 3 CALIBRATION SCHEDULE TO REQUIRE PERIODICAL SETPOINT VERIFICATION AND INSURE

1 4 T.S. COMPLIANCE. SEE SUPPLEMENT.

1   5	G	0   0   0	NA	C	QUALITY CONTROL COORDINATOR	REVIEW
7 8	FACILITY STATUS 8 9	% POWER 10 12	OTHER STATUS 13 30	METHOD OF DISCOVERY 45 46	DISCOVERY DESCRIPTION 47 80	32

1   6	Z	Z	NA	NA	NA
7 8	ACTIVITY RELEASED OF RELEASE 9 10	CONTENT 10 11	AMOUNT OF ACTIVITY 12 35	LOCATION OF RELEASE 45 36	80

1   7	0   0   0	Z	NA
7 8	PERSONNEL EXPOSURES NUMBER 9 10	TYPE 11 37	DESCRIPTION 12 39

1   8	0   0   0	NA
7 8	PERSONNEL INJURIES NUMBER 9 11	DESCRIPTION 12 41


  

1   9	Z	NA
7 8	LOSS OF OR DAMAGE TO FACILITY TYPE 9 11	DESCRIPTION 12 43

2   0	N	NA
7 8	PUBLICITY ISSUED DESCRIPTION 9 10 45	80

*duped of 7902220108*

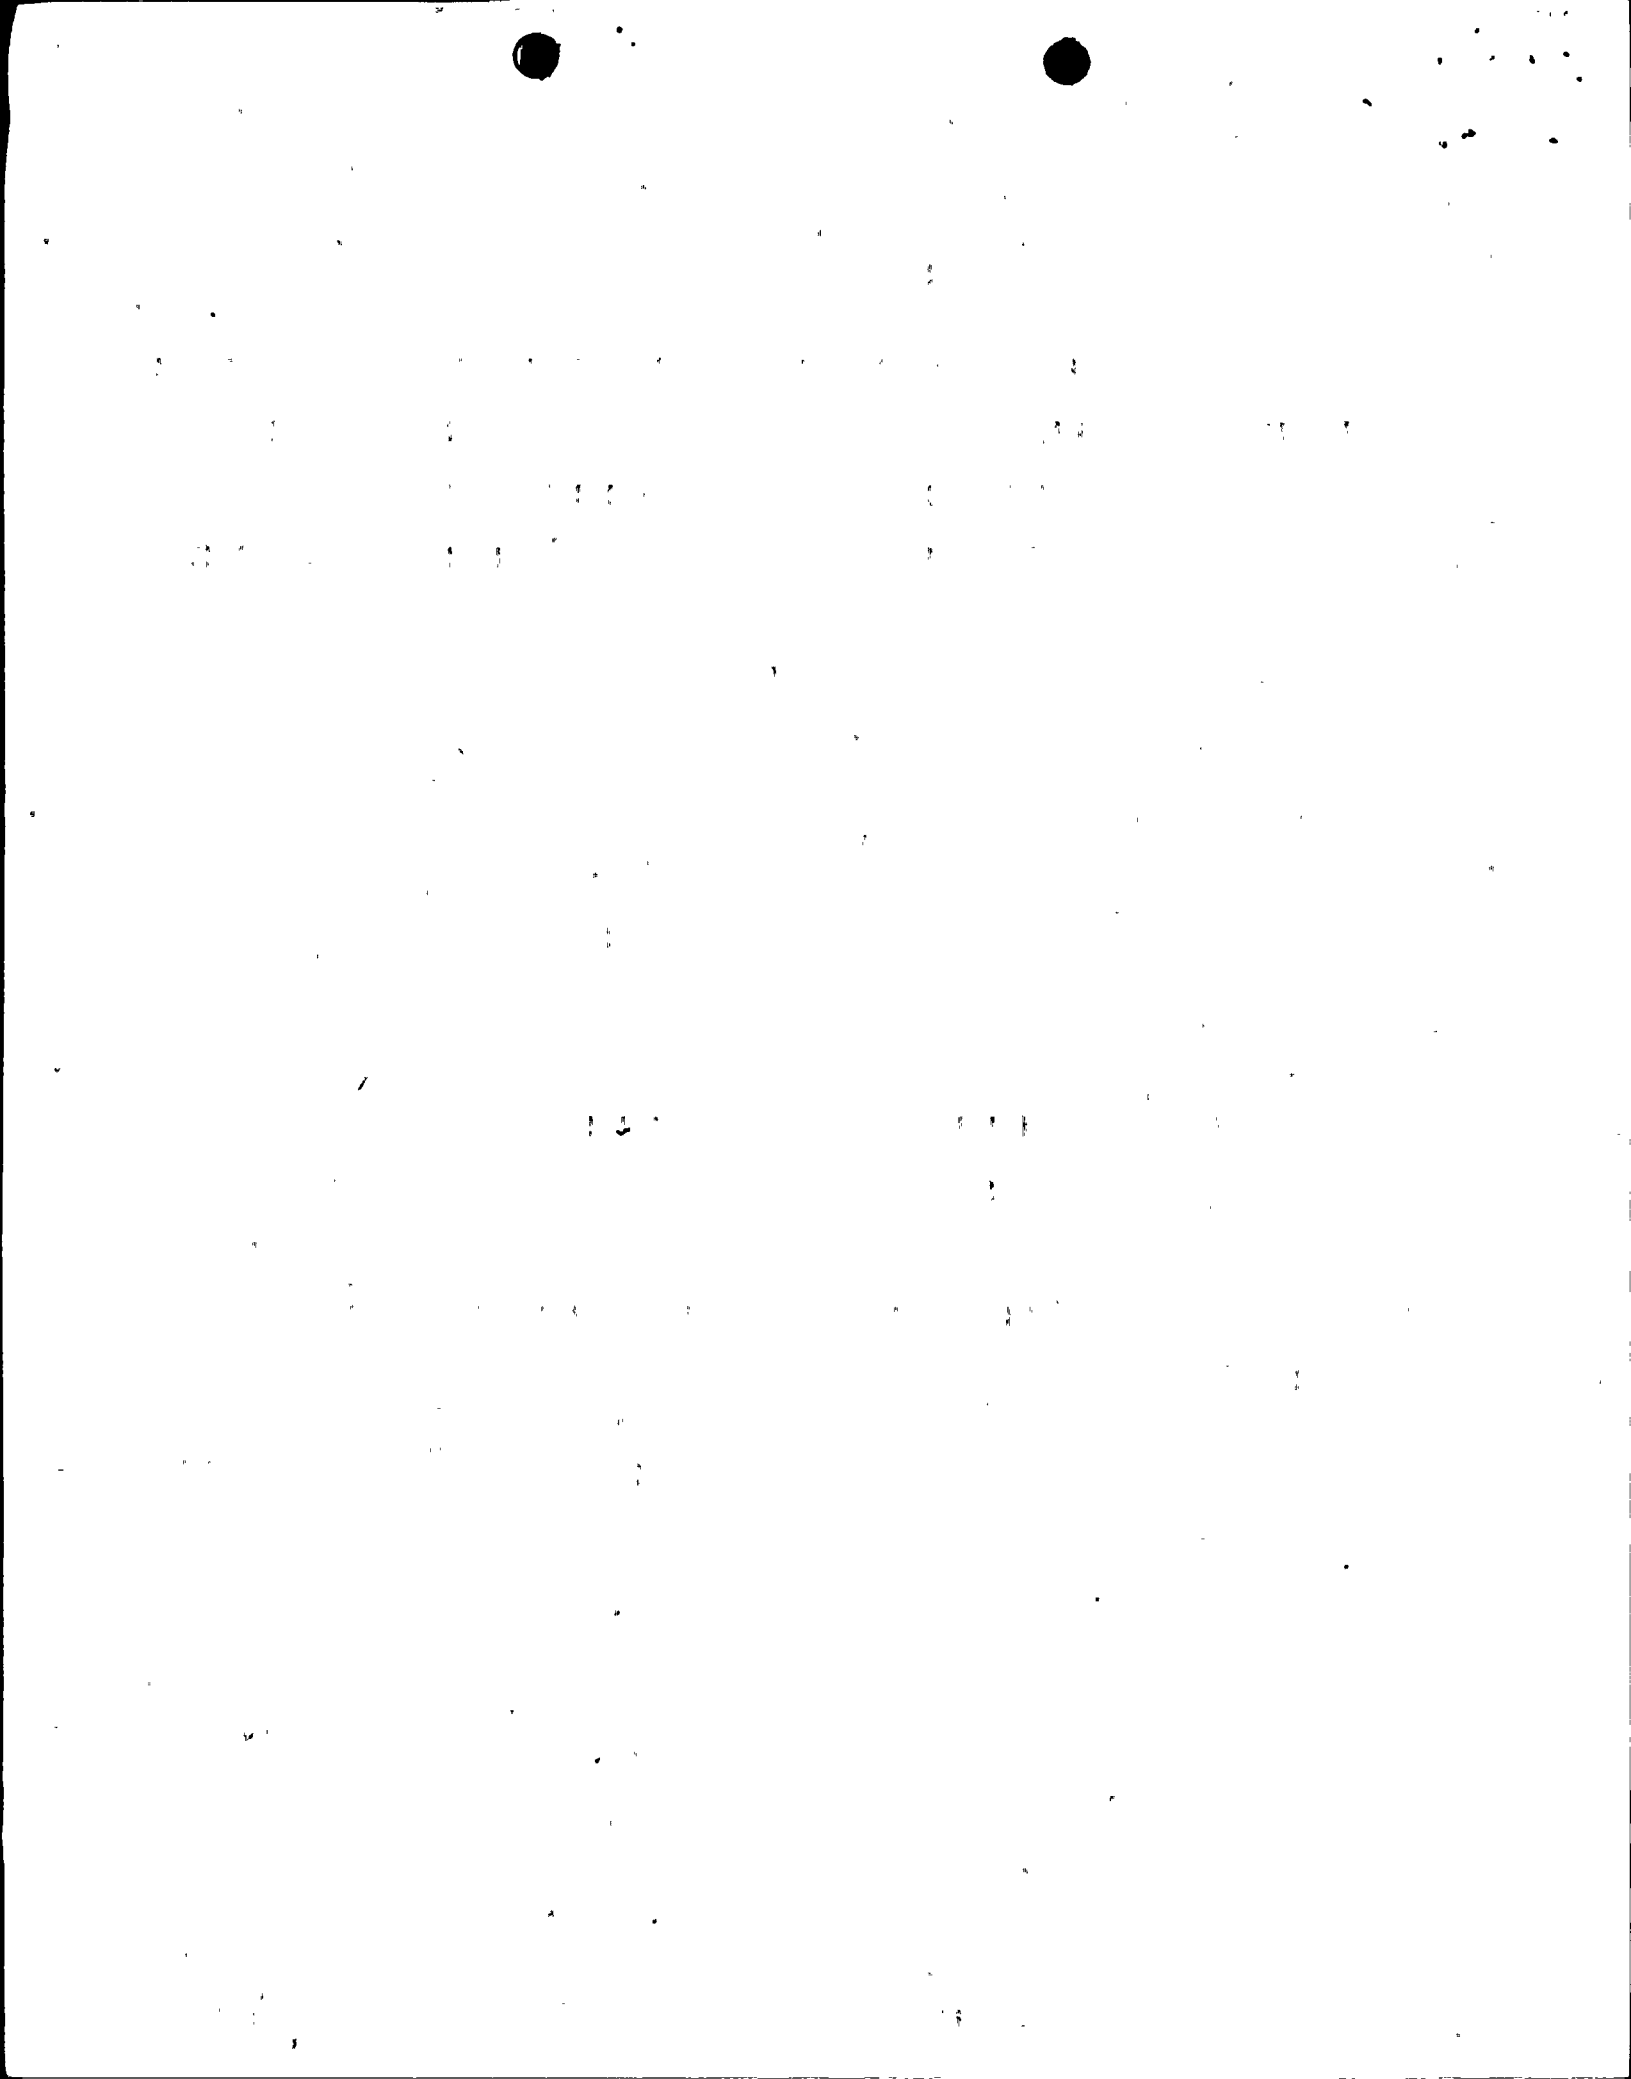

SUPPLEMENT TO LER # 79-004/01T-0

SUPPLEMENT TO CAUSE DESCRIPTION

CURRENT AND PAST CALIBRATION DATA FOR D. C. COOK UNIT ONE INDICATES THAT THE SET POINTS ARE CONSISTENT WITH THE T.S. REQUIREMENTS. THE PRESSURE SWITCHES FOR UNIT ONE HAVE ALSO BEEN ADDED TO A ROUTINE CALIBRATION SCHEDULE AS A PRECAUTIONARY MEASURE.



Handwritten marks and characters in the top right corner, possibly a date or initials.

Faint, illegible text or markings in the upper middle section of the page.

Faint, illegible text or markings in the lower middle section of the page.