


Please Send Copy of XA to PDR



DEC 30 1982

Docket Nos. 50-316
and 50-316

DISTRIBUTION W/SER & TER

Docket File NRC PDR

DWigginton L PDR

NSIC

DISTRIBUTION W/SER ONLY

CParrish

ACRS210

Gray

ORB#1 Rdg

ELJordan

JMTaylor

OELD

CParrish

Mr. John Dolan, Vice President
Indiana and Michigan Electric Company
Post Office Box 18
Bowling Green Station
New York, New York 10004

Dear Mr. Dolan:

This letter transmits the Safety Evaluation Report for the Environmental Qualification of Safety-Related Electrical Equipment at your facility. This evaluation is based on your response to our previous Safety Evaluation Report, issued on May 26, 1981 and D. C. Cook's subsequent submittals dated September 23, 1981, February 26, 1982, April 6, 1982, April 7, 1982, and June 11, 1982. This Safety Evaluation Report presents the results of the Environmental Qualification Review for safety-related electrical equipment, exposed to a harsh environment, in accordance with NRC requirements. We request that you provide your plans for qualification or replacement of the equipment in NRC categories I.B, II.A and II.B (presented in the Technical Evaluation Report) and the schedule for accomplishing your proposed corrective actions to us within ninety (90) days of the receipt of this letter. We understand that some of this information may have been provided in your November 3, 1982 letter which was not included in the Safety Evaluation Report or the Technical Evaluation Report.

see repts

As indicated in the conclusion section of the Safety Evaluation Report, we request that you reaffirm the justification for continued operation and within thirty (30) days of receipt of this letter, submit information for items in NRC categories I.B, II.A and II.B (presented in the enclosed Technical Evaluation Report) for which justification for continued operation was not previously submitted to the NRC. We suggest that the clarification set forth in item 8 of Generic Letter No. 82-09, "Clarification Questions and Answers of Environmental Qualification Requirements," should be considered in your justification for continued operation.

The Technical Evaluation Report contained certain identified information which you have previously claimed to be proprietary. We request that you inform us as indicated in the proprietary section of the Safety Evaluation Report whether any portions of the identified pages still require proprietary protection.

At your option, the staff will be available to discuss the findings in the Safety Evaluation Report as augmented by the Technical Evaluation Report. Your November 3, 1982 letter, as you may wish to further supplement, could serve as the basis for these discussions.

Please Send Copy of XA to PDR

OFFICE	8301070381 PDR ADDOCK	821230 05000315 PDR					
SURNAME							
DATE							

Withheld from Public Disclosure

1952 JAN 18

AND
A

1952 JAN 18

Mr. John Dolan

~~Attachment to be
returned to the
originator~~

The reporting and/or recordkeeping requirements contained in this letter affect fewer than ten respondents; therefore, OMB clearance is not required under P.L. 96-511.

Sincerely,

Original signed by:
S. A. Varga
Steven A. Varga, Chief
Operating Reactors Branch #1
Division of Licensing


Enclosures:

- 1. Safety Evaluation Report
- 2. Technical Evaluation Report

cc w/o TER:
See next page

~~Attachment to be
returned to the
originator~~

OFFICE ▶	ORB#1-DL	ORAB <i>me</i>	ORB#1-DL				
SURNAME ▶	DWigginton	JCalvo	S. Varga				
DATE ▶	12/16/82:dm	12/20/82	12/22/82				

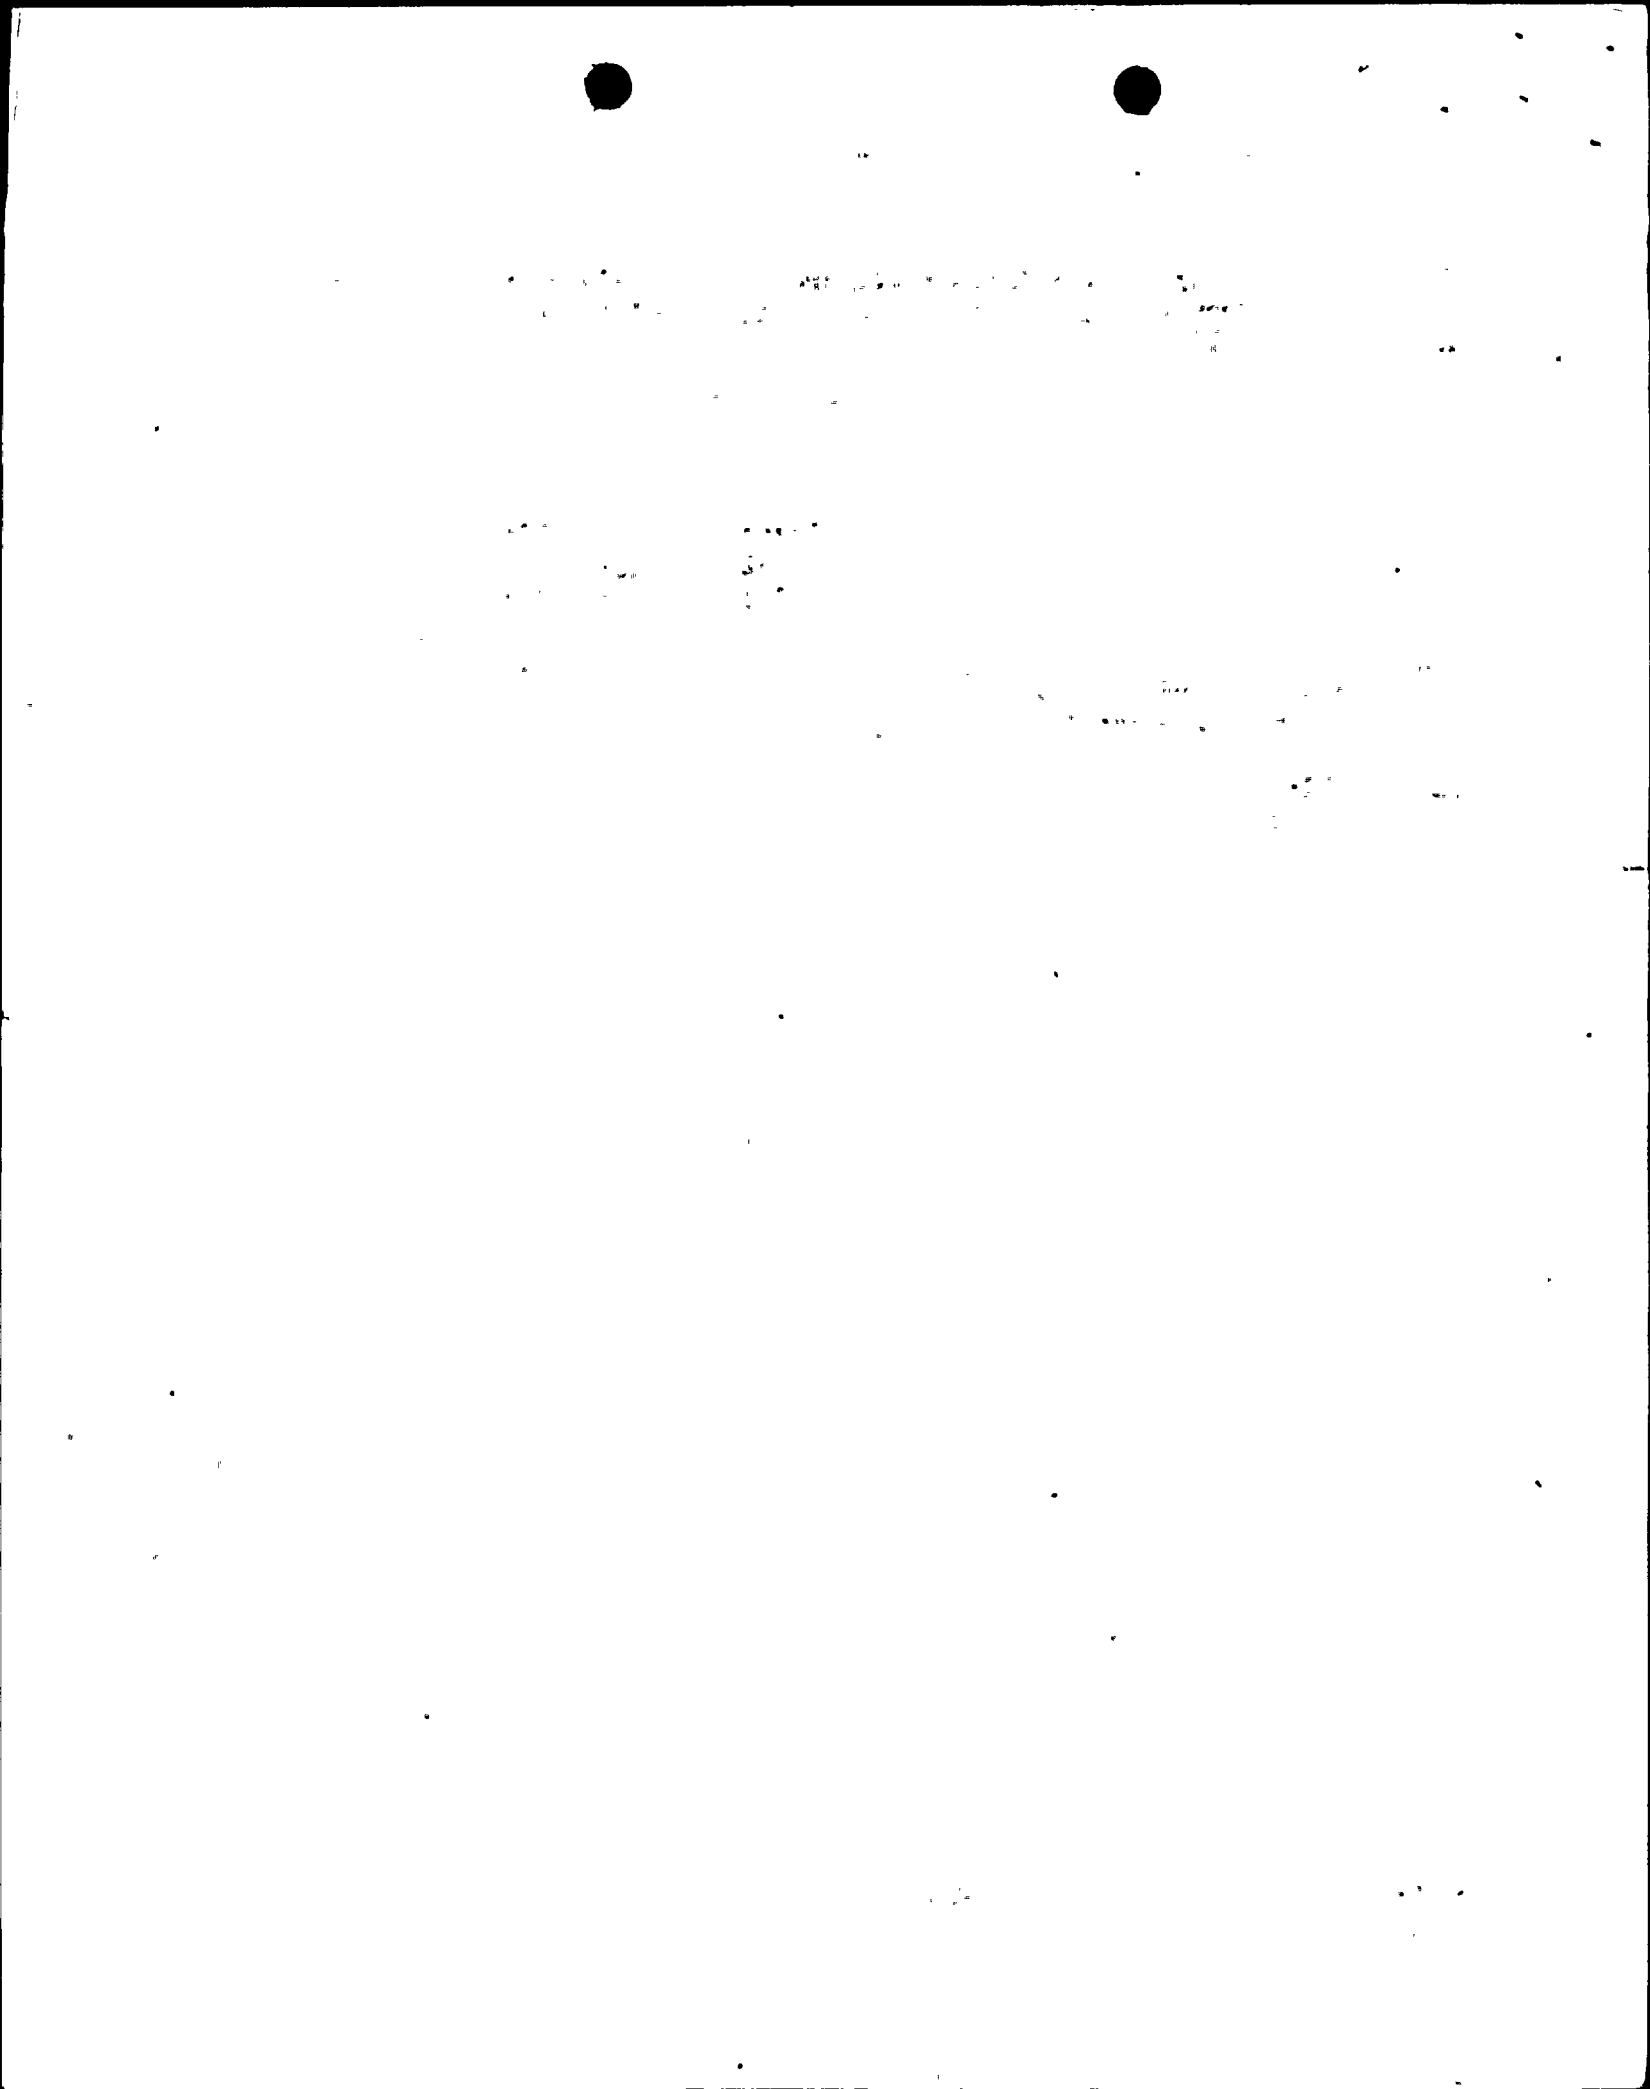

Mr. John Dolan
Indiana and Michigan Electric Company

cc: Mr. M. P. Alexich
Assistant Vice President.
for Nuclear Engineering
American Electric Power
Service Corporation.
2 Broadway
New York, New York 10004

Gerald Charnoff, Esquire
Shaw, Pittman, Potts and Trowbridge
1800 M Street, N.W.
Washington, D. C. 20036

W. G. Smith Jr., Plant Manager
Donald C. Cook Nuclear Plant
P. O. Box 458
Bridgman, Michigan 49106

U. S. Nuclear Regulatory Commission
Resident Inspectors Office
7700 Red Arrow Highway
Stevensville, Michigan 49127

William J. Scanlon, Esquire
2034 Pauline Boulevard
Ann Arbor, Michigan 48103

The Honorable Tom Corcoran
United States House of Representatives
Washington, D. C. 20515

James G. Keppler
Regional Administrator - Region III
U. S. Nuclear Regulatory Commission
799 Roosevelt Road
Glen Ellyn, Illinois 60137

