



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

INDIANA AND MICHIGAN ELECTRIC COMPANY

DOCKET NO. 50-315

DONALD C. COOK NUCLEAR PLANT UNIT NO. 1

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 67  
License No. DPR-58

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment by Indiana and Michigan Electric Company (the licensee) dated December 9, 1982, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.

8301280510 830120  
PDR ADOCK 05000315  
PDR


2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. DPR-58 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 67, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.

3. Within 90 days after the effective date of this amendment, or such later time as the Commission may specify, the Licensee shall satisfy any applicable requirement of P.L. 97-425 related to pursuing an agreement with the Secretary of Energy for the disposal of high-level radioactive waste and spent nuclear fuel.
4. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION

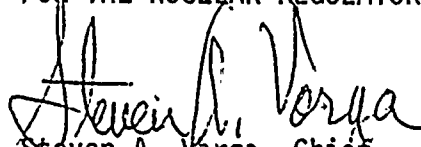

Steven A. Varga, Chief  
Operating Reactors Branch No. 1  
Division of Licensing

Attachment:  
Changes to the Technical  
Specifications

Date of Issuance: January 20, 1983



UNITED STATES  
NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D. C. 20555

INDIANA AND MICHIGAN ELECTRIC COMPANY

DOCKET NO. 50-316

DONALD C. COOK NUCLEAR PLANT UNIT NO. 2

AMENDMENT TO FACILITY OPERATING LICENSE

Amendment No. 49  
License No. DPR-74

1. The Nuclear Regulatory Commission (the Commission) has found that:
  - A. The application for amendment by Indiana and Michigan Electric Company (the licensee) dated December 9, 1982, complies with the standards and requirements of the Atomic Energy Act of 1954, as amended (the Act) and the Commission's rules and regulations set forth in 10 CFR Chapter I;
  - B. The facility will operate in conformity with the application, the provisions of the Act, and the rules and regulations of the Commission;
  - C. There is reasonable assurance (i) that the activities authorized by this amendment can be conducted without endangering the health and safety of the public, and (ii) that such activities will be conducted in compliance with the Commission's regulations;
  - D. The issuance of this amendment will not be inimical to the common defense and security or to the health and safety of the public; and
  - E. The issuance of this amendment is in accordance with 10 CFR Part 51 of the Commission's regulations and all applicable requirements have been satisfied.


2. Accordingly, the license is amended by changes to the Technical Specifications as indicated in the attachment to this license amendment, and paragraph 2.C.(2) of Facility Operating License No. DPR-74 is hereby amended to read as follows:

(2) Technical Specifications

The Technical Specifications contained in Appendices A and B, as revised through Amendment No. 49, are hereby incorporated in the license. The licensee shall operate the facility in accordance with the Technical Specifications.


3. This license amendment is effective as of the date of its issuance.

FOR THE NUCLEAR REGULATORY COMMISSION.

  
Steven A. Wurga, Chief  
Operating Reactors Branch #1  
Division of Licensing

Attachment:  
Changes to the Technical  
Specifications

Date of Issuance: January 20, 1983



ATTACHMENT TO LICENSE AMENDMENTS

AMENDMENT NO. 67 TO FACILITY OPERATING LICENSE NO. DPR-58

AMENDMENT NO. 49 TO FACILITY OPERATING LICENSE NO. DPR-74

DOCKET NOS. 50-315 AND 50-316

Revise Appendix A as follows:

Remove Page

Insert Page

6-11

6-11

6-12\*

6-12\*

\*Included for convenience.

## ADMINISTRATIVE CONTROLS

---

### RECORDS

6.5.2.10 Records of NSDRC activities shall be prepared, approved and distributed as indicated below:

- a. Minutes of each NSDRC meeting shall be prepared, approved and forwarded to the Vice Chairman, Engineering and Construction, AEPSC, within 14 days following each meeting.
- b. Reports of reviews encompassed by Section 6.5.2.7 above, shall be prepared, approved and forwarded to the Vice Chairman, Engineering and Construction, AEPSC, within 14 days following completion of the review.
- c. Audit reports encompassed by Section 6.5.2.8 above, shall be forwarded to the Vice Chairman, Engineering and Construction, AEPSC, and to the management positions responsible for the areas audited within 30 days after completion of the audit.

### 6.6 REPORTABLE OCCURRENCE ACTION

6.6.1 The following actions shall be taken for REPORTABLE OCCURRENCES:

- a. The Commission shall be notified and/or a report submitted pursuant to the requirements of Specification 6.9.
- b. Each REPORTABLE OCCURRENCE requiring 24 hour notification to the Commission shall be reviewed by the PNSRC and submitted to the NSDRC and the Chief, Nuclear Engineer.

## ADMINISTRATIVE CONTROLS

### AUDITS

6.5.2.8 Audits of facility activities shall be performed under the cognizance of the NSDRC. These audits shall encompass:

- a. The conformance of facility operation to provisions contained within the Technical Specifications and applicable license conditions at least once per 12 months.
- b. The performance, training and qualifications of the entire facility staff at least once per 12 months.
- c. The results of actions taken to correct deficiencies occurring in facility equipment, structures, systems or method of operation that affect nuclear safety at least once per 6 months.
- d. The performance of activities required by the Operational Quality Assurance Program to meet the criteria of Appendix "B", 10 CFR 50, at least once per 24 months.
- e. The Facility Emergency Plan and implementing procedures at least once per 12 months.
- f. The Facility Security Plan and implementing procedures at least once per 12 months.
- g. Any other area of facility operation considered appropriate by the NSDRC.
- h. The Facility Fire Protection Program and implementing procedures at least once per 24 months.
- i. An independent fire protection and loss prevention inspection and audit shall be performed at least once per 12 months utilizing either qualified offsite licensee personnel or an outside fire protection firm.
- j. An inspection and audit of the fire protection and loss prevention program shall be performed by an outside qualified fire consultant at least once per 36 months.

### AUTHORITY

6.5.2.9 The NSDRC shall report to and advise the Vice Chairman, Engineering and Construction, AEPSC, on those areas of responsibility specified in Sections 6.5.2.7 and 6.5.2.8.



## ADMINISTRATIVE CONTROLS

### RECORDS

6.5.2.10 Records of NSDRC activities shall be prepared, approved and distributed as indicated below:

- a. Minutes of each NSDRC meeting shall be prepared, approved and forwarded to the Vice Chairman, Engineering and Construction, AEPSC, within 14 days following each meeting.
- b. Reports of reviews encompassed by Section 6.5.2.7 above, shall be prepared, approved and forwarded to the Vice Chairman, Engineering and Construction, AEPSC, within 14 days following completion of the review.
- c. Audit reports encompassed by Section 6.5.2.8 above, shall be forwarded to the Vice Chairman, Engineering and Construction, AEPSC, and to the management positions responsible for the areas audited within 30 days after completion of the audit.

### 6.6 REPORTABLE OCCURRENCE ACTION

6.6.1 The following actions shall be taken for REPORTABLE OCCURRENCES:

- a. The Commission shall be notified and/or a report submitted pursuant to the requirements of Specification 6.9.
- b. Each REPORTABLE OCCURRENCE requiring 24 hour notification to the Commission shall be reviewed by the PNSRC and submitted to the NSDRC and the Chief, Nuclear Engineer.

## ADMINISTRATIVE CONTROLS

### AUDITS

6.5.2.8 Audits of facility activities shall be performed under the cognizance of the NSDRC. These audits shall encompass:

- a. The conformance of facility operation to provisions contained within the Technical Specifications and applicable license conditions at least once per 12 months.
- b. The performance, training and qualifications of the entire facility staff at least once per 12 months.
- c. The results of actions taken to correct deficiencies occurring in facility equipment, structures, systems or method of operation that affect nuclear safety at least once per 6 months.
- d. The performance of activities required by the Quality Assurance Program to meet the criteria of Appendix "B", 10 CFR 50, at least once per 24 months.
- e. The Facility Emergency Plan and implementing procedures at least once per 12 months.
- f. The Facility Security Plan and implementing procedures at least once per 12 months.
- g. Any other area of facility operation considered appropriate by the NSDRC.
- h. The Facility Fire Protection Program and implementing procedures at least once per 24 months.
- i. An independent fire protection and loss prevention program inspection and audit shall be performed at least once per 12 months utilizing either qualified offsite licensee personnel or an outside fire protection firm.
- j. An inspection and audit of the fire protection and loss prevention program shall be performed by a qualified outside fire consultant at least once per 36 months.

### AUTHORITY

6.5.2.9 The NSDRC shall report to and advise the Vice Chairman, Engineering and Construction, AEPSC, on those areas of responsibility specified in Sections 6.5.2.7 and 6.5.2.8.